

# PRELIMINARY / FINAL LAND DEVELOPMENT PLAN FOR 2509 MILL ROAD TOWNHOMES LOCATED IN UPPER ALLEN TOWNSHIP, CUMBERLAND COUNTY, PA



PENNSYLVANIA ACT 38  
(1991) AS AMENDED  
REQUIRES NOTIFICATION OF  
EXCAVATORS, DESIGNERS, OR  
ANY PERSON PREPARING TO  
DISTURB THE EARTH'S  
SURFACE ANYWHERE IN THE  
COMMONWEALTH. SERIAL NO.  
20211971405 IN UPPER  
ALLEN TOWNSHIP 7/27/2021

## UTILITY CO. CONTACTS

COMPANY: VERIZON  
PENNSYLVANIA LLC  
ADDRESS: 1026 HAY ST  
PITTSBURGH, PA. 15221  
CONTACT: DEBORAH BARUM  
deborah.d.della@verizon.com

COMPANY: MESSIAH UNIVERSITY  
ADDRESS: FACILITY SERVICES  
ONE UNIVERSITY AVE SUITE 3001  
MECHANICSBURG, PA. 17055  
CONTACT: RUSS EHRICH  
REHRICH@MESSIAH.EDU

COMPANY: UPPER ALLEN  
TOWNSHIP PUBLIC WORKS  
ADDRESS: 100 GETTYSBURG PIKE  
MECHANICSBURG, PA. 17055  
CONTACT: COLLIN BARGE  
CBARGE@UATWP.ORG

COMPANY: UGI UTIL LANCASTER  
ADDRESS: 1301 AIP DRIVE  
CONTACT: STEPHEN BATEMAN  
sbateman@ugl.com

COMPANY: SUEZ WATER  
PENNSYLVANIA INC.  
ADDRESS: 6310 ALLENTOWN  
BLVD  
HARRISBURG, PA. 17112  
CONTACT: NAT SHEFFER  
nathaniel.sheffer@suez.com

COMPANY: PPL ELECTRIC UTILITIES  
CORPORATION  
ADDRESS: 434 SUSQUEHANNA  
TRL  
NORTHUMBERBURG, PA. 17857  
CONTACT: DOUGLAS HAUP  
dihaupt@pplweb.com

COMPANY: UPPER ALLEN  
TOWNSHIP  
ADDRESS: 100 GETTYSBURG PIKE  
MECHANICSBURG, PA. 17055  
CONTACT: KODI HOCKENBERRY  
khockenberry@uatwp.org

## GENERAL NOTES:

- The purpose of this plan is to create a Preliminary / Final Land Development Plan depict the improvements required for am 18 rental Townhouse-style Attached Dwellings.
- All existing buildings within the site will be removed prior to development.
- The site survey is ...State Plane Coordinates (NAD 83 PA SOUTH ZONE GRID). Elevations are on NAVD 88 Datum referenced from NGS Benchmark
- .....The existing ground topography shown on this plan is a combination of a field survey conducted from 7/22/2021 to 11/30/2021 by R. J. Fisher & Associates, Inc.
- Proposed sanitary sewer mains located in Upper Allen Township will be offered for dedication to Upper Allen Township; all sanitary sewer construction methods and materials shall conform to the latest standards of Upper Allen Township, Cumberland County, Pennsylvania and shall be subject to approval by the appropriate Township official or Township Engineer.
- The Applicant shall prepare and submit sanitary sewer easement plats and legal descriptions for Township review prior to the start of sanitary sewer construction.
- Within clear sight triangles shown, no structure or growing material shall exceed a height of 3 feet above the grade of the street, and no branch of a tree, or obstruction, shall be lower than 9 feet above the grade of the street, with the exception of traffic signs, public utility poles, and similar-type structures
- All new utilities shall be placed underground.
- All stormwater drainage facilities located outside of dedicated and accepted public street rights-of-way shall be private, and shall be maintained by the developer. The developer shall maintain the drainage facilities to the design, dimensions and elevations indicated on these drawings, and such facilities shall be permanent unless and until a revised stormwater management plan is approved by Upper Allen Township, and/or PA D.E.P.
- The proposed water system shown hereon is schematic only, and shall be superseded by the water company design when Final Plans are approved.
- A minimum of 10-foot separation, or an 18" vertical separation, shall be maintained wherever possible between water lines and sanitary sewer lines.
- Approval by the Cumberland County Conservation District of a soil erosion and sedimentation control plan must be obtained prior to any earthmoving. Implementation of the erosion control plan is the responsibility of the lot owner.
- According to FEMA maps, there is no designated floodplain on this site.
- Concrete monuments will be set where indicated. All other property corners not already marked shall be marked with iron pins. Monuments and markers shall be of the proper size and material as outlined in section 220-24 of the Subdivision & Land Development Ordinance of Upper Allen Township.
- All public improvements shall comply with the applicable municipality's construction specifications, for the municipality in which the work is located.
- All work shall be in accordance with PennDOT Publication 408, Specifications and Publication 72, Roadway Construction Standards, unless otherwise noted.
- Signs shall be installed per PennDOT standards and specifications.
- Manhole covers for storm manholes shall be cast with the word "Storm Sewer" for identification purpose.
- Construction of all work within the public street right-of-way and work related to storm drainage facilities requires inspection by the Township.
- Contractor shall schedule a pre-construction site meeting with the Upper Allen Township Engineer at least 48 hours prior to starting site construction activities.
- Nothing shall be placed, planted, set or put within the area of an easement that would adversely affect the function of the easement or conflict with the easement agreement.
- Paper and digital Record Drawings shall be provided to Upper Allen Township; horizontal datum to be NAD 83 PA South Grid and vertical datum to be NAVD 88.
- All sanitary sewer construction in public street shall be subject to backfill compaction testing at the developer's expense.
- A Sewer Planning Module Exemption, DEP Code No.
- Upon Township acceptance of any sanitary sewer mains, laterals, manholes, and other appurtenances located in public streets but not yet dedicated to the Township, developer grants to Township a temporary sanitary sewer easement thirty feet in width measured from the centerline of the sanitary sewer main for that purpose of emergency or other repairs to the sanitary sewer system, until such time they are dedicated to the Township.
- Location of underground utilities is shown approximately hereon. Contractor shall contact PA One Call prior to any excavation or construction and filed verify utility locations and follow utility company requirements for protection, relocation, or removal.

Sheet List Table	
Sheet Number	Sheet Title
1	COVER SHEET
2	EXISTING CONDITIONS & DEMO PLAN
3	EXISTING CONDITIONS PLAN (ARIAL)
4	LAND DEVELOPMENT PLAN - SITE LAYOUT
5	GRADING & DRAINAGE PLAN
6	LANDSCAPE PLAN
7	E & S POLLUTION CONTROL PLAN
8	SITE LIGHTING PLAN
9	SANITARY SEWER PLAN & PROFILE
10	STORM SEWER PLAN & PROFILES
11	SITE DETAILS
12	SITE DETAILS
13	SWM DETAILS
14	SWM DETAILS
15	UTILITY DETAILS
16	UTILITY DETAILS
17	E&S CONTROL DETAILS
18	E&S CONTROL DETAILS

ZONING REQUIREMENTS		
Medium Density Residential	Required	Proposed
Minimum Street Frontage	20 feet (interior), 35 feet (exterior)	84.72 Feet
Maximum Building Coverage	30%	16.6%
Maximum Impervious Coverage	45%	43.5%
Lot Size	2000 s.f.	1.75 AC.
Minimum Front Yard	25 Feet	25 Feet
Minimum Side Yard	10 Feet (exterior side)	10 Feet
Minimum Rear Yard	15 Feet	15 Feet
Minimum Lot Width	20 feet (interior), 35 feet (exterior)	20 feet (interior), 35 feet (exterior)
Maximum Building Height	35 Feet	<35 Feet
Parking (2.25 space/unit)	32 Spaces	36 Spaces
Handicap Parking	1 Space	1 Space

## REQUIRED AGENCY APPROVALS/ PERMITS

APPROVAL	NUMBER	APPROVAL DATE	EXPIRATION DATE
PA DEP SEWAGE PLANNING MODULE EXEMPTION			
UPPER ALLEN TOWNSHIP SEWAGE PLANNING MODULE EXEMPTION CERTIFICATION			
UPPER ALLEN TOWNSHIP LAND DEVELOPMENT PLAN APPROVAL			
CUMBERLAND COUNTY CONSERVATION DISTRICT EROSION & SEDIMENT CONTROL PLAN ADEQUACY DETERMINATION			
CUMBERLAND COUNTY CONSERVATION DISTRICT / DEP NPDES NOTICE OF INTENT ACKNOWLEDGEMENT			

## TAX PARCEL NUMBER:

42-10-0256-019

## RECORDING:

THIS PLAN RECORDED IN THE OFFICE OF THE RECORDER OF DEEDS IN AND FOR

CUMBERLAND COUNTY THIS \_\_\_\_\_ DAY OF \_\_\_\_\_ 20\_\_.

PLAN BOOK \_\_\_\_\_, PAGE \_\_\_\_\_.

INSTRUMENT NUMBER \_\_\_\_\_.

## SITE DATA:

- Record owner and applicant: Mihail Malinov 2509 Mill Rd. Mechanicsburg, PA 17055 Phone: (717) 713-3892
- Deed reference: INST # 201623365
- Property is zoned Medium Density Residential (R-2) in Upper Allen Township.
- Gross acreage: 1.75 acres
- Existing number of lots: 1
- Proposed number of lots: 1
- Existing number of dwelling units: 1
- Proposed number of dwelling units: 14
- Proposed Density: 10.3 Units/ac.
- Proposed use: 14 Single-Family Attached (Townhouse) dwellings.
- Proposed total length of new public streets: 0 linear feet.
- Proposed total length of new private streets: 0 linear feet
- There are no streams, wetlands, significant rock outcrops, soil subsidences, floodplains, or contaminated soils known to exist on the Upper Allen Township portion of this site.
- Proposed water supply: public (Suez Water)
- Proposed sewage disposal: public
- Maximum proposed building height is 35 feet.
- Site is tax parcel number 42-10-0256-019.

## GEOLOGIST CERTIFICATION:

I, BLAIR C. KITLINSKI, P.E. OF F.T. KITLINSKI & ASSOCIATES, INC. (CONSULTING GEOTECHNICAL ENGINEERS) HEREBY CERTIFY THAT THE SITE IS NOT UNDERLAIN BY LIMESTONE BEDROCK OR OTHER CARBONATE GEOLOGIC FORMATION.

## OWNER & APPLICANT

MIHAIL MALINOV  
2509 MILL RD.  
MECHANICSBURG, PA 17055  
(717) 713-3892

BY UPPER ALLEN TOWNSHIP, I, MIHAIL MALINOV, HEREBY ACKNOWLEDGE THAT THE STORMWATER MANAGEMENT FACILITIES AND BMP'S ARE TO BE PERMANENT FIXTURES THAT CAN BE ALTERED OR REMOVED ONLY AFTER APPROVAL OF A REVISED PLAN



## R. J. FISHER & ASSOCIATES, INC.

▣ SITE PLANNING ▣ CIVIL ENGINEERING ▣ LAND SURVEYS

1546 BRIDGE STREET, NEW CUMBERLAND, PA. 17070

PHONE: (717) 774-7534 FAX: (717) 774-7190

WWW.RJFISHERENGINEERING.COM

No.	REVISION	DATE	DRAWING ID
1	—	—	221013-1-COV
2	—	—	
3	—	—	DATE: 04/25/2022
4	—	—	
COPYRIGHT © 2017 BY R.J. FISHER & ASSOCIATES, INC.			SHEET 1 OF 18.

## PLAN APPROVAL BLOCKS

REVIEWED THIS \_\_\_\_\_ DAY OF \_\_\_\_\_ 20\_\_ BY CUMBERLAND COUNTY PLANNING DEPARTMENT.

DIRECTOR OF PLANNING \_\_\_\_\_ DATE \_\_\_\_\_

APPROVED BY THE PLANNING COMMISSION OF UPPER ALLEN TOWNSHIP, THIS \_\_\_\_\_ DAY OF \_\_\_\_\_ 20\_\_.

ATTEST: \_\_\_\_\_ SECRETARY \_\_\_\_\_ DATE \_\_\_\_\_

CHAIRMAN \_\_\_\_\_ DATE \_\_\_\_\_

APPROVED BY THE BOARD OF COMMISSIONERS OF UPPER ALLEN TOWNSHIP, THIS \_\_\_\_\_ DAY OF \_\_\_\_\_, 20\_\_.

ATTEST: \_\_\_\_\_ SECRETARY \_\_\_\_\_ DATE \_\_\_\_\_

CHAIRMAN \_\_\_\_\_ DATE \_\_\_\_\_

## OWNER CERTIFICATION

COMMONWEALTH OF PENNSYLVANIA: \_\_\_\_\_:SS

COUNTY OF CUMBERLAND: \_\_\_\_\_:SS

ON THIS, THE \_\_\_\_\_ DAY OF \_\_\_\_\_, 20\_\_, BEFORE ME, \_\_\_\_\_, THE UNDERSIGNED OFFICER, PERSONALLY APPEARED \_\_\_\_\_, WHO ACKNOWLEDGED HIMSELF TO BE THE MANAGING PARTNER OF MCNAUGHTON PROPERTIES LP A LIMITED PARTNERSHIP, AND THAT HE, AS SUCH MANAGING PARTNER, BEING AUTHORIZED TO DO SO, EXECUTED THE FOREGOING INSTRUMENT FOR THE PURPOSE THEREIN CONTAINED BY SIGNING THE NAME OF THE LIMITED PARTNERSHIP BY HIMSELF AS MANAGING PARTNER.

IN WITNESS WHEREOF, I HAVE HEREUNTO SET MY HAND AND OFFICIAL SEAL

MY COMMISSION EXPIRES: \_\_\_\_\_

IT IS HEREBY CERTIFIED THAT THE UNDERSIGNED IS THE OWNER OF THE PROPERTY SHOWN ON THIS PLOT. ALL PROPOSED RIGHTS-OF-WAY ARE DEDICATED FOR PUBLIC USE. PROPOSED DRAINAGE AND SANITARY SEWER EASEMENTS ARE DEDICATED FOR UPPER ALLEN TOWNSHIP USE. WATER EASEMENTS ARE DEDICATED TO SUEZ WATER COMPANY USE.

OWNER: MIHAIL MALINOV


## ENGINEER & SURVEYOR

R.J. FISHER & ASSOCIATES  
ENGINEERING, PLANNING & SURVEYING  
1546 BRIDGE STREET  
NEW CUMBERLAND, PA 17070  
(717) 774-7534


I, MATTHEW R. FISHER, P.E., P.L.S., HEREBY CERTIFY THAT I AM A REGISTERED LAND SURVEYOR, AND A REGISTERED ENGINEER IN COMPLIANCE WITH THE LAWS OF THE COMMONWEALTH OF PENNSYLVANIA; THAT THIS PLAN CORRECTLY REPRESENTS A SURVEY COMPLETED BY ME ON 11/30/2021; THAT ALL THE MONUMENTS SHOWN THEREON ACTUALLY EXIST; AND THAT THEIR LOCATION, SIZE, TYPE AND MATERIAL ARE ACCURATELY SHOWN. ALL ELEMENTS OF THE PLAN ARE IN CONFORMITY WITH TOWNSHIP CODE AND ANY APPLICABLE STATE REGULATIONS.

MATTHEW R. FISHER, P.L.S., P.E.



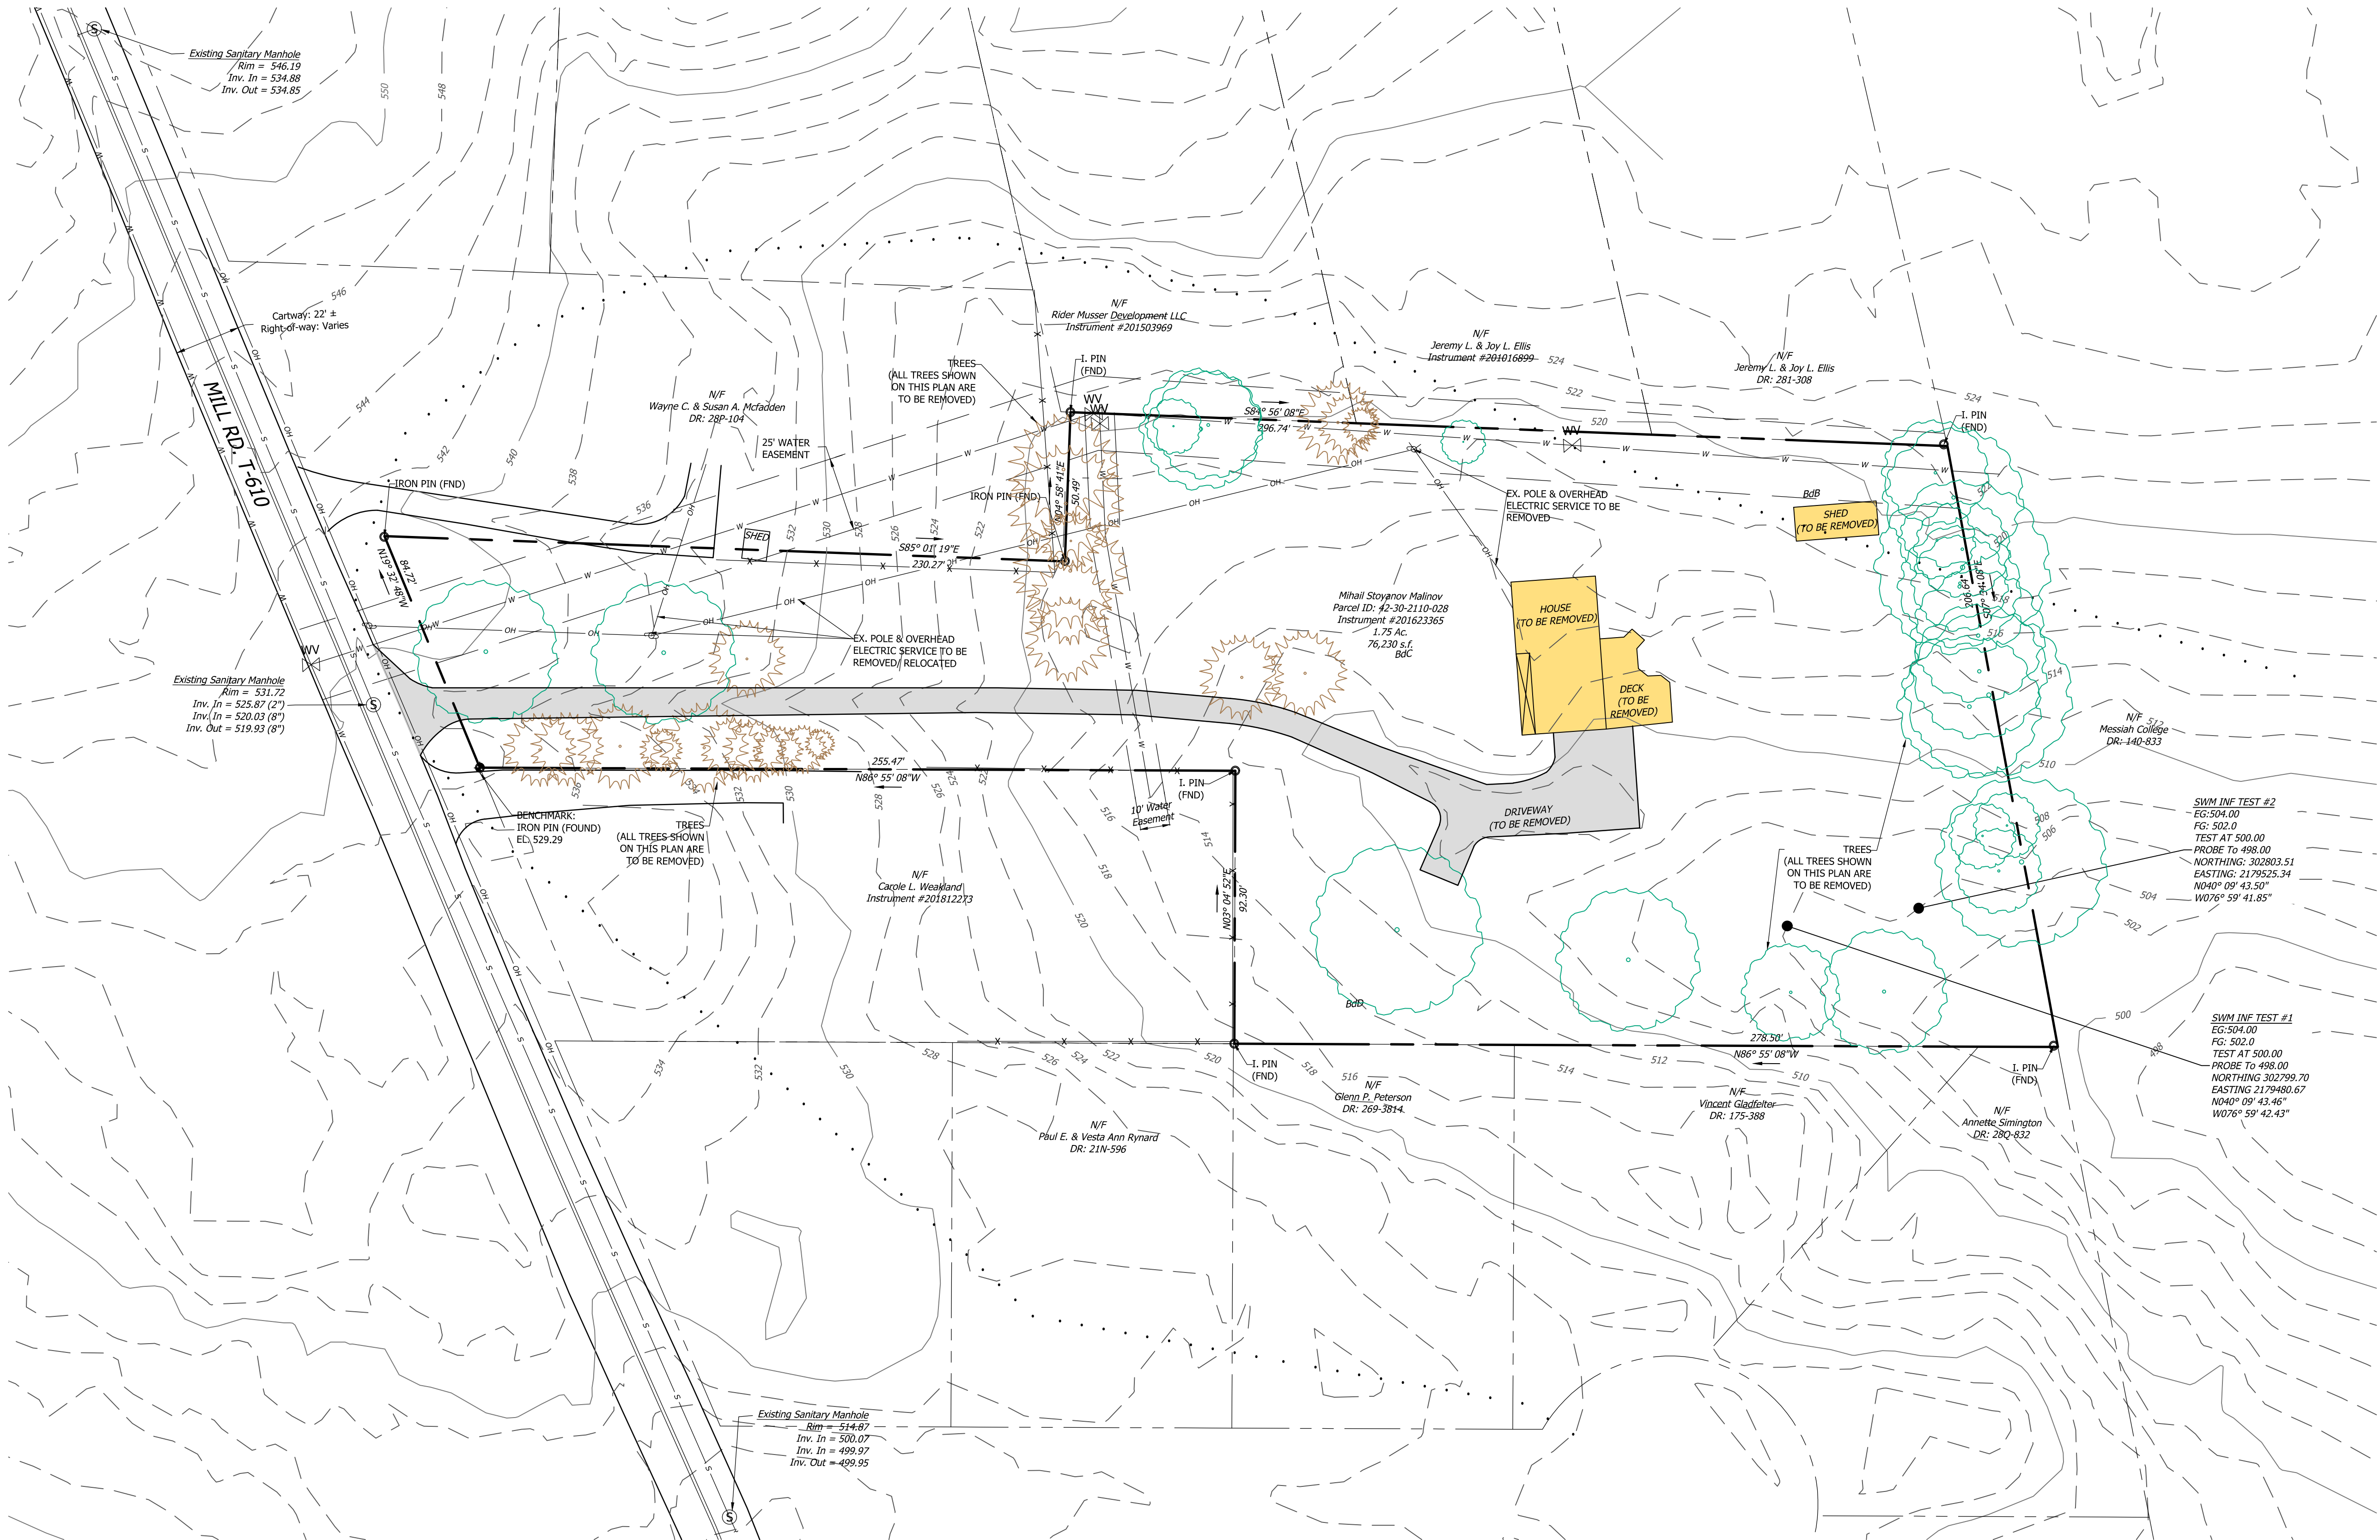


Existing Conditions Legend

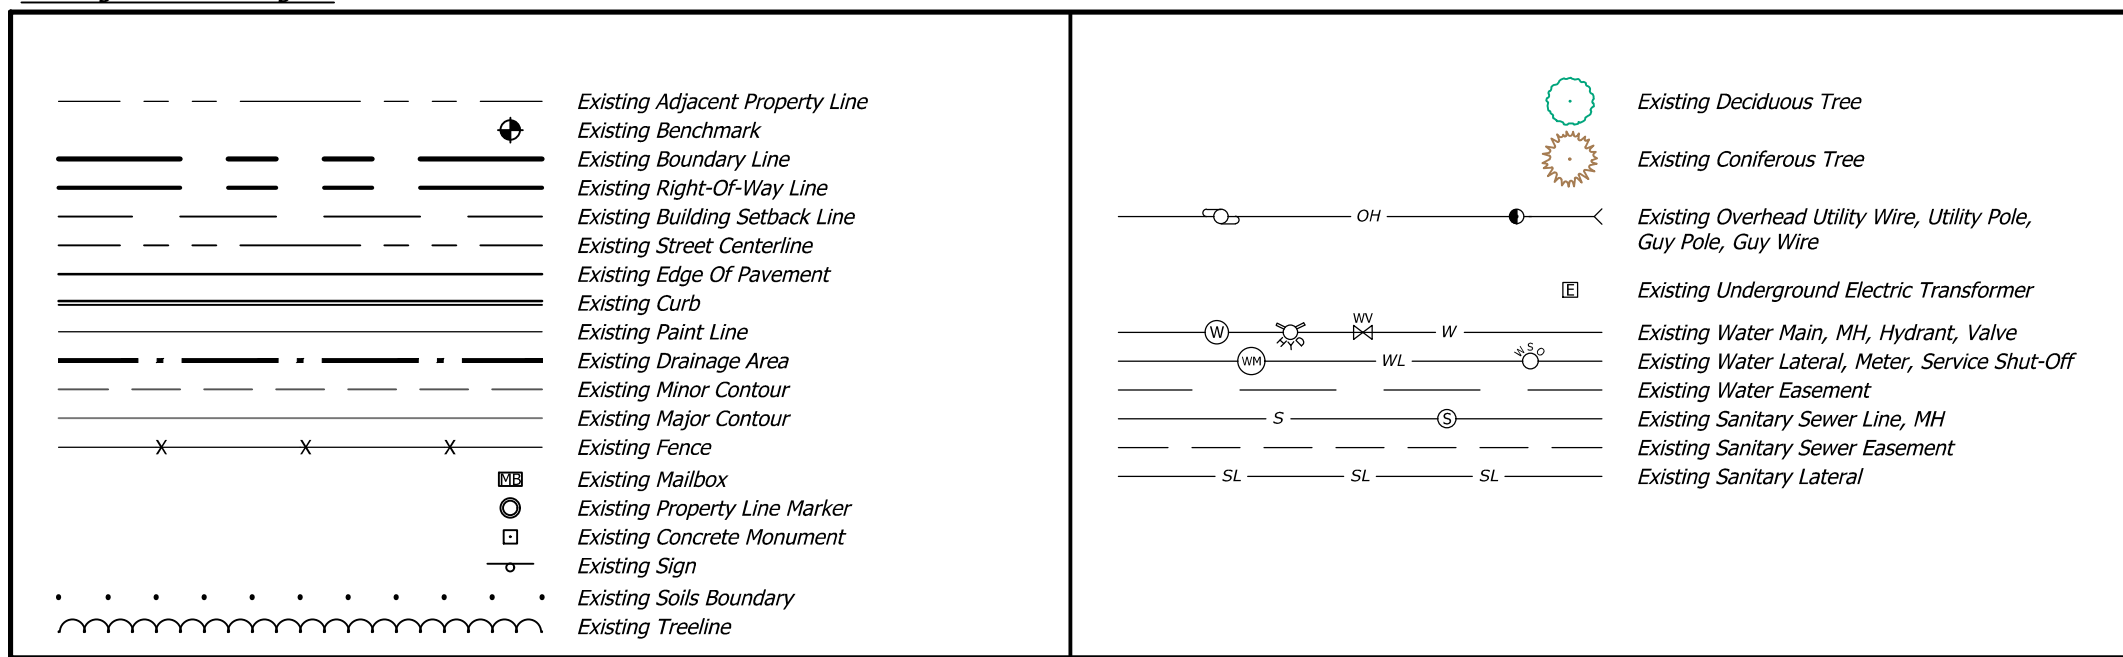

NOTES:

1. ALL TREES WITHIN PROPERTY AND LIMIT OF DISTURBANCE TO BE REMOVED, EXCEPT AS NOTED.

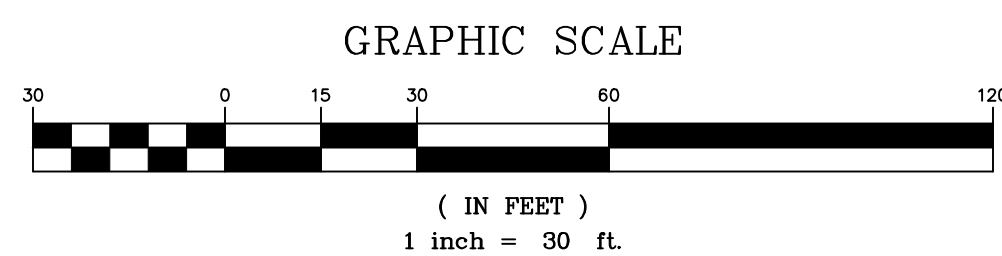

EXISTING CONDITIONS & DEMO PLAN  
FOR  
2509 MILL ROAD TOWNHOMES  
LOCATED IN  
UPPER ALLEN TOWNSHIP, CUMBERLAND COUNTY, PA

DRAWING ID: 221013-EC  
PROJECT: 221013  
DATE: 04/25/2022  
SHEET: 2 OF 18

R. J. FISHER & ASSOCIATES, INC.  
SITE PLANNING ■ CIVIL ENGINEERING ■ LAND SURVEYS  
1546 BRIDGE STREET, NEW CUMBERLAND, PA. 17070  
PHONE: (717) 774-7534 ■ FAX: (717) 774-7190  
RJFISHERENGINEERING.COM





NO.	REVISION	DATE
1		
2		
3		
4		
5	###	###

COPYRIGHT © ### BY R.J. FISHER & ASSOCIATES, INC.





\\p01\apps\p01\221013\221013-2509 Mill Rd.dwg  
PLOT: \\p01\apps\p01\221013\221013-2509 Mill Rd.dwg  
3 ECA

Existing Conditions Legend

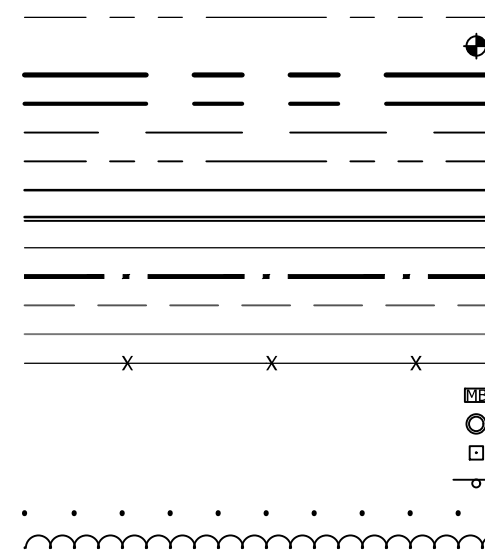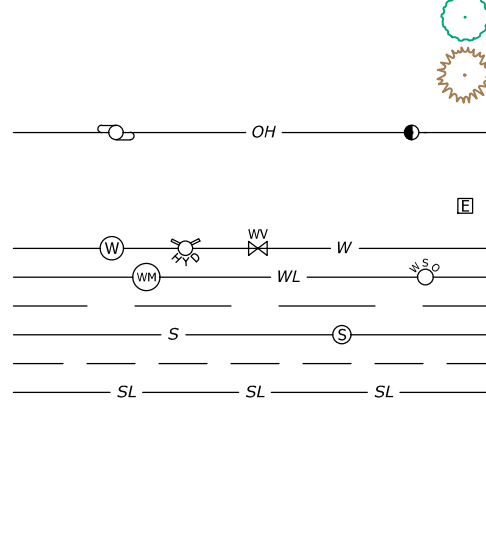	<ul style="list-style-type: none"><li>Existing Adjacent Property Line</li><li>Existing Benchmark</li><li>Existing Boundary Line</li><li>Existing Right-Of-Way Line</li><li>Existing Building Setback Line</li><li>Existing Street Centerline</li><li>Existing Edge Of Pavement</li><li>Existing Fence</li><li>Existing Paint Line</li><li>Existing Drainage Area</li><li>Existing Minor Contour</li><li>Existing Major Contour</li><li>Existing Mailbox</li><li>Existing Property Line Marker</li><li>Existing Concrete Monument</li><li>Existing Sign</li><li>Existing Soils Boundary</li><li>Existing Tree Line</li></ul>
	<ul style="list-style-type: none"><li>Existing Deciduous Tree</li><li>Existing Coniferous Tree</li><li>Existing Overhead Utility Wire, Utility Pole, Guy Pole, Guy Wire</li><li>Existing Underground Electric Transformer</li><li>Existing Water Main, MH, Hydrant, Valve</li><li>Existing Water Lateral, Meter, Service Shut-Off</li><li>Existing Water Easement</li><li>Existing Sanitary Sewer Line, MH</li><li>Existing Sanitary Sewer Easement</li><li>Existing Sanitary Lateral</li></ul>

NOTES:

- ALL TREES WITHIN PROPERTY AND LIMIT OF DISTURBANCE TO BE REMOVED, EXCEPT AS NOTED.

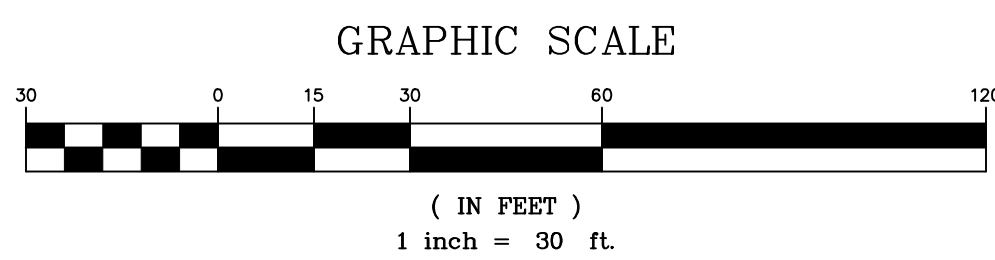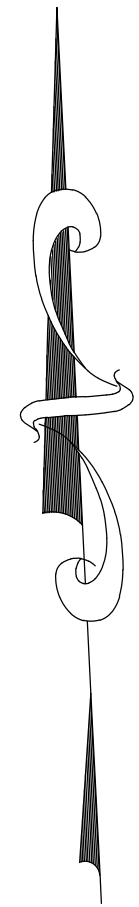

EXISTING CONDITIONS PLAN (AERIAL)

FOR  
2509 MILL ROAD TOWNHOMES

LOCATED IN  
UPPER ALLEN TOWNSHIP, CUMBERLAND COUNTY, PA



R. J. FISHER & ASSOCIATES, INC.

SITE PLANNING • CIVIL ENGINEERING • LAND SURVEYS

1546 BRIDGE STREET, NEW CUMBERLAND, PA. 17070

PHONE: (717) 774-7534 • FAX: (717) 774-7190


RJFISHERENGINEERING.COM

NO.	REVISION	DATE
1	—	—
2	—	—
3	—	—
4	—	—
5	###	###

COPYRIGHT © ### BY R.J. FISHER & ASSOCIATES, INC.





Sight Distance Table				
CL Access Drive & Mill Road Speed Limit = 25 MPH				
View From	Slope	Distance Required	Distance Available	
Left	Down Hill @ 7%	97 Feet	325 Feet	
Right	Up Hill @ 6%	100 Feet	421 Feet	

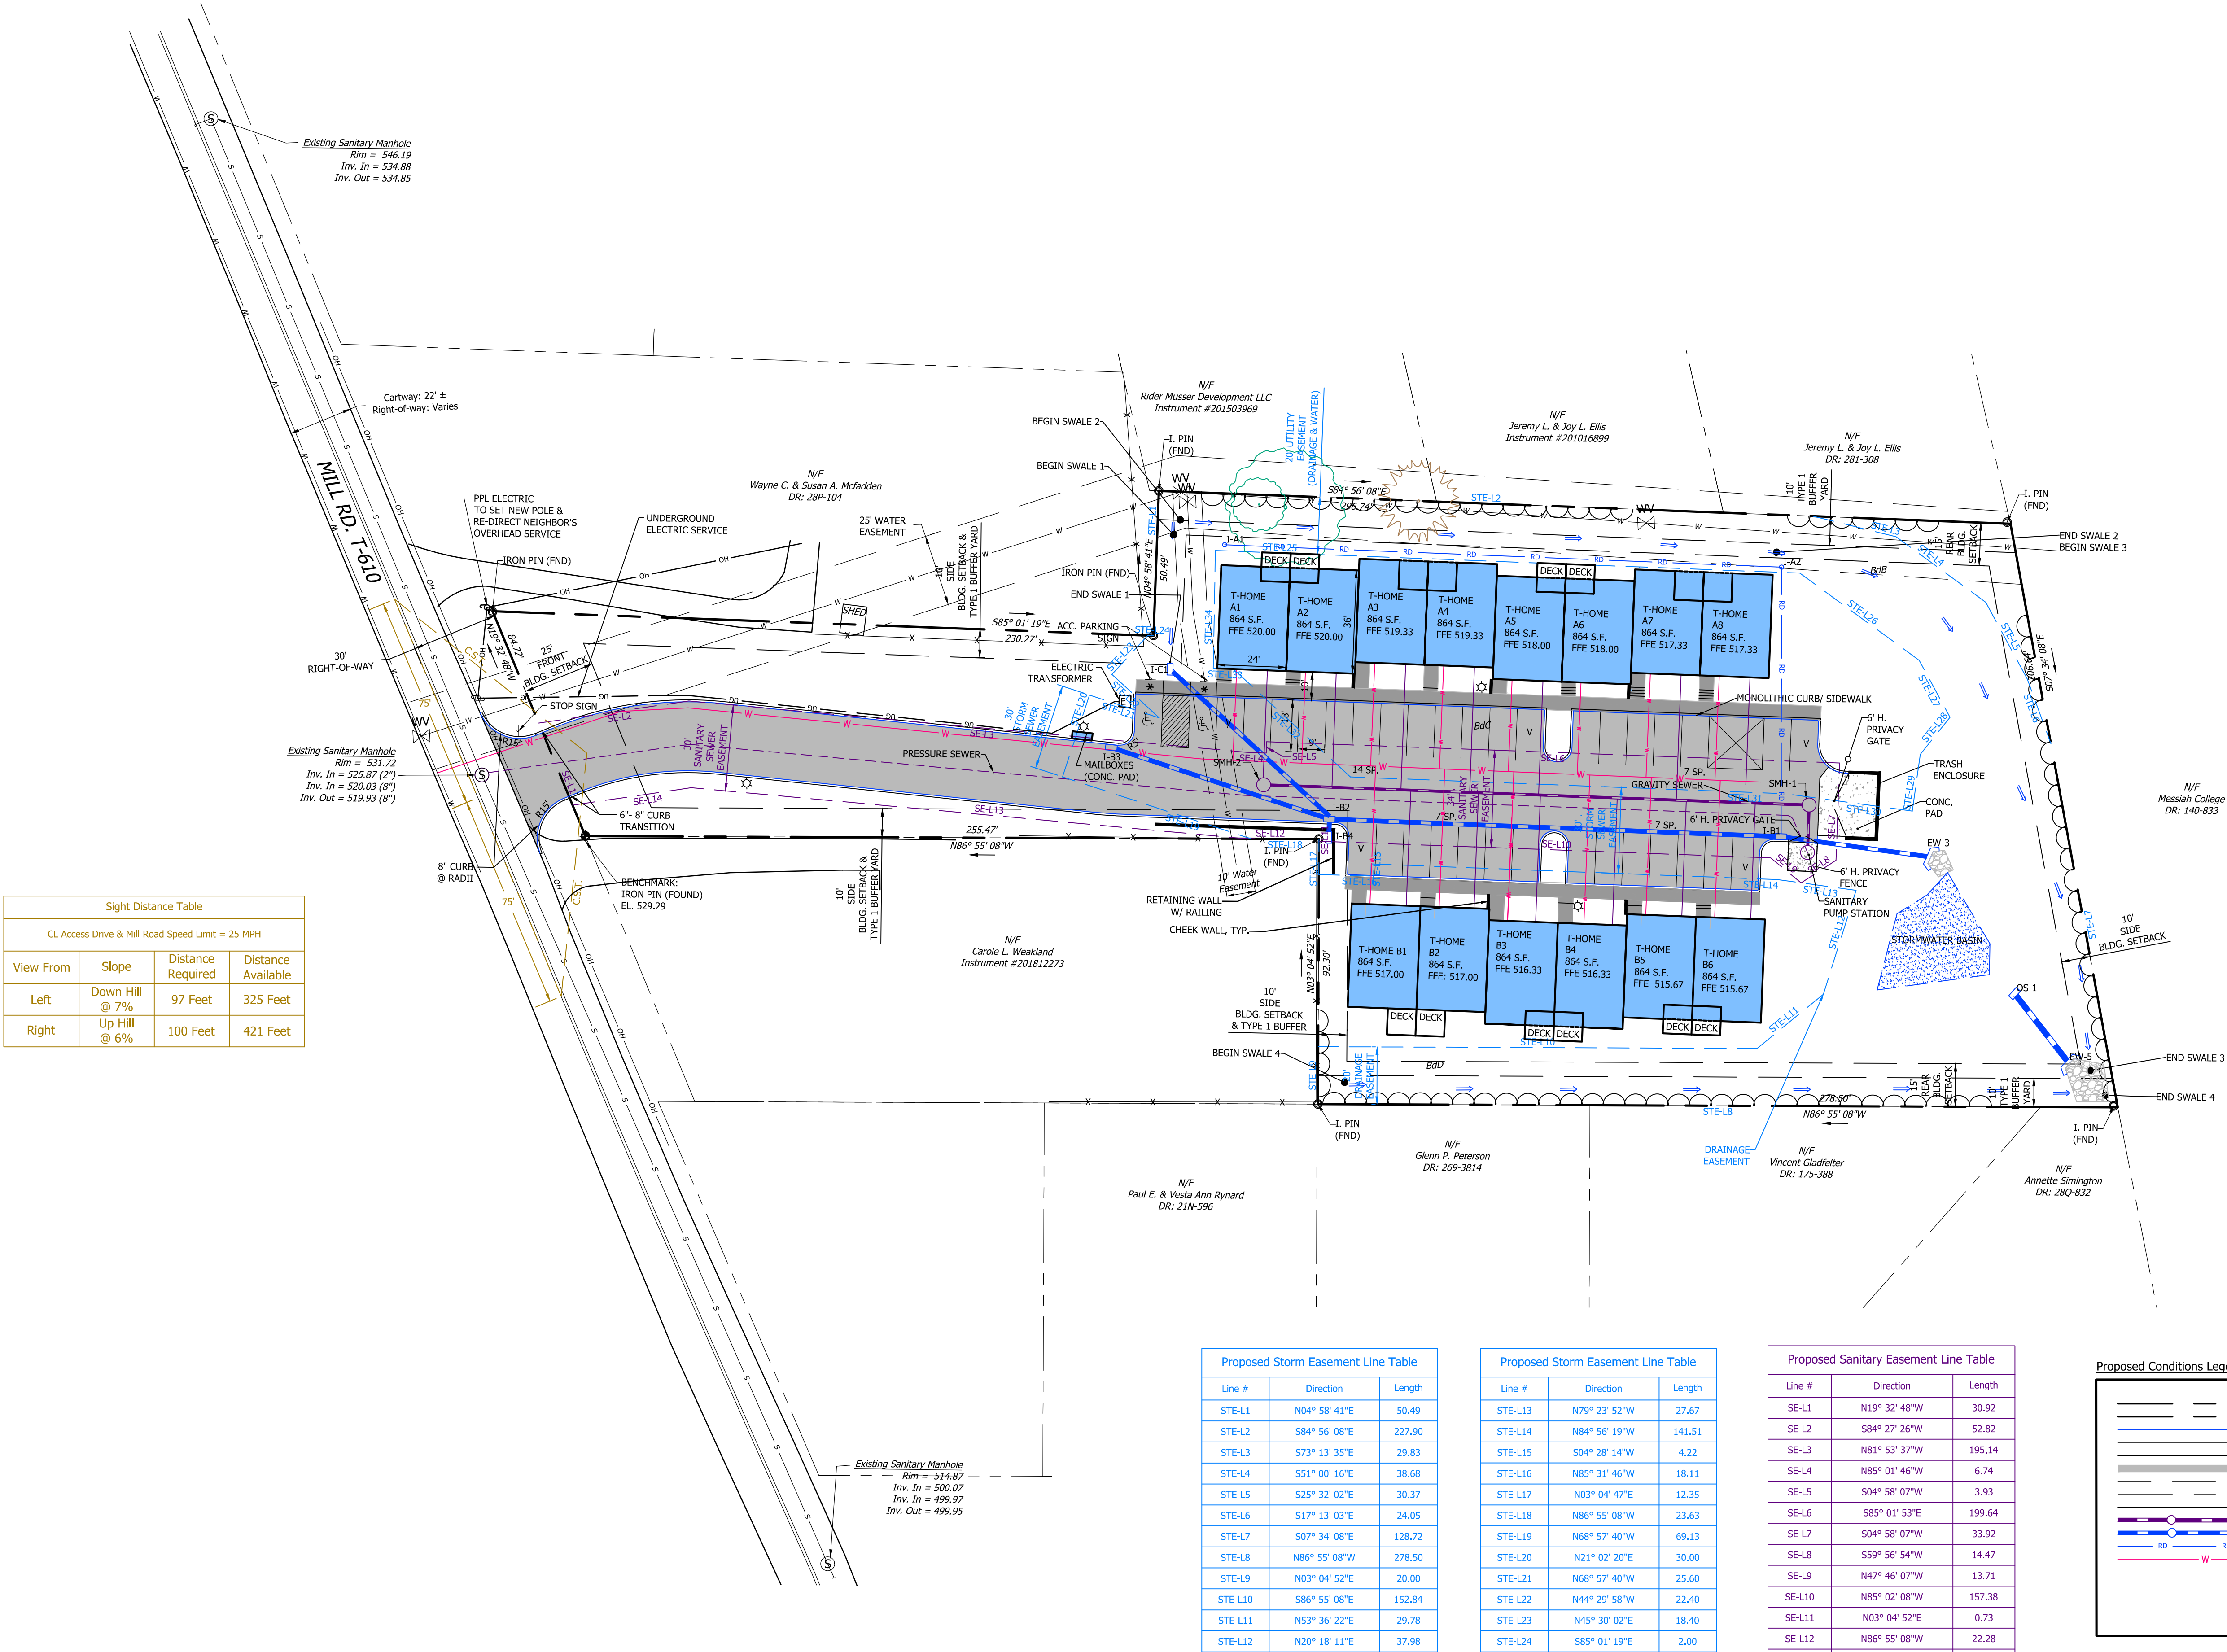

Proposed Storm Easement Line Table		
Line #	Direction	Length
STE-L1	N04° 58' 41"E	50.49
STE-L2	S84° 56' 08"E	227.90
STE-L3	S73° 13' 35"E	29.83
STE-L4	S51° 00' 16"E	38.68
STE-L5	S25° 32' 02"E	30.37
STE-L6	S17° 13' 03"E	24.05
STE-L7	S07° 34' 08"E	128.72
STE-L8	N86° 55' 08"W	278.50
STE-L9	N03° 04' 52"E	20.00
STE-L10	S86° 55' 08"E	152.84
STE-L11	N53° 36' 22"E	29.78
STE-L12	N20° 18' 11"E	37.98

Proposed Storm Easement Line Table		
Line #	Direction	Length
STE-L13	N79° 23' 52"W	27.67
STE-L14	N84° 56' 19"W	141.51
STE-L15	S04° 28' 14"W	4.22
STE-L16	N85° 31' 46"W	18.11
STE-L17	N03° 04' 47"E	12.35
STE-L18	N86° 55' 08"W	23.63
STE-L19	N68° 57' 40"W	69.13
STE-L20	N21° 02' 20"E	30.00
STE-L21	N68° 57' 40"W	25.60
STE-L22	N44° 29' 58"W	22.40
STE-L23	N45° 30' 02"E	18.40
STE-L24	S85° 01' 19"E	2.00

Proposed Sanitary Easement Line Table		
Line #	Direction	Length
SE-L1	N19° 32' 48"W	30.92
SE-L2	S84° 27' 26"W	52.82
SE-L3	N81° 53' 37"W	195.14
SE-L4	N85° 01' 46"W	6.74
SE-L5	S04° 58' 07"W	3.93
SE-L6	S85° 01' 53"E	199.64
SE-L7	S04° 58' 07"W	33.92
SE-L8	S59° 56' 54"W	14.47
SE-L9	N47° 46' 07"W	13.71
SE-L10	N85° 02' 08"W	157.38
SE-L11	N03° 04' 52"E	0.73
SE-L12	N86° 55' 08"W	22.28
SE-L13	N81° 53' 37"W	192.37

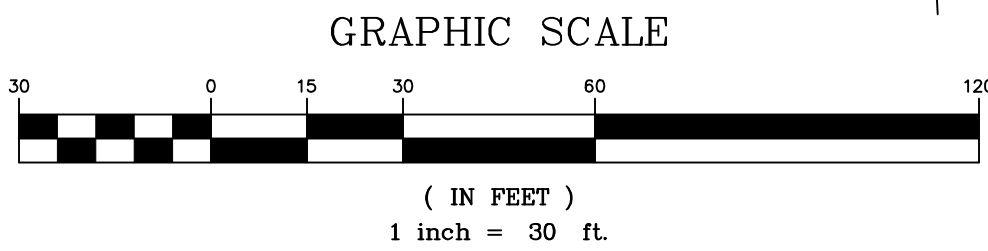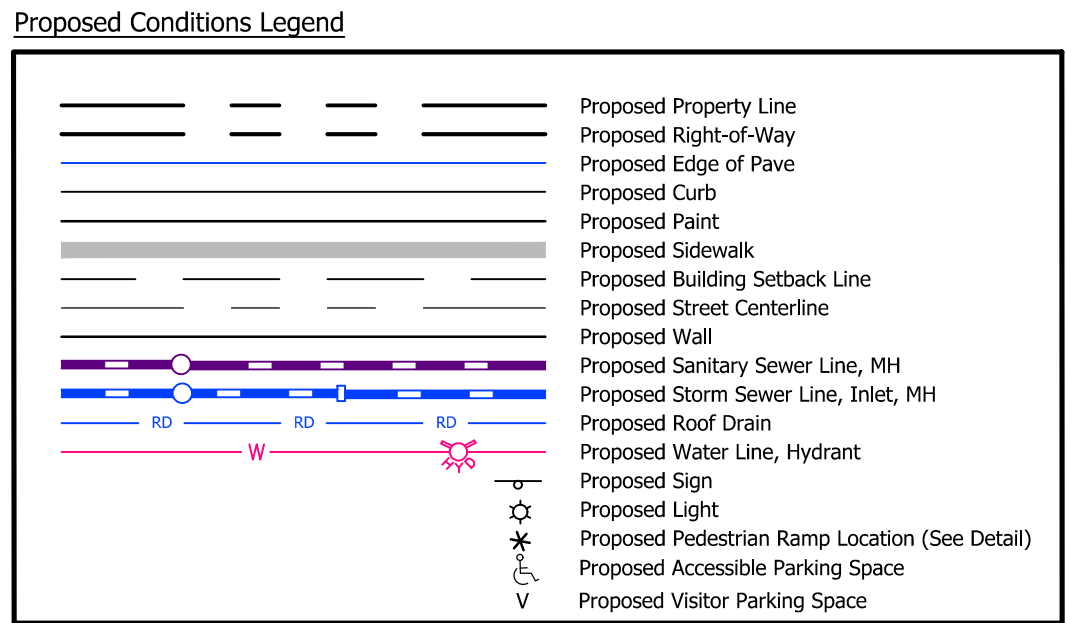

LAND DEVELOPMENT PLAN - SITE LAYOUT  
FOR  
2509 MILL ROAD TOWNHOMES  
LOCATED IN  
UPPER ALLEN TOWNSHIP, CUMBERLAND COUNTY, PA

DRAWING ID: 221013-3-LD  
PROJECT: 221013  
DATE: 04/25/2022  
SHEET: 4 OF 18


R. J. FISHER & ASSOCIATES, INC.  
SITE PLANNING & CIVIL ENGINEERING & LAND SURVEYS  
1546 BRIDGE STREET, NEW CUMBERLAND, PA. 17070  
PHONE: (717) 774-7534 & FAX: (717) 774-7190  
RJFISHERENGINEERING.COM



NO.	REVISION	DATE
1		
2		
3		
4		
5		

COPYRIGHT © 2021 BY R. J. FISHER & ASSOCIATES, INC.



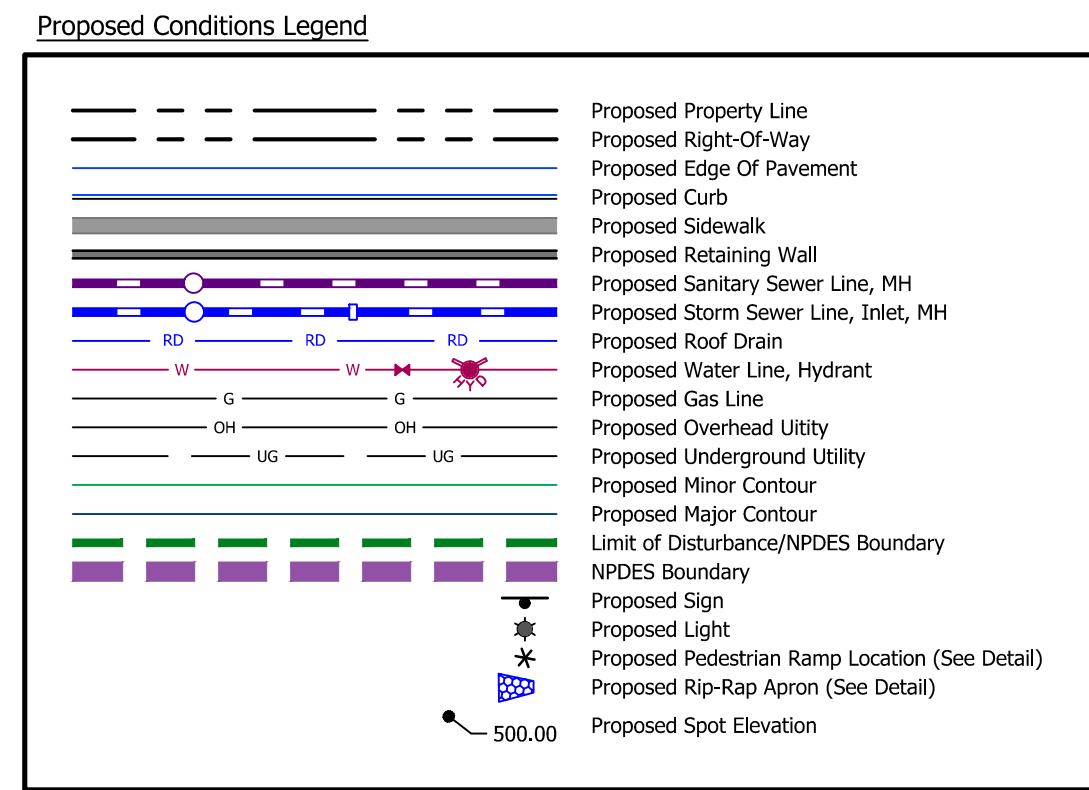

**FISHER**  
& Associates, Inc.

DRAWING ID:	221013-5-GD
PROJECT:	221013
DATE:	04/25/2022
SHEET:	5 OF 18

NO.	REVISION	DATE
1	—	—
2	—	—
3	—	—
4	—	—
5	—	—

COPYRIGHT © 2021 BY R.J. FISHER & ASSOCIATES, INC.

COPYRIGHT © 2021 BY R.J. FISHER & ASSOCIATES, INC.




6-145P  
C:\Users\jfisher\OneDrive\Documents\221013-6-LSP.dwg  
J.FISHER 2/21/2022 10:45:29 AM

PLANTING SCHEDULE						
245-16.5.C., 220-5.13.B.1, TYPE 1 BUFFER REQUIRES 1 SHADE TREE PER 50 LF OF BUFFER AND 1 EVERGREEN TREE PER 40 LF OF BUFFER YARD; 220-5.13 DUMPSTER SCREENING: 1 SHADE TREE PER LF AND 1 EVERGREEN TREE PER 5 LF OF VISIBILITY; 114.5' OF TYPE 1 BUFFER = 23 SHADE TREES REQUIRED, 23 PROPOSED; 29 EVERGREENS, 47 PROPOSED; 4 EVERGREENS @ DUMPSTER, 4 PROPOSED						
SYMBOL	ID	QUANTITY	BOTANICAL NAME	COMMON NAME	PLANTING SIZE/ CONDITIONS	NATIVE (N)
NS		14	NYSSA SYLVATICA	BLACKGUM	2 to 2-1/2" CAL. B&B, 40" O.C MAX	N
QR		9	QUERCUS ROBAR 'FASTIGIATA'	COLUMNAR ENGLISH OAK	2 to 2-1/2" CAL. B&B	N
JV		25	JUNIPERUS VIRGINIANA	EASTERN REDCEDAR	6'H. B&B, 15" O.C., ADJUST LOCATION TO AVOID PLANTING WITHIN 10' OF HEALTHY TREE TO BE SAVED	N
JS		26	JUNIPERUS SCOPULORUM 'MOONGLOW'	MOONGLOW JUNIPER	6' H., #10 CONTAINER	
220-5.13.D.7 STREET TREES REQUIRED 2 PER 100 LF OF RIGHT-OF-WAY, 84/100 = 2 REQUIRED, 2 PROPOSED						
AG		2	AMELANCHIER X GRANDIFLORIA	AUTUMN BRILLIANCE APPLE SERVICEBERRY	2" CALIPER (CAL.), BALLED & BURLAPPED (B&B) ROOT	N
205-5.13.q.5 TYPE 3 BUFFER REQUIRED FOR STORMWATER FACILITY, 1 SHADE TREE PER 30 LF AND 1 EVERGREEN TREE PER 10 LF AND 1 SHRUB PER 10 LF OF BERM PERIMETER REQUIRED PERIMETER = 340', 340/30 = 12 SHADE TREES REQUIRED, 12 PROPOSED; 340/10 = 34 EVERGREEN TREES, 34 PROPOSED; 34 SHRUBS REQUIRED, 34 SHRUBS PROPOSED						
AG		12	AMELANCHIER X GRANDIFLORIA	AUTUMN BRILLIANCE APPLE SERVICEBERRY	2" CALIPER (CAL.), BALLED & BURLAPPED (B&B) ROOT	N
JS		34	JUNIPERUS SCOPULORUM 'MOONGLOW'	MOONGLOW JUNIPER	6' H., #10 CONTAINER	
IG		34	ILEX GLABRA 'INKBERRY'	COMPACT INKBERRY HOLLY	4" W. X 4" H. EVERGREEN SHRUB	N
205-5.13.B.2.b 1 SHADE TREE FOR EACH LANDSCAPE ISLAND REQUIRED						
QR		3	QUERCUS ROBAR 'FASTIGIATA'	COLUMNAR ENGLISH OAK	2 to 2-1/2" CAL. B&B	N

## GENERAL LANDSCAPE NOTES:

- ALL LANDSCAPE MATERIALS SHALL BE PLACED AND PLANTED IN ACCORDANCE WITH THIS PLAN AND ALL APPLICABLE STANDARDS AND REQUIREMENTS OF THE UPPER ALLEN TOWNSHIP ZONING AND SUBDIVISION/ LAND DEVELOPMENT ORDINANCES.
- THE OWNER WILL BE RESPONSIBLE FOR THE PROPER MAINTENANCE OF ALL PLANT MATERIALS. ALL PLANTINGS WILL BE INSTALLED, MAINTAINED AND REPLACED BY THE OWNER, IF DEAD OR DISEASED, IN LOCATIONS AS SHOWN ON THIS APPROVED LANDSCAPE PLAN.
- ALL PLANT MATERIALS SHALL BE PLANTED IN ACCORDANCE WITH GOOD NURSERY AND LANDSCAPING PRACTICES WITH ADEQUATE UNPAVED SURFACE AROUND EACH FOR WATER AND AIR AND SHALL BE PROPERLY PROTECTED BY CURBS, CURB STOPS, DISTANCE OR OTHER PROTECTIVE DEVICES TO PREVENT DAMAGE FROM VEHICLES. ANY AND ALL OTHER APPLICABLE STANDARDS ESTABLISHED BY THE TOWNSHIP SHALL ALSO APPLY. INDIVIDUAL PLANTS SHOULD BE MULCHED IN A CIRCLE OF MINIMUM DIAMETER OF 3 FT.. GROUPS OF SHRUBS SHOULD BE IN A CONTINUOUS ORGANICALLY-SHAPED MULCH BED.
- ALL PLANT MATERIALS SHALL BE NURSERY GROWN IN A CLIMATE SIMILAR TO THAT OF THE LOCALITY OF THE SUBJECT TRACT.
- ALL PLANT MATERIALS SHALL HAVE A NORMAL, SYMMETRICAL GROWTH HABIT AND SHALL BE SOUND, HEALTHY AND VIGOROUS AND SHALL BE FREE FROM DISEASE, INSECTS, INSECT EGGS AND LARVAE.
- REQUIREMENTS FOR THE MEASUREMENT, BRANCHING, GRADING, QUALITY, BALLING AND BURLAPPING OF PLANT MATERIALS SHALL FOLLOW THE CODE OF STANDARDS RECOMMENDED BY THE AMERICAN NURSERY AND LANDSCAPE ASSOCIATION IN THE AMERICAN STANDARD FOR NURSERY STOCK, ANSI Z.60, CURRENT EDITION. PLANTS SHALL BE SO TRAINED IN DEVELOPMENT AND APPEARANCE TO BE PROPER IN FORM, COMPACTNESS AND SYMMETRY. THEY SHALL BE SOUND, HEALTHY, VIGOROUS, WELL BRANCHED, DENSELY FOLIATED WHEN IN LEAF AND FREE OF DISEASE AND INSECTS OF ANY KIND.
- LAYOUT OF PLANTS PRIOR TO PLANTING SHALL BE VERIFIED BY THE OWNER/DEVELOPER AND/OR THEIR REPRESENTATIVE.
- PRIOR TO PLANTING, TREES SHALL BE INSPECTED BY THE OWNER/DEVELOPER AND/OR THEIR REPRESENTATIVE FOR INJURY TO TRUNKS, EVIDENCE OF INSECT INFESTATION, OR IMPROPER PRUNING.
- ALL ROPES, STAVES, TAGS OR OTHER BINDINGS SHALL BE CUT OFF THE TOPS AND SIDES OF THE BALLS AND REMOVED FROM PITTS. ALL ROT-PROOF, ROT-RESISTANT, PLASTIC BURLAP AND TOP HALF OF WIRE BASKET (MINIMUM) BALL COVERINGS SHALL BE REMOVED BEFORE PLANTING.
- DIAMETER OF PITTS FOR TREES AND B+B SHRUBS SHALL BE AT LEAST 2 FEET GREATER THAN THE DIAMETER OF THE BALL OR SPREAD OF ROOTS. DIAMETER OF PITTS FOR BARE-ROOTED TREES AND SHRUBS SHALL BE AT LEAST 1 FOOT GREATER THAN THE SPREAD OF ROOTS. NEVER CUT LEADER, PRUNE TOP OF BARE-ROOTED SHRUBS AND LATERAL BRANCHES OF TREE TO BALANCE LOSS OF ROOTS RESULTING FROM DIGGING. REFER TO DETAIL SHEET FOR PLANTING DETAILS.
- PLANT SUBSTITUTIONS MAY BE PERMITTED IF APPROVED BY THE OWNER/DEVELOPER AND LEMOYNE BOROUGH. ANY APPROVED SUBSTITUTION SHALL BE MADE IN LIKE KIND, SUITABLE FOR MICRO-CLIMATE AND SOIL CONDITIONS OF PLANTING SITE AND BE EQUIVALENT IN MATURE HEIGHT & WIDTH, GENERAL TYPE, HARDINESS.
- THE CONTRACTOR IS SOLELY RESPONSIBLE FOR IDENTIFYING AND AVOIDING DISRUPTION OR DAMAGE OF ANY AND ALL UNDERGROUND UTILITY LOCATIONS, PRIOR TO DIGGING, PERFORMING A PA ONE CALL, AND PERFORMING EXPLORATORY TESTING AS MAY OTHERWISE BE REQUIRED. ANY AND ALL DAMAGE TO UNDERGROUND UTILITIES, WHETHER KNOWN OR UNKNOWN, IS AND WILL BE THE SOLE RESPONSIBILITY AND LIABILITY OF THE CONTRACTOR.
- THE CONTRACTOR SHALL SPRAY PAINT OR OTHERWISE MARK ALL PROPOSED PLANTING BED LINES FOR OWNER APPROVAL PRIOR TO CUTTING IN PROPOSED BEDS.
- IF ANY DISCREPANCIES BETWEEN QUANTITIES IN PLANTING SCHEDULES AND THOSE SHOWN ON THE PLAN, THE PLAN SHALL GOVERN.
- ALL TREES SHALL BE GUYED OR STAKED FOR ONE YEAR FOLLOWING PLANTING. ALL GUYS OR STAKES SHOULD BE REMOVED ONE YEAR FROM INSTALLATION.
- TREE CANOPIES WILL BE MAINTAINED TO BE CLEAR OF BRANCHES AND LEAVES FROM GROUND TO 8 FT HEIGHT ABOVE CLEAR SIGHT TRIANGLE, SIDEWALKS, STREETS, PARKING AREAS AND OTHER AREAS OF PEDESTRIAN / VEHICLE CIRCULATION AREAS.
- PLANT BACKFILL MIX SHALL BE 75% TOPSOIL AND 25% PEAT (TOPSOIL & PEAT CONFORMING TO PENNDOT PUB. 408, SECTION 802 SPECIFICATIONS).

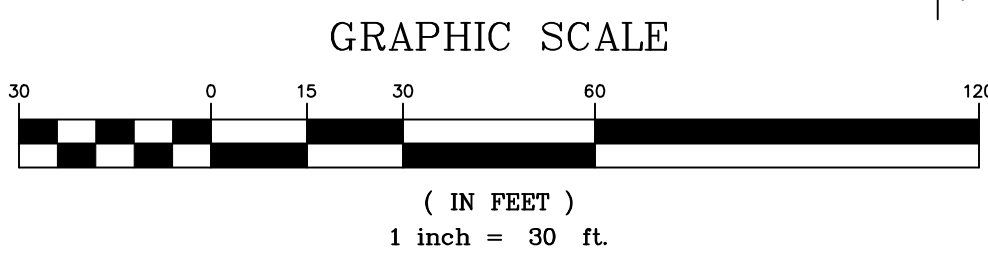

**R. J. FISHER & ASSOCIATES, INC.**  
SITE PLANNING ■ CIVIL ENGINEERING ■ LAND SURVEYS  
1546 BRIDGE STREET, NEW CUMBERLAND, PA. 17070  
PHONE: (717) 774-7534 ■ FAX: (717) 774-7190  
**RJFISHERENGINEERING.COM**




**LANDSCAPE PLAN**  
FOR  
**2509 MILL ROAD TOWNHOMES**  
LOCATED IN  
UPPER ALLEN TOWNSHIP, CUMBERLAND COUNTY, PA

DRAWING ID:  
221013-6-LSP  
PROJECT: 221013  
DATE: 04/25/2022  
SHEET:  
**6 OF 18**

NO.	REVISION	DATE
1		
2		
3		
4		
5		

COPYRIGHT © 2021 BY R.J. FISHER & ASSOCIATES, INC.



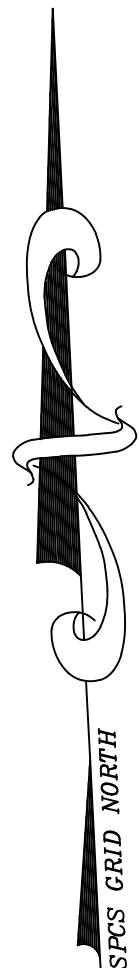

LOCATED IN  
UPPER ALLEN TOWNSHIP, CUMBERLAND COUNTY, PA

**R. J. FISHER & ASSOCIATES, INC.**  
SITE PLANNING ▫ CIVIL ENGINEERING ▫ LAND SURVEYS  
1546 BRIDGE STREET, NEW CUMBERLAND, PA. 17070  
PHONE: (717) 774-7534 ▫ FAX: (717) 774-7190  
[RJFISHERENGINEERING.COM](http://RJFISHERENGINEERING.COM)

NO.	REVISION	DATE
1	—	—
2	—	—
3	—	—
4	—	—
5	—	—

COPYRIGHT © 2021 BY R.J. FISHER & ASSOCIATES, INC.

COPYRIGHT © 2021 BY R.J. FISHER & ASSOCIATES, INC.

SHEET:  
**7 OF 18**




7 OF 18

( IN FEET )  
1 inch = 30 ft

J:\PROJECTS\2021\221013\CAD\LD-SUB\221013-ENS.DWG  
XREF: ..\XREF\221013-D.dwg



DESIGN AREA MEETS ILLUMINATION ENGINEERING SOCIETY'S RECOMMENDED PRACTICE FOR PARKING AREAS PER RP-20  
TYPE S1 MEETS FULL CUTOFF CLASSIFICATION  
LCS TABLE BUG RATING B4-U0-G2  
+0.0 3' FOOT CANDLE VALUE

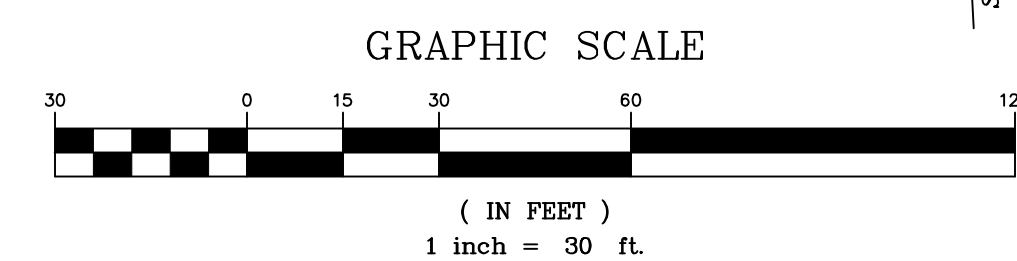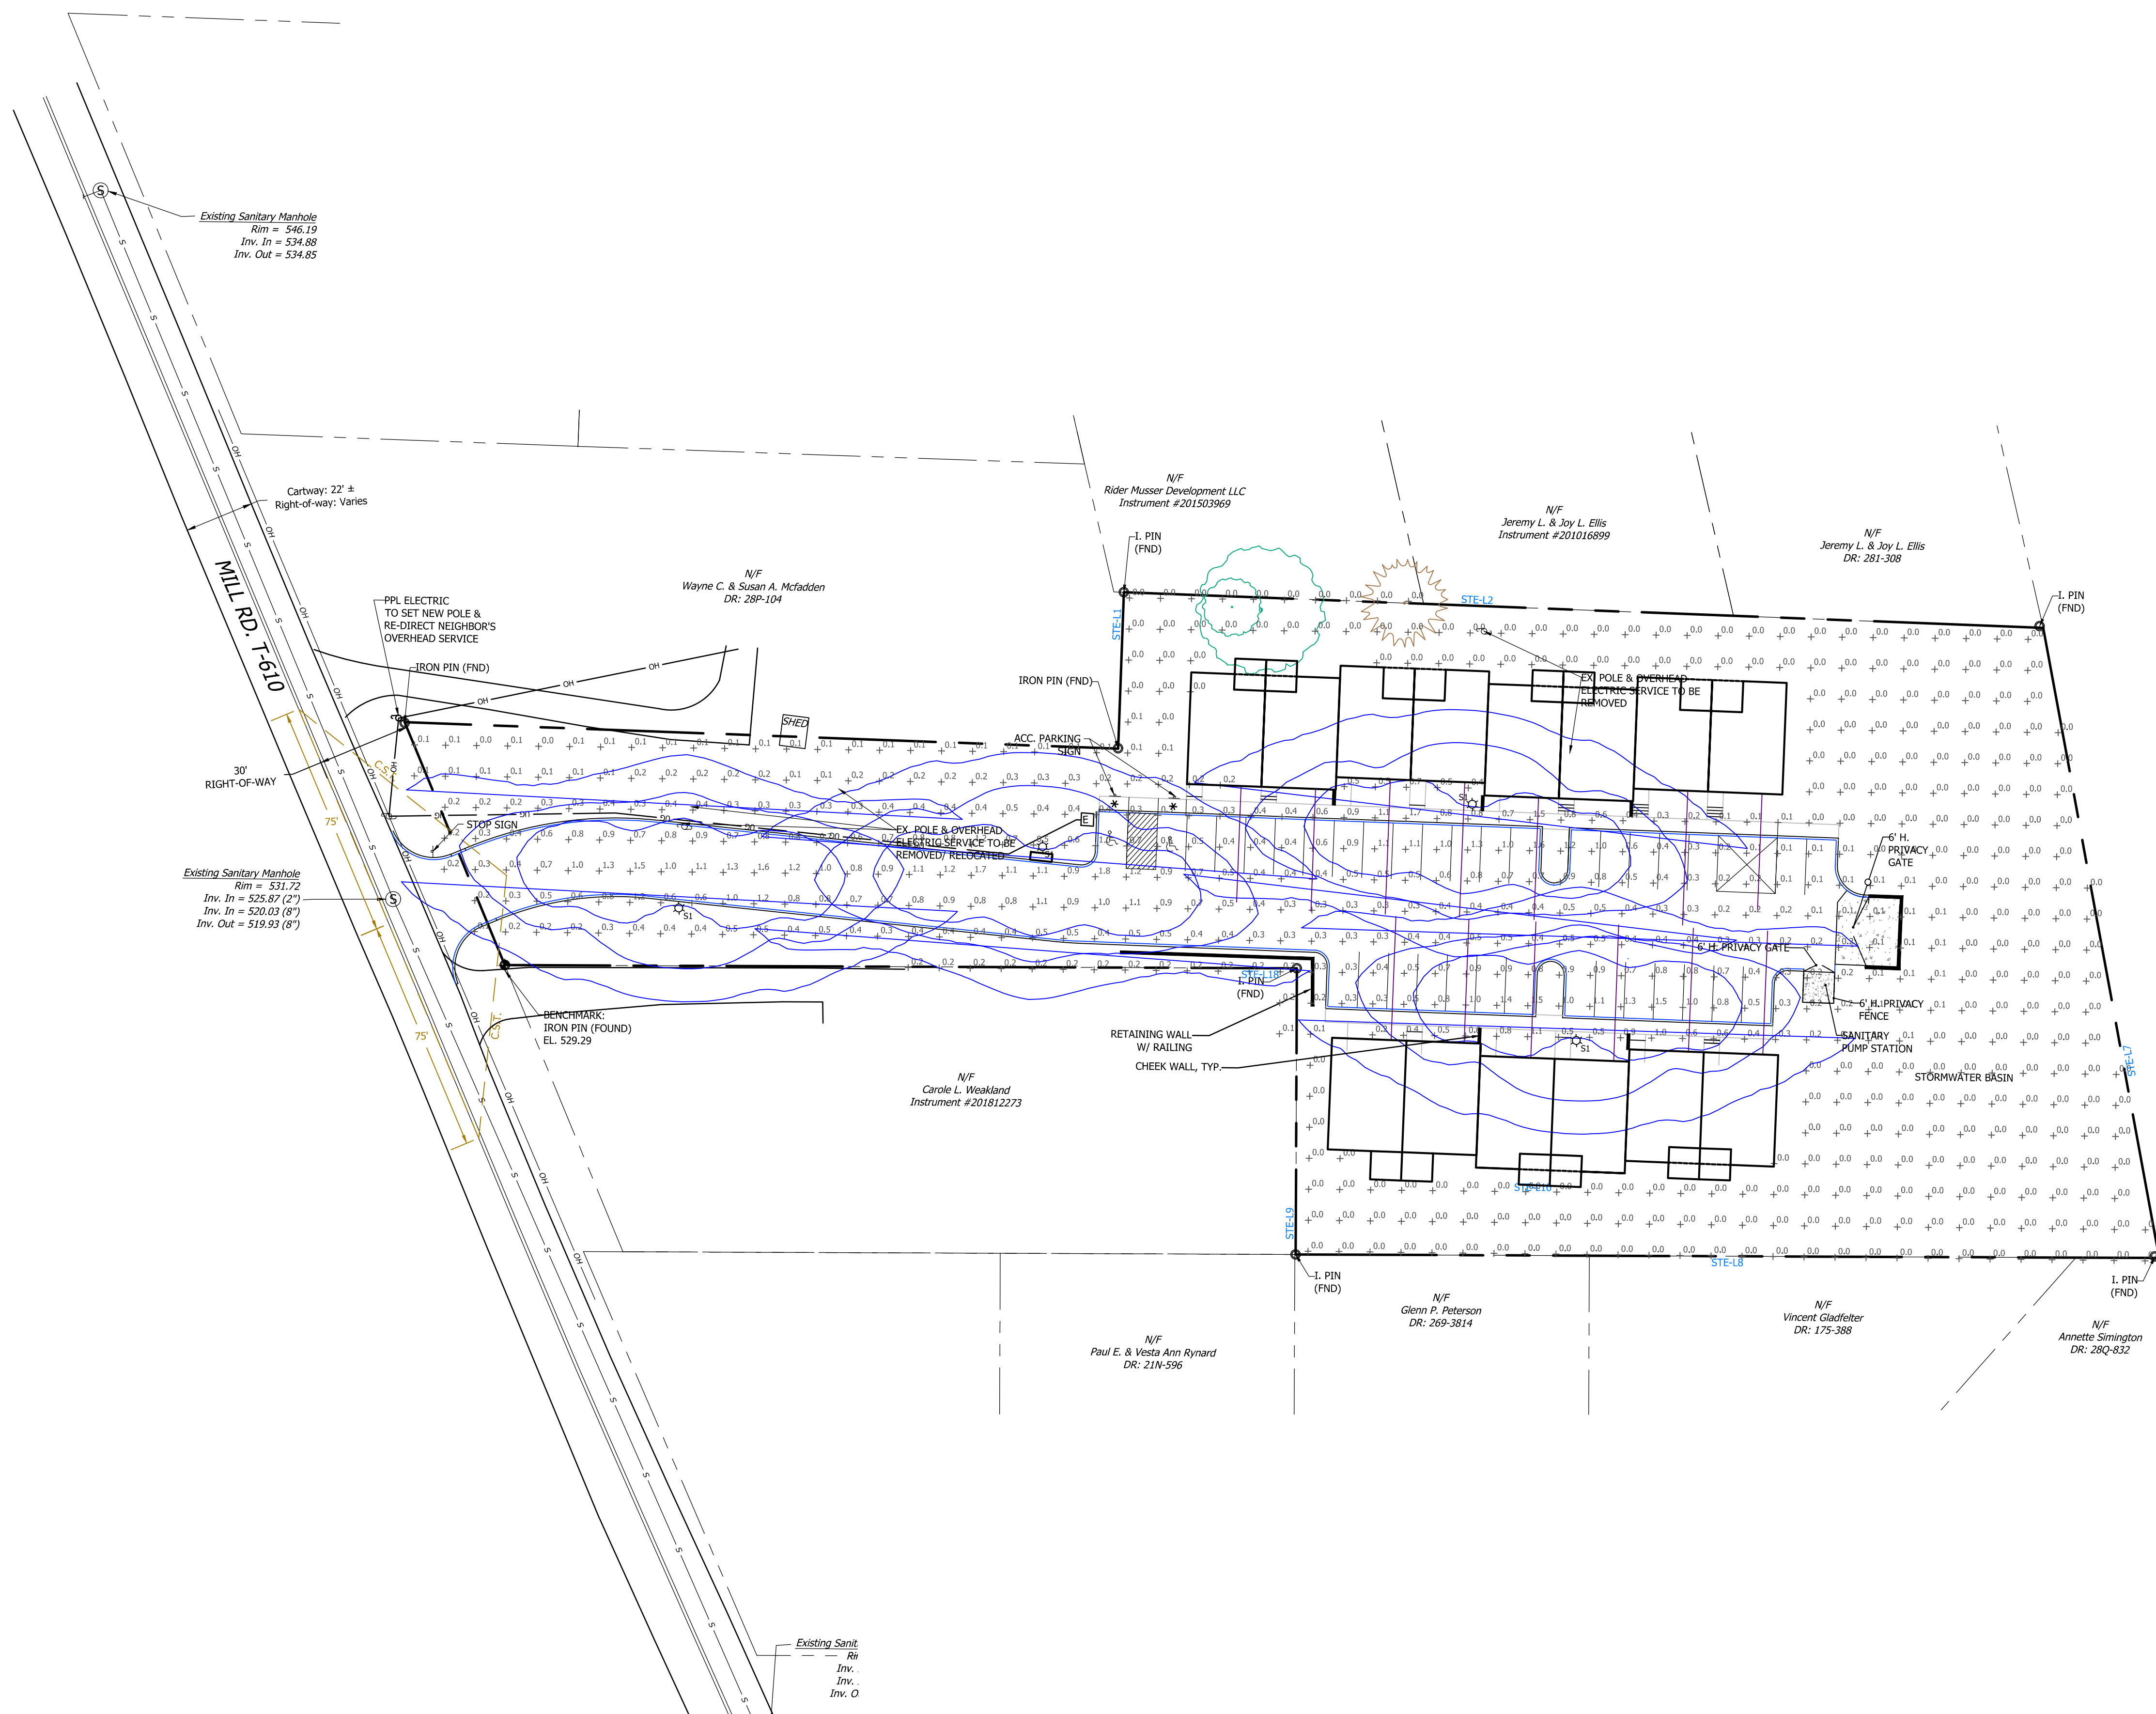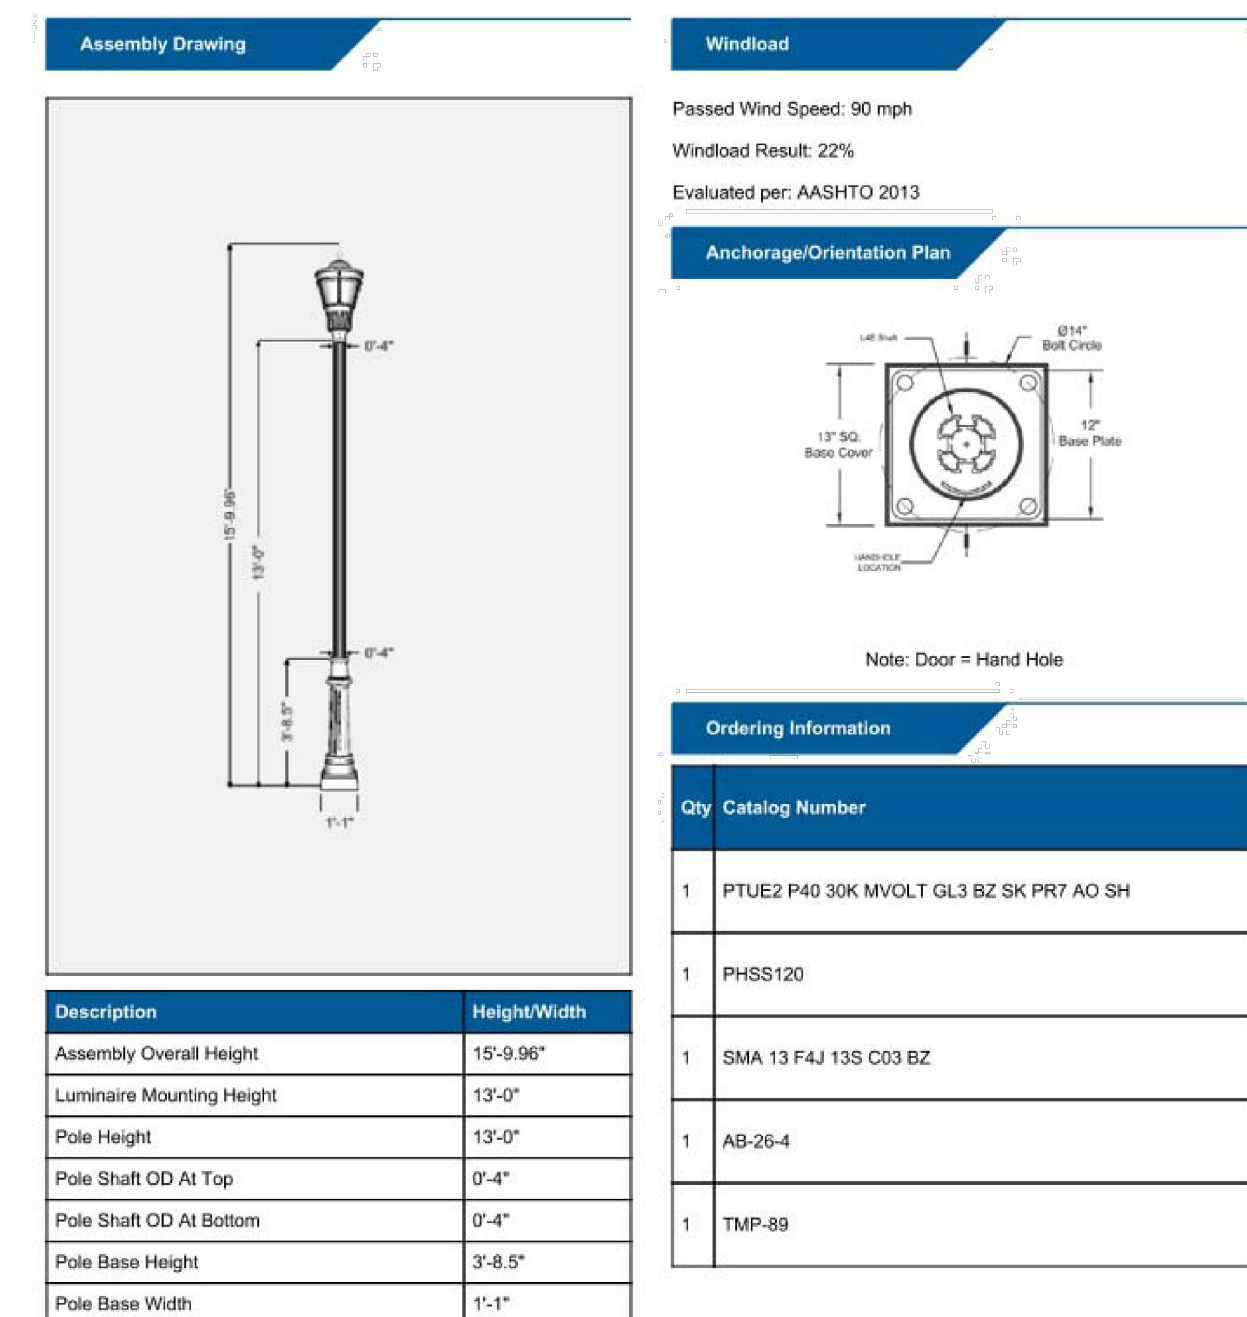

**R. J. FISHER & ASSOCIATES, INC.**  
SITE PLANNING ▫ CIVIL ENGINEERING ▫ LAND SURVEYS  
1546 BRIDGE STREET, NEW CUMBERLAND, PA. 17070  
PHONE: (717) 774-7534 ▫ FAX: (717) 774-7190  
[RJFISHERENGINEERING.COM](http://RJFISHERENGINEERING.COM)






**SITE LIGHTING PLAN**  
FOR  
**2509 MILL ROAD TOWNHOMES**  
LOCATED IN  
UPPER ALLEN TOWNSHIP, CUMBERLAND COUNTY, PA

DRAWING ID:	221013-3-LD
PROJECT:	221013
DATE:	04/25/2022
SHEET:	8 OF 18

COPYRIGHT © ### BY R.J. FISHER & ASSOCIATES, INC.



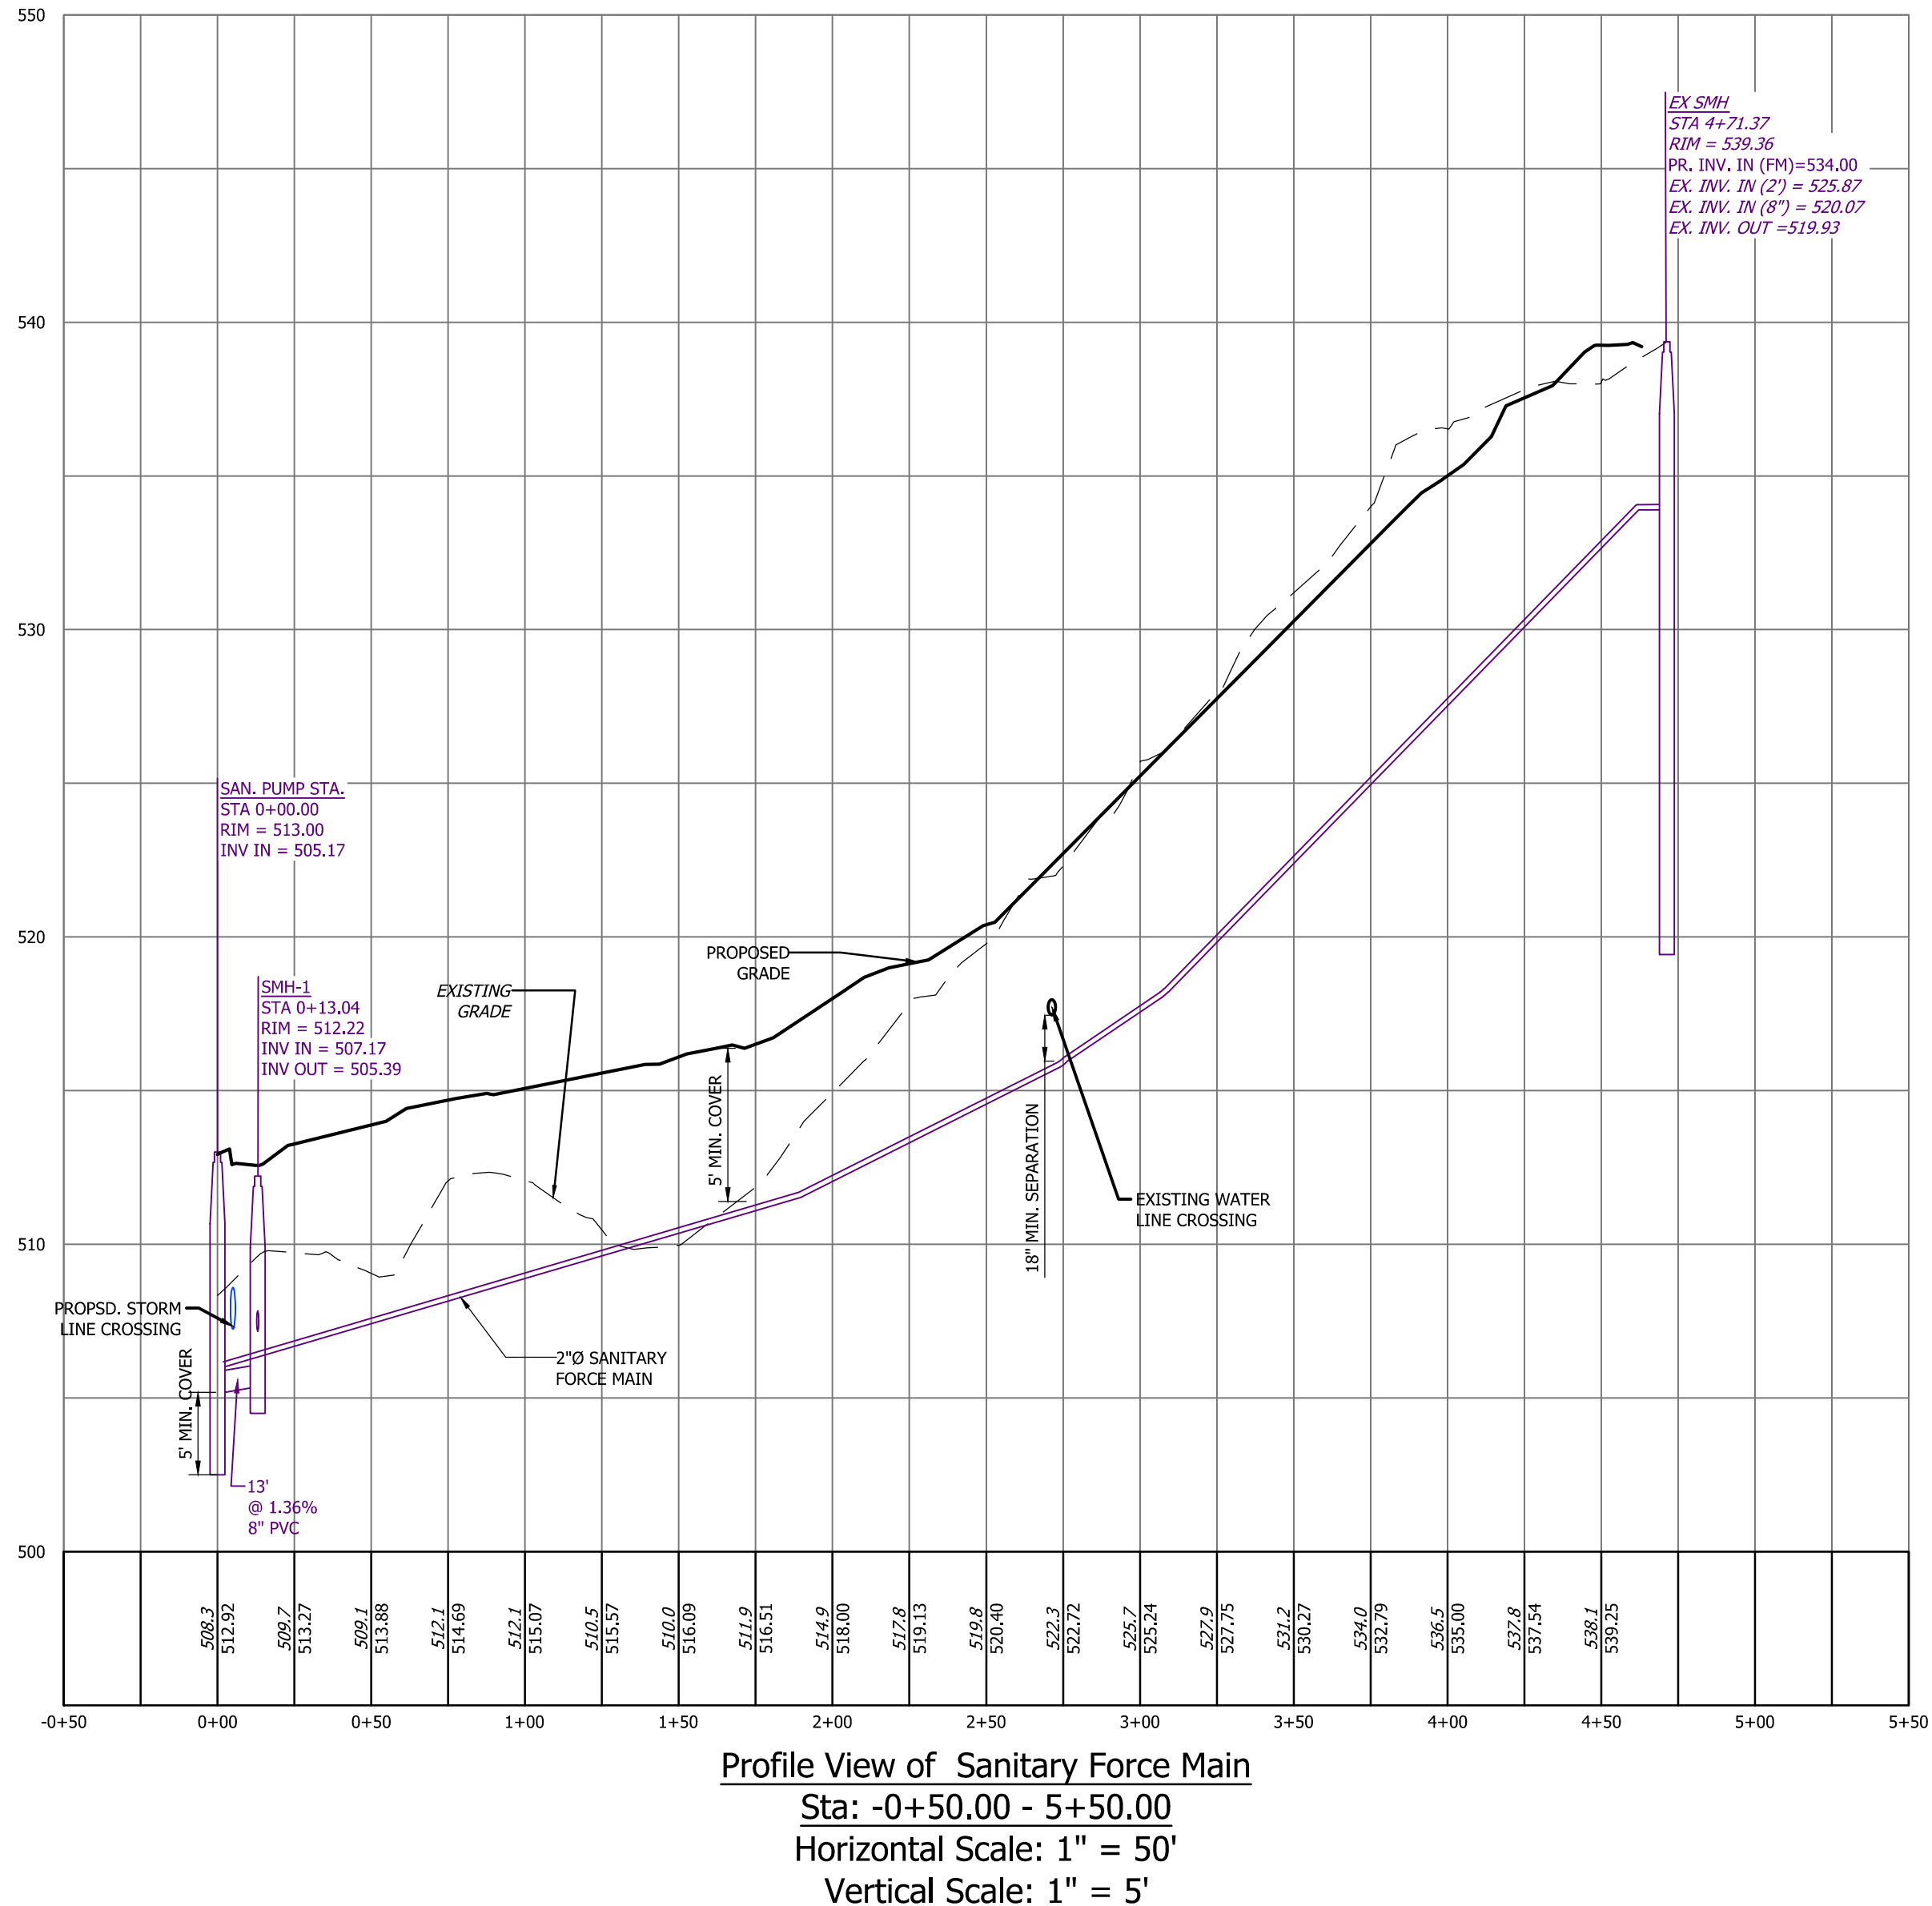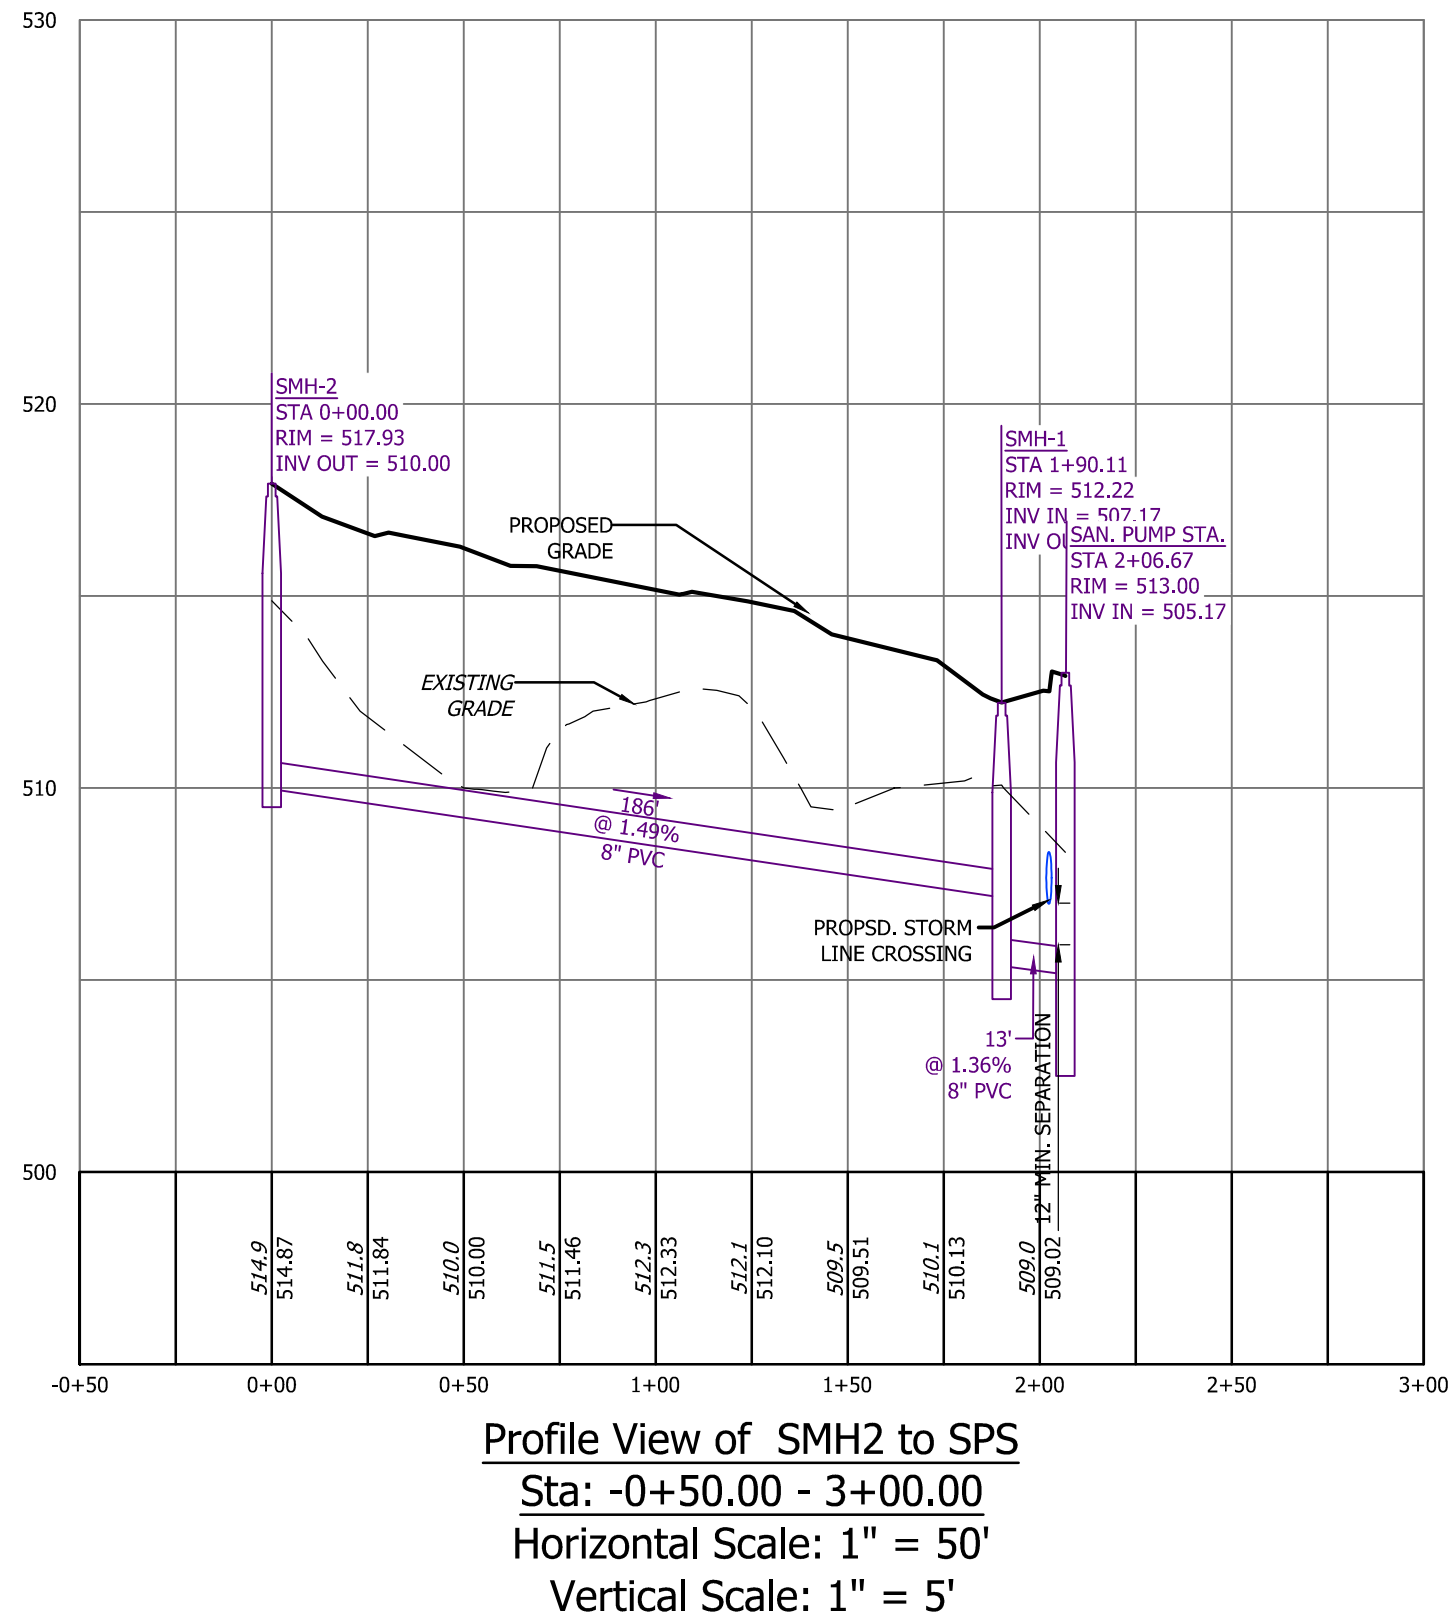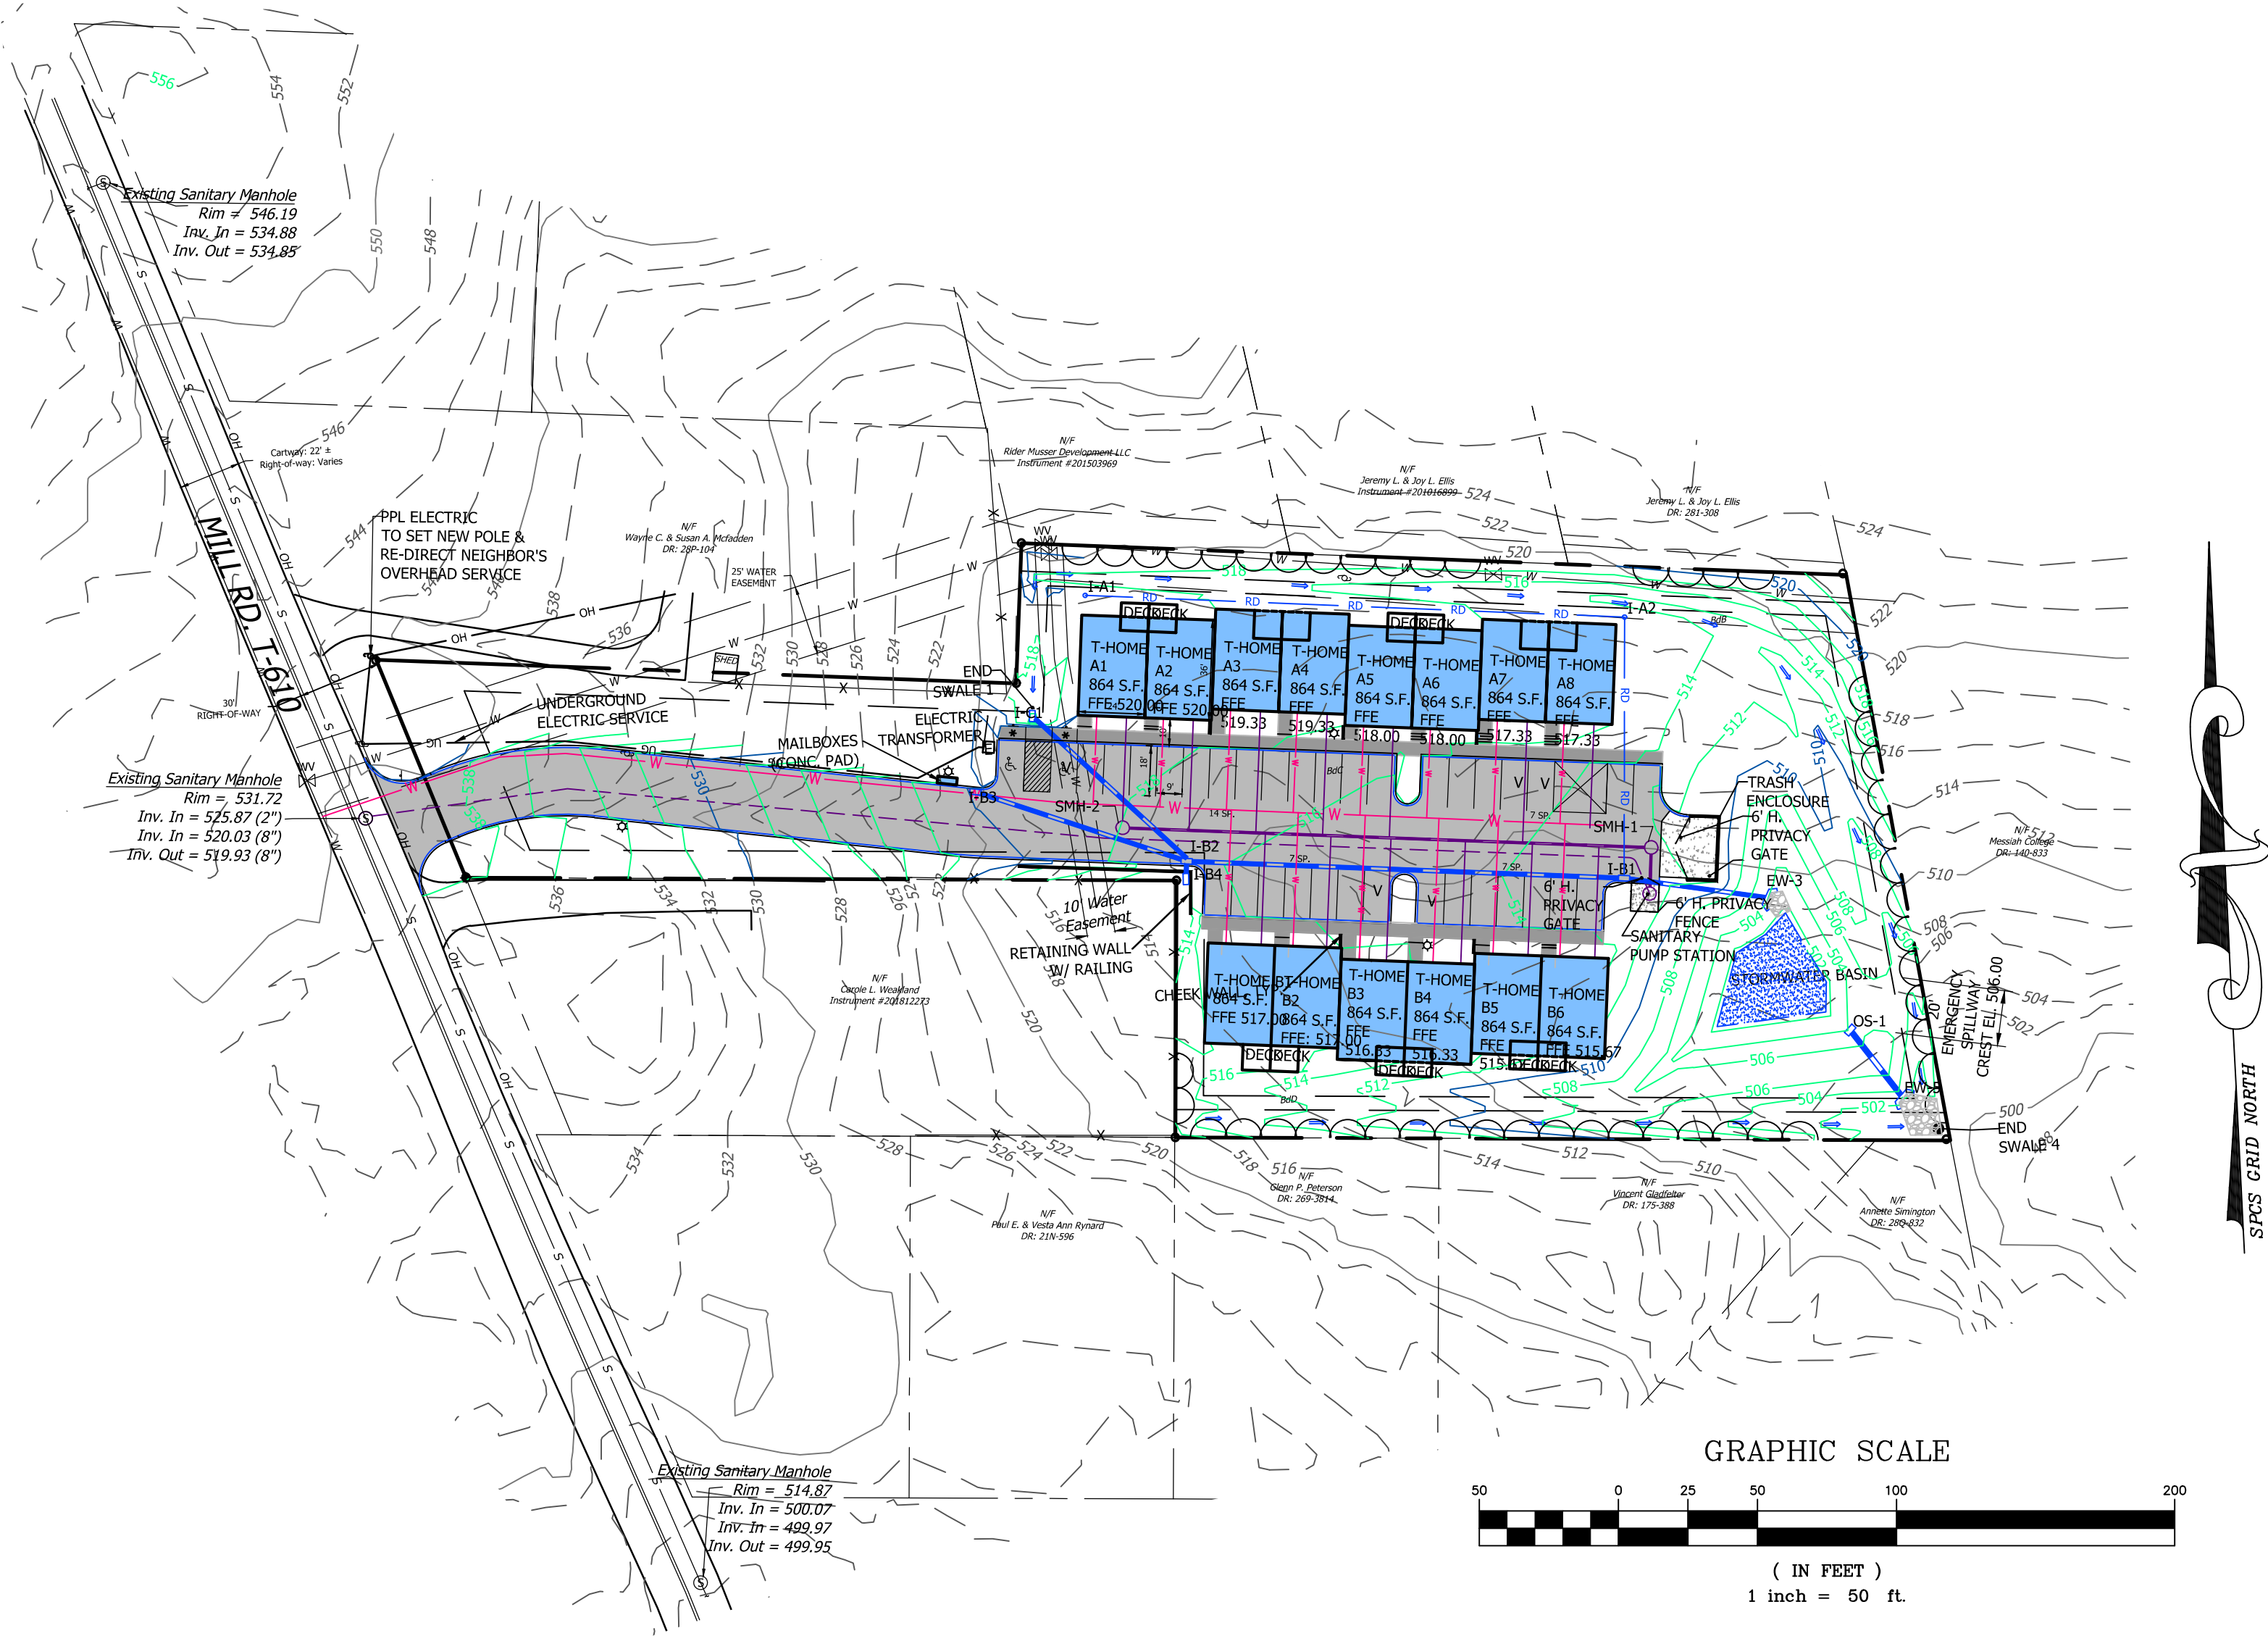

# SANITARY SEWER PLAN & PROFILE

FOR  
**2509 MILL ROAD TOWNHOMES**  
LOCATED IN  
UPPER ALLEN TOWNSHIP, CUMBERLAND COUNTY, PA

**R. J. FISHER & ASSOCIATES, INC.**  
SITE PLANNING ▫ CIVIL ENGINEERING ▫ LAND SURVEYS

1546 BRIDGE STREET, NEW CUMBERLAND, PA. 17070  
PHONE: (717) 774-7534 ▫ FAX: (717) 774-7190

**RJFISHERENGINEERING.COM**



NO.	REVISION	DATE
1	—	—
2	—	—
3	—	—
4	—	—
5	###	###


DRAWING ID:	221013-6-SAN PR
PROJECT:	221013
DATE:	04/25/2022
SHEET:	9 OF 18

COPYRIGHT © ### BY R.J. FISHER & ASSOCIATES, INC.








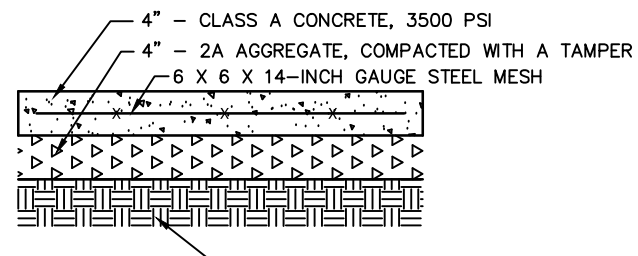


- NOTE: 1. PROVIDE TRANSVERSE ASPHALT TYPE EXPANSION JOINTS SPACED 30' MAX.  
2. PROVIDE CONSTRUCTION JOINTS @ 4' INTERVALS OR AS SPECIFIED.  
3. A TOOLED EDGE SHALL BE PROVIDED ON ALL EDGES INCLUDING EXPANSION JOINTS.  
4. IN THE CASE WHERE SIDEWALKS ARE PROPOSED DIRECTLY AGAINST CURB OR BUILDING, EXPANSION MATERIAL SHALL BE INSTALLED CONTINUOUSLY ALONG THE COMMON EDGE.  
5. PROVIDE A BROOM FINISH.  
6. WHERE PROPOSED SIDEWALKS CROSS A DRIVEWAY, A CONCRETE APRON SHALL BE PROVIDED FROM THE EDGE OF THE STREET CARRYWAY TO THE FAR EDGE OF THE SIDEWALK. CONCRETE DRIVEWAY APRONS SHALL HAVE A MINIMUM DEPTH OF SIX INCHES AND CONSTRUCTED WITH REINFORCED WIRE OF FIBERGLASS SUBSTITUTE FOR STRENGTHENING PURPOSES.  
7. JOINTS SHALL BE SEALED IN ACCORDANCE WITH PENNDOT SECTION 705.4.


CONCRETE SIDEWALK DETAIL  
N.T.S.

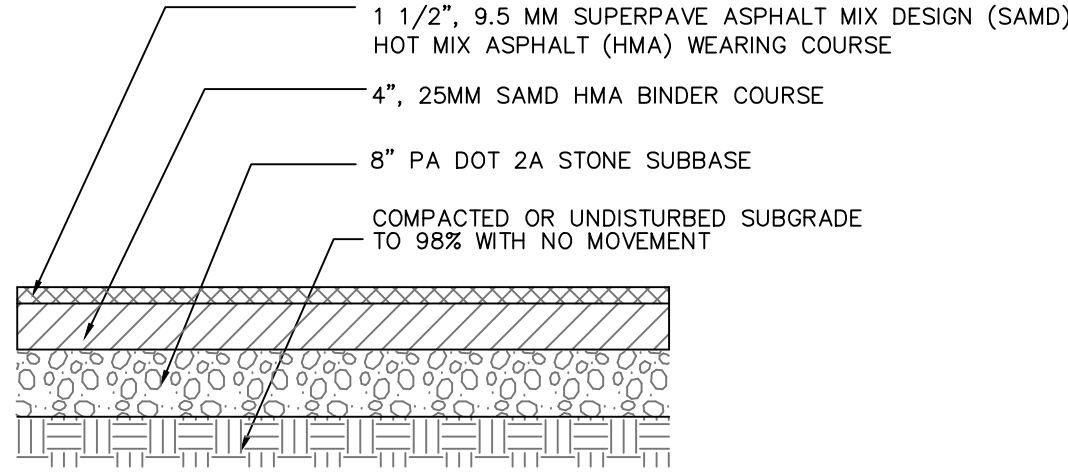

PAVING DETAIL  
N.T.S.

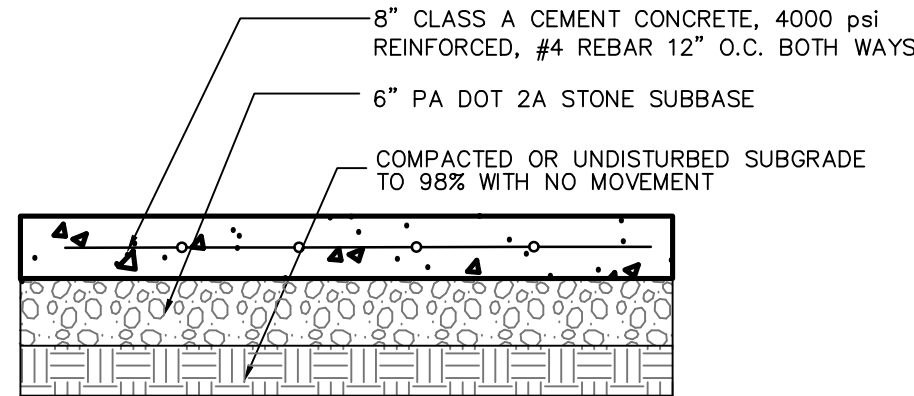


DUMPSTER & SEWAGE PUMP STATION  
PAD PAVING DETAIL  
N.T.S.

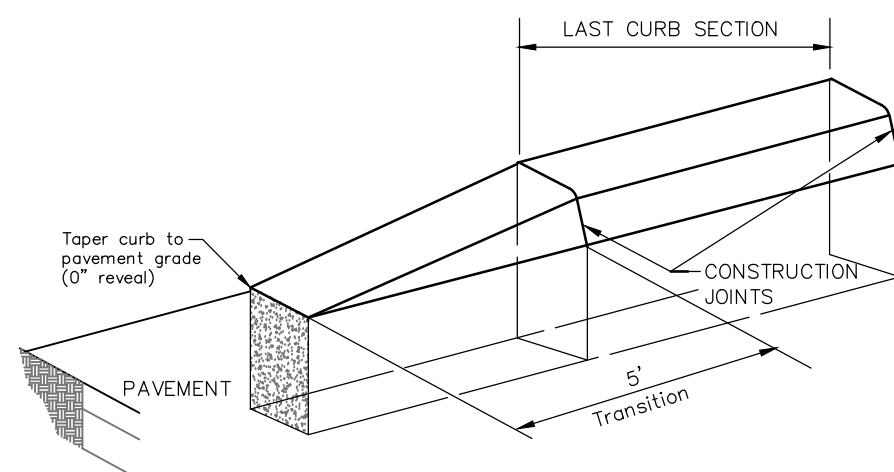


- NOTES:  
1. ALL CONSTRUCTION MATERIALS AND STRUCTURES SHALL BE IN CONFORMANCE WITH PENN DOT STANDARDS FOR ROADWAY CONSTRUCTION AS AMENDED AUGUST 28, 2000.  
2. ALL CURBING SHALL BE IN CONFORMANCE WITH RC-64M STANDARDS.  
3. SEE PLAN FOR LIMITS OF VERTICAL CURB INSTALLATION.  
4. CURB TAPERS SHALL BE PROVIDED AT CURB ENDS WITH A 5' TRANSITION AND A 0" TERMINUS REVEAL.

CURB TAPER DETAIL  
N.T.S.

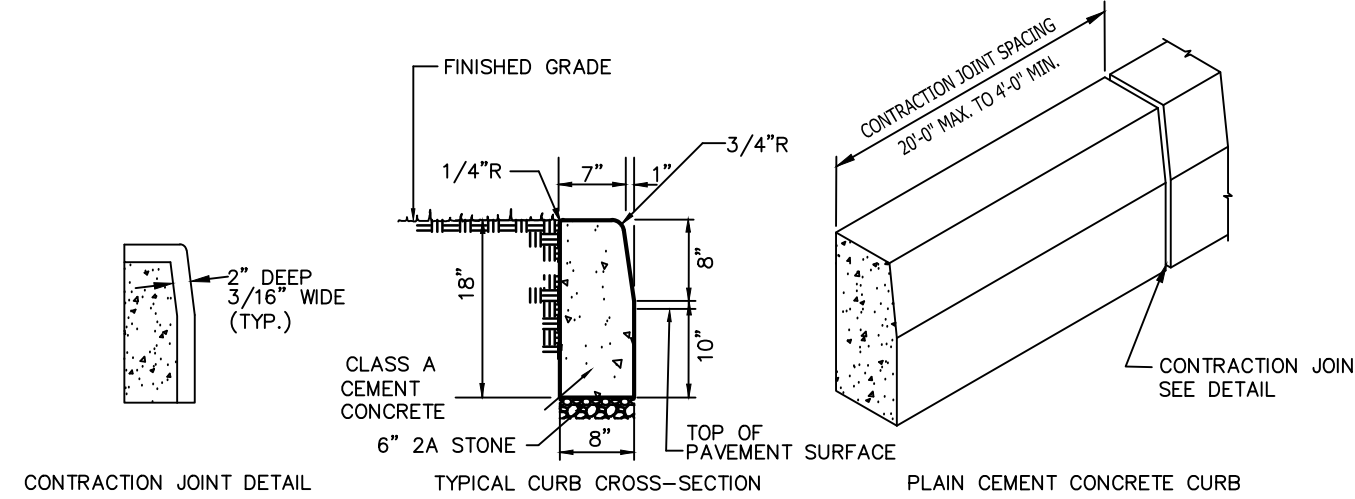

- NOTES:  
1. PROVIDE MATERIALS AND CONSTRUCTION MEETING THE REQUIREMENTS OF PUB. 408, SECTION 630 FOR PLAIN CONCRETE CURB AND DERESSED CURB, SECTION 640 FOR PLAIN CONCRETE CURB AND PLAIN CONCRETE CURB CUTTER.  
2. SPACE CONTRACTION JOINTS IN UNIFORM LENGTHS OR SECTIONS.  
3. PLACE 3/4-INCH PREMOULDED EXPANSION JOINT FILLER MATERIAL AT STRUCTURES AND AT THE END OF THE WORK DAY. CUT MATERIAL TO CONFORM TO AREA ADJACENT TO CURB OR TO CONFORM TO CROSS SECTIONAL AREA OF CURB.

8" VERTICAL CONCRETE CURB DETAIL  
(DRIVEWAY RADII @ MILL ROAD)  
N.T.S.

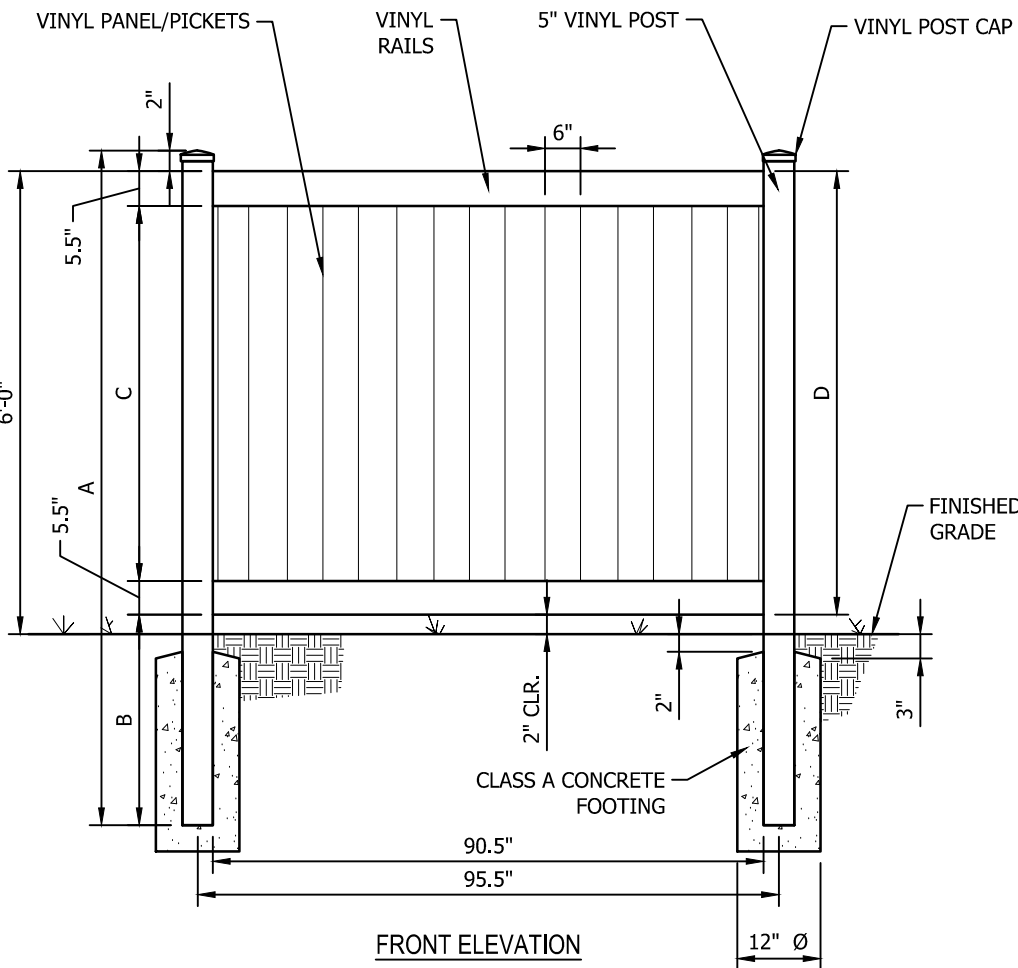


A	B	C	D
INCHES	INCHES	INCHES	INCHES
108	34	59	72

- NOTES:  
1. ALL ILLUSIONS VINYL FENCES ARE ASTM F842-03 COMPLIANT.  
2. AVAILABLE IN GRAND ILLUSIONS COLOR SPECTRUM (35 COLORS) AND GRAND ILLUSIONS VINYL WOODBOND (5 AUTHENTIC WOODGRAINS), CHOSEN BY OWNER.  
3. INCLUDES METAL REINFORCEMENT BOTTOM RAIL.  
4. PROVIDE DBL.-LEAF MATCHING GATE WITH LATCH.

V300-6 ILLUSIONS FENCE PRODUCT AS MANUFACTURED BY ILLUSIONS VINYL FENCE MEDFORD, NY 11763 WWW.ILLUSIONSFENCE.COM TOLL FREE: 1-800-339-3362


POST CAP MODEL: FLAT - V55FO  
POST OPTIONS: 5" X 5" I.D. - .250 WALL

(SOLID TONGUE AND GROOVE)  
6" H. VINYL PRIVACY FENCE  
NOT TO SCALE

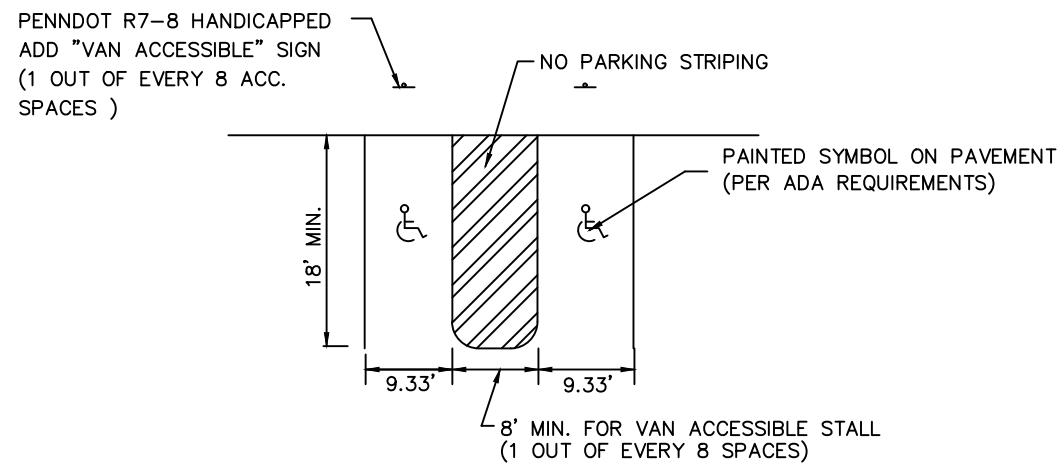


NOTE: HANDICAPPED RAMPS AND STALLS SHALL COMPLY WITH THE AMERICANS WITH DISABILITY ACT DESIGN STANDARDS

TYPICAL HANDICAP PARKING SPACE  
N.T.S.

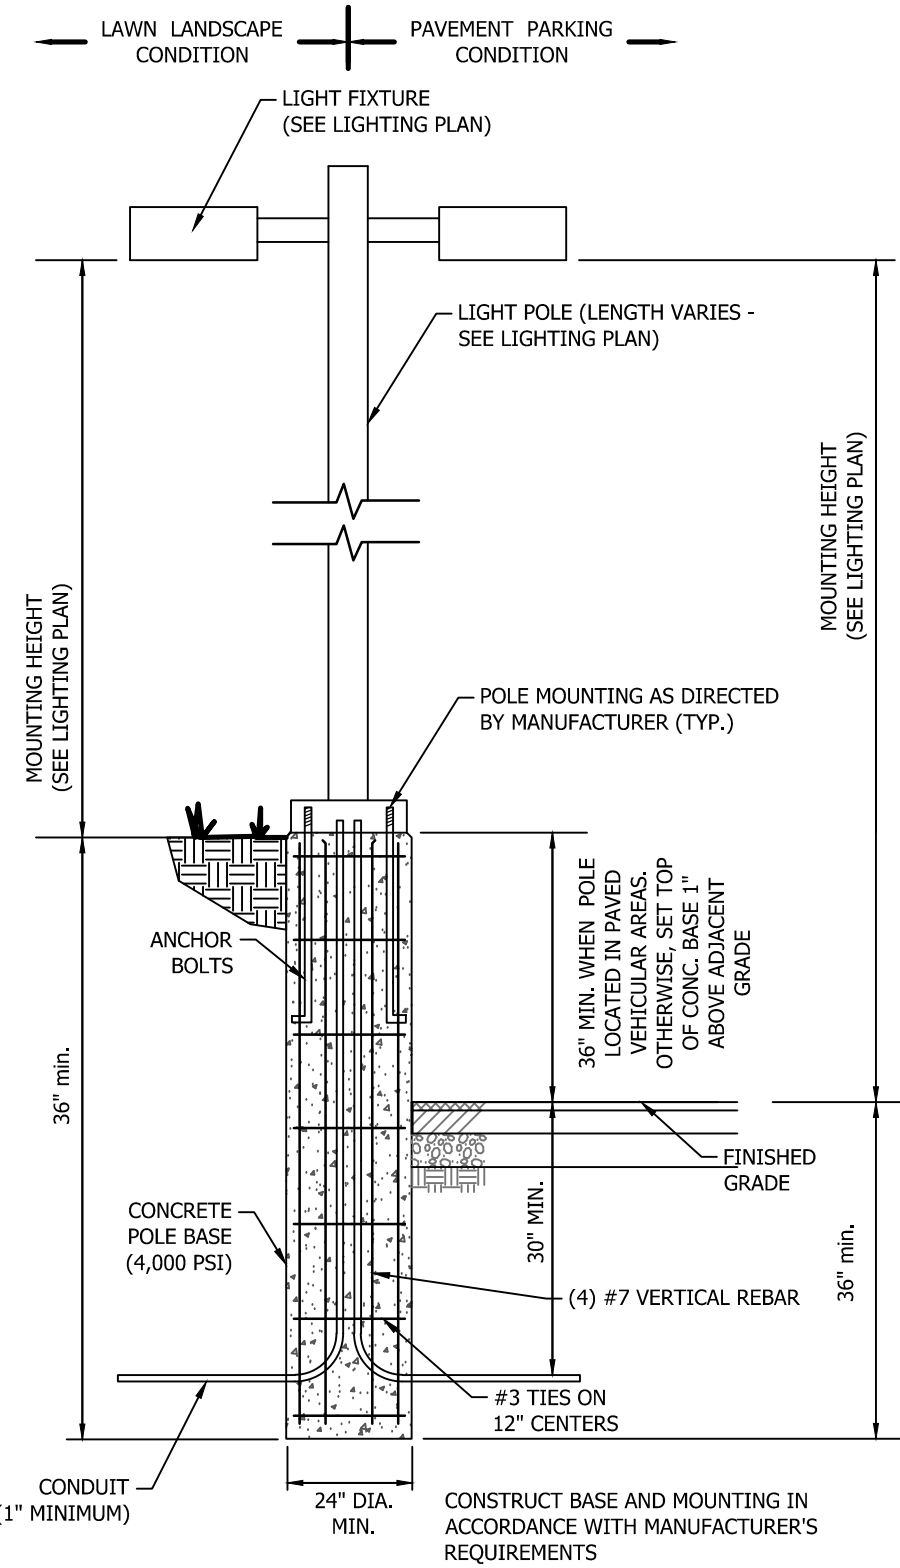


- NOTES:  
1. SEE ELECTRICAL DRAWINGS FOR CONDUIT LOCATIONS.  
2. NUMBER AND SIZE OF ANCHOR BOLTS PER MANUFACTURER'S REQUIREMENTS.  
3. FOUNDATION INFORMATION AND DESIGN TO BE PROVIDED BY THE LIGHTING DESIGNER.  
4. POLES MUST BE GROUNDED.

LIGHT STANDARD BASE DETAIL  
N.T.S.

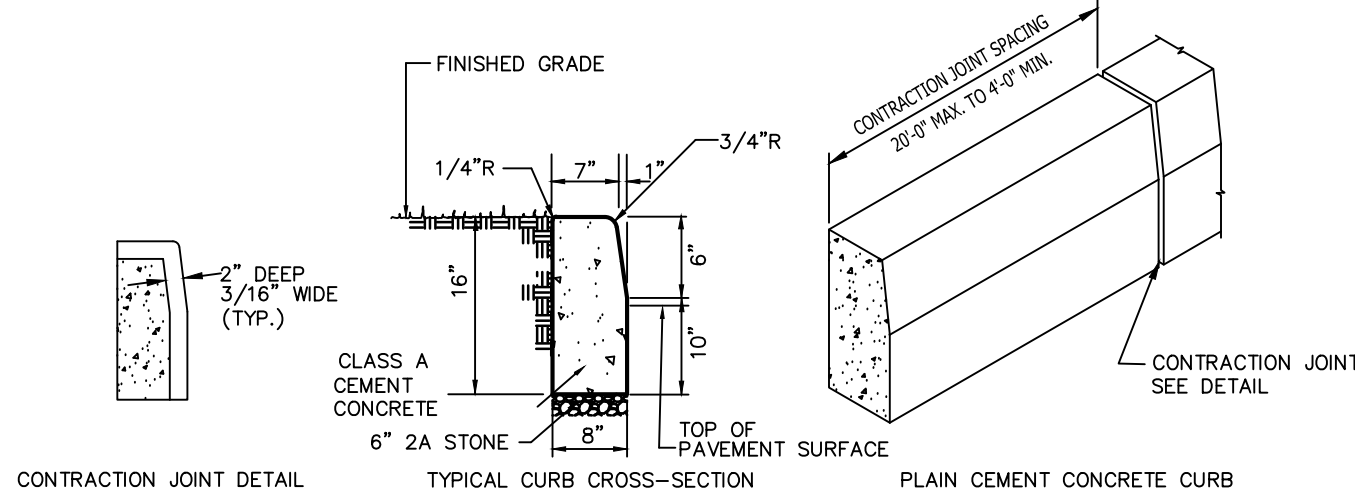


- NOTES:  
1. PROVIDE MATERIALS AND CONSTRUCTION MEETING THE REQUIREMENTS OF PUB. 408, SECTION 630 FOR PLAIN CONCRETE CURB AND DERESSED CURB, SECTION 640 FOR PLAIN CONCRETE CURB AND PLAIN CONCRETE CURB CUTTER.  
2. SPACE CONTRACTION JOINTS IN UNIFORM LENGTHS OR SECTIONS.  
3. PLACE 3/4-INCH PREMOULDED EXPANSION JOINT FILLER MATERIAL AT STRUCTURES AND AT THE END OF THE WORK DAY. CUT MATERIAL TO CONFORM TO AREA ADJACENT TO CURB OR TO CONFORM TO CROSS SECTIONAL AREA OF CURB.

6" VERTICAL CONCRETE CURB DETAIL  
(ON-SITE)  
N.T.S.

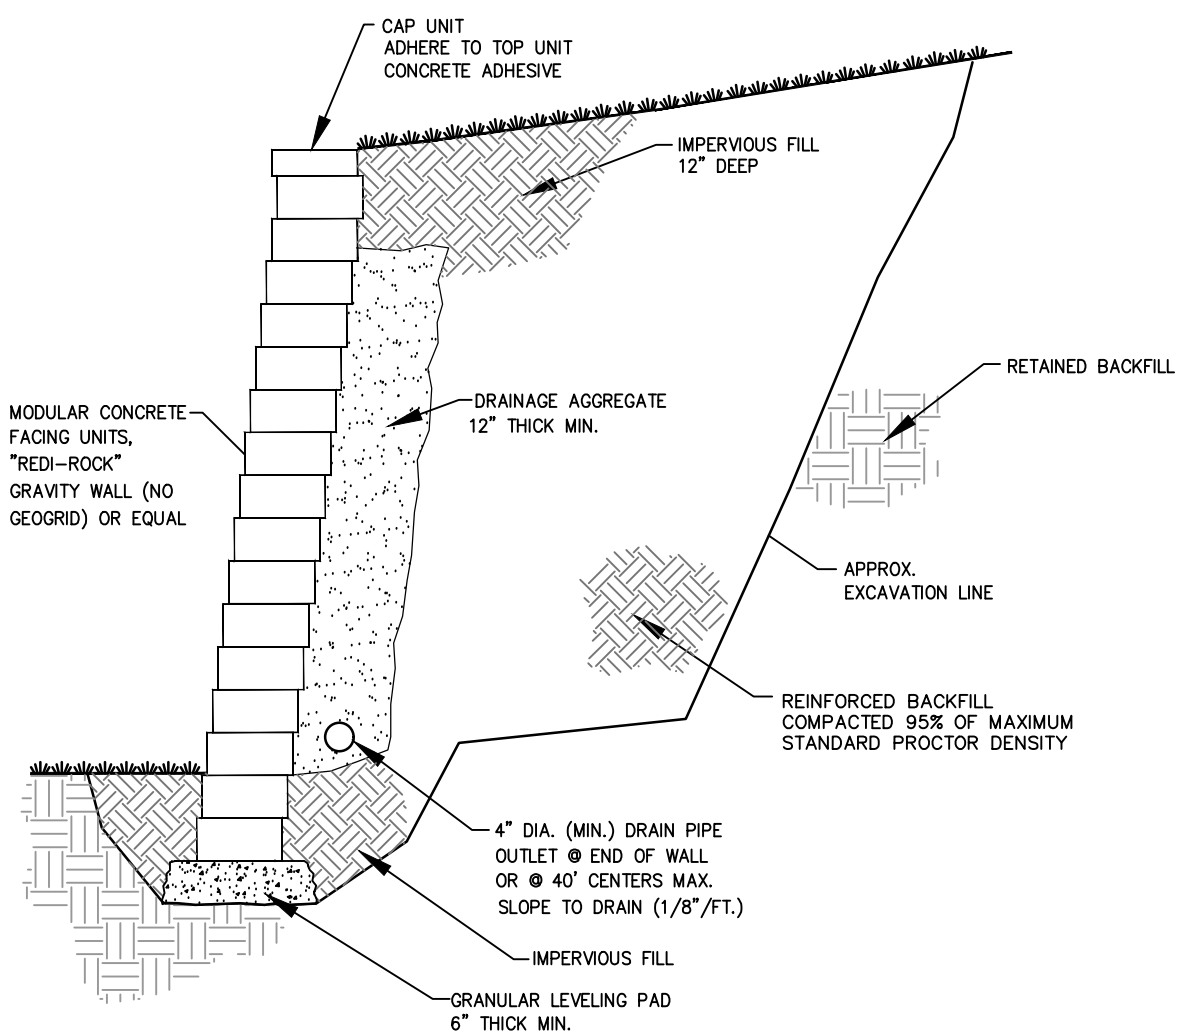

NOTE: THIS DETAIL IS A REPRESENTATION ONLY. ACTUAL DESIGN OF THE RETAINING WALL SHALL BE AS CERTIFIED BY A PROFESSIONAL ENGINEER IN ACCORDANCE WITH MANUFACTURER'S DESIGN REQUIREMENTS AND PROVIDED TO TOWNSHIP FOR REVIEW IN CONJUNCTION WITH TOWNSHIP BUILDING PERMIT APPLICATION.


TYPICAL SECTION - RETAINING WALL  
NOT TO SCALE

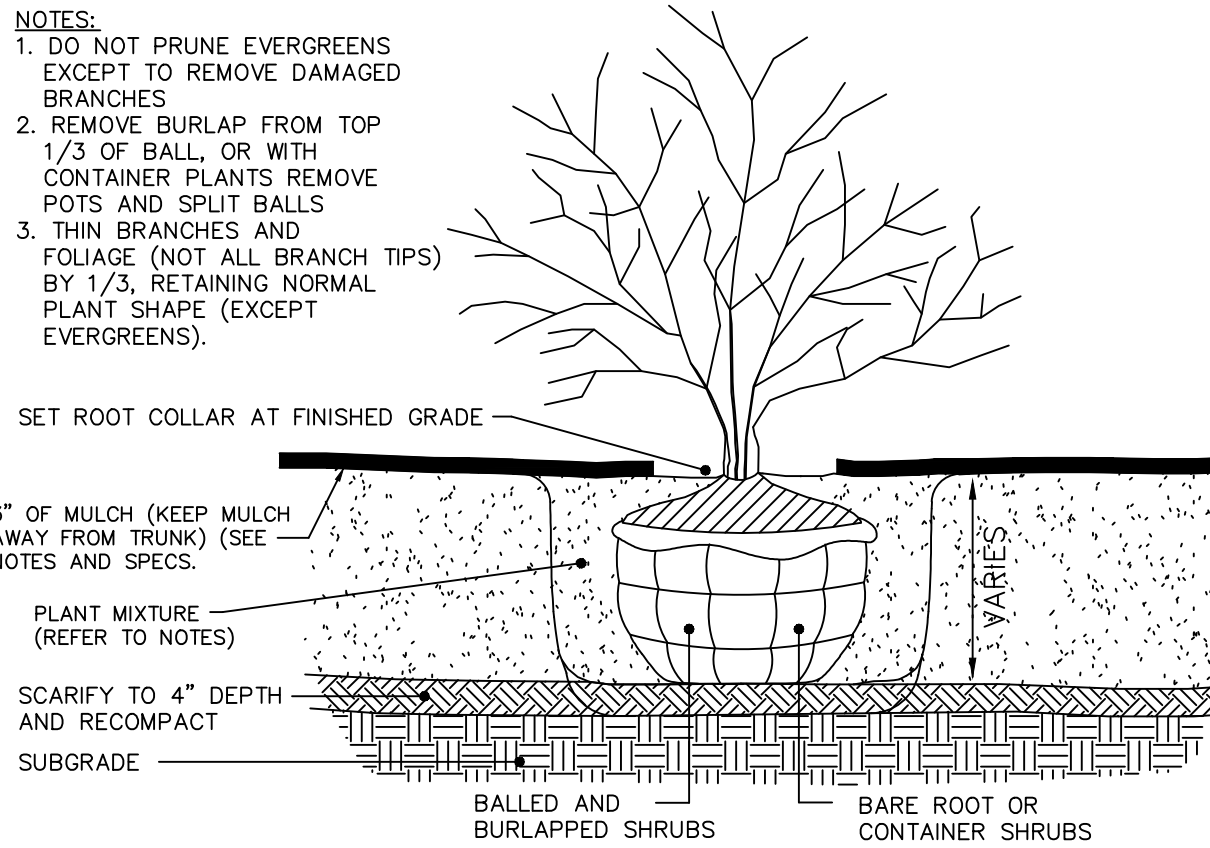


- NOTES:  
1. DO NOT PRUNE EVERGREENS EXCEPT TO REMOVE DAMAGED BRANCHES.  
2. REMOVE BURLAP FROM TOP 1/3 OF BALL, OR WITH CONTAINER PLANTS REMOVE POTS AND SPLIT BALLS.  
3. THIN BRANCHES AND FOLIAGE (NOT ALL BRANCH TIPS) BY 1/3, RETAINING NORMAL PLANT SHAPE (EXCEPT EVERGREENS).

SET ROOT COLLAR AT FINISHED GRADE  
3" OF MULCH (KEEP MULCH AWAY FROM TRUNK) (SEE NOTES AND SPECS.)  
PLANT MIXTURE (REFER TO NOTES)  
SCARIFY TO 4" DEPTH AND RECOMPACT SUBGRADE  
BALLED AND BURLAPPED SHRUBS  
BARE ROOT OR CONTAINER SHRUBS


SHRUB PLANTING

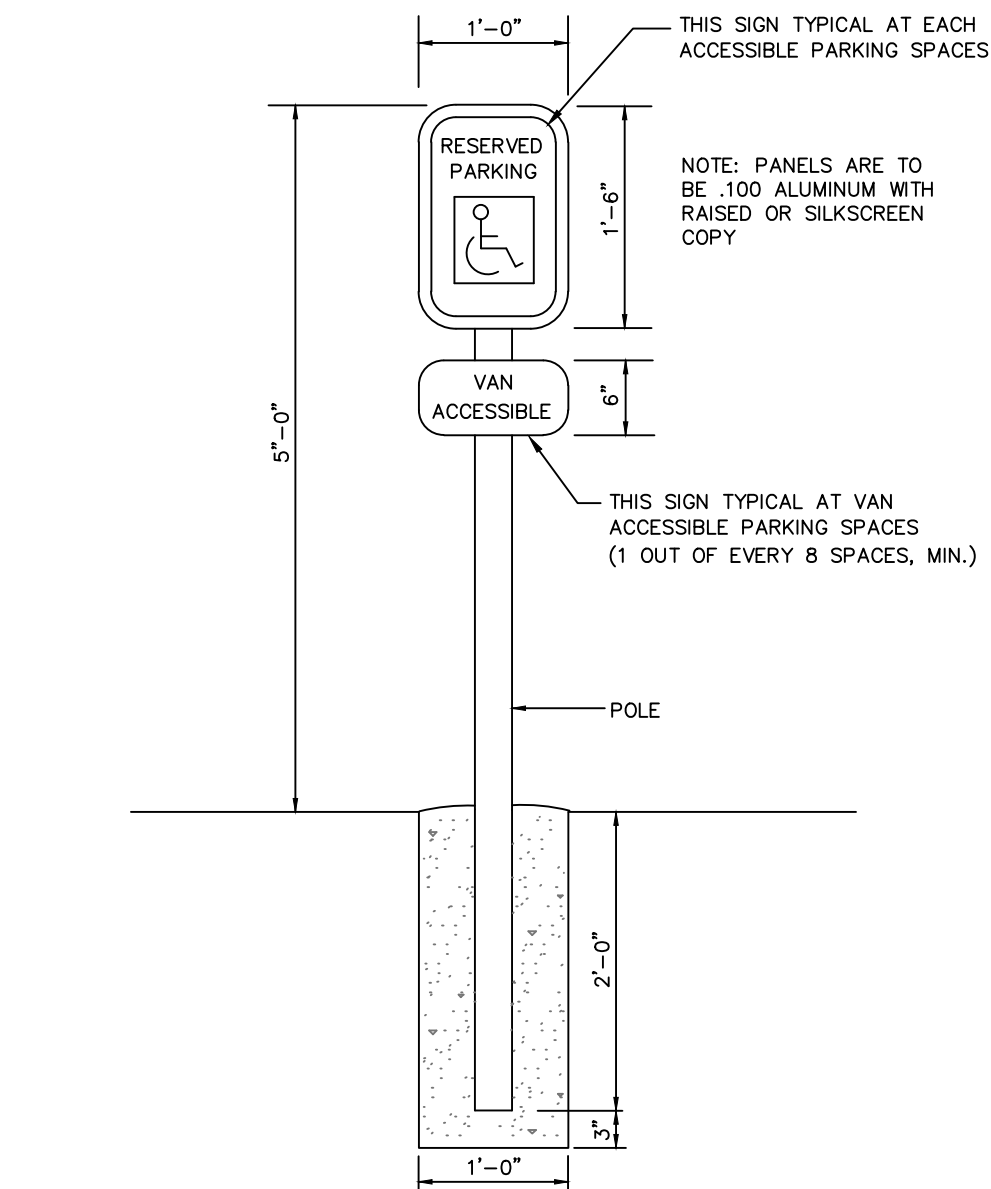

TYPICAL ACCESSIBLE PARKING SIGN DETAIL  
N.T.S.

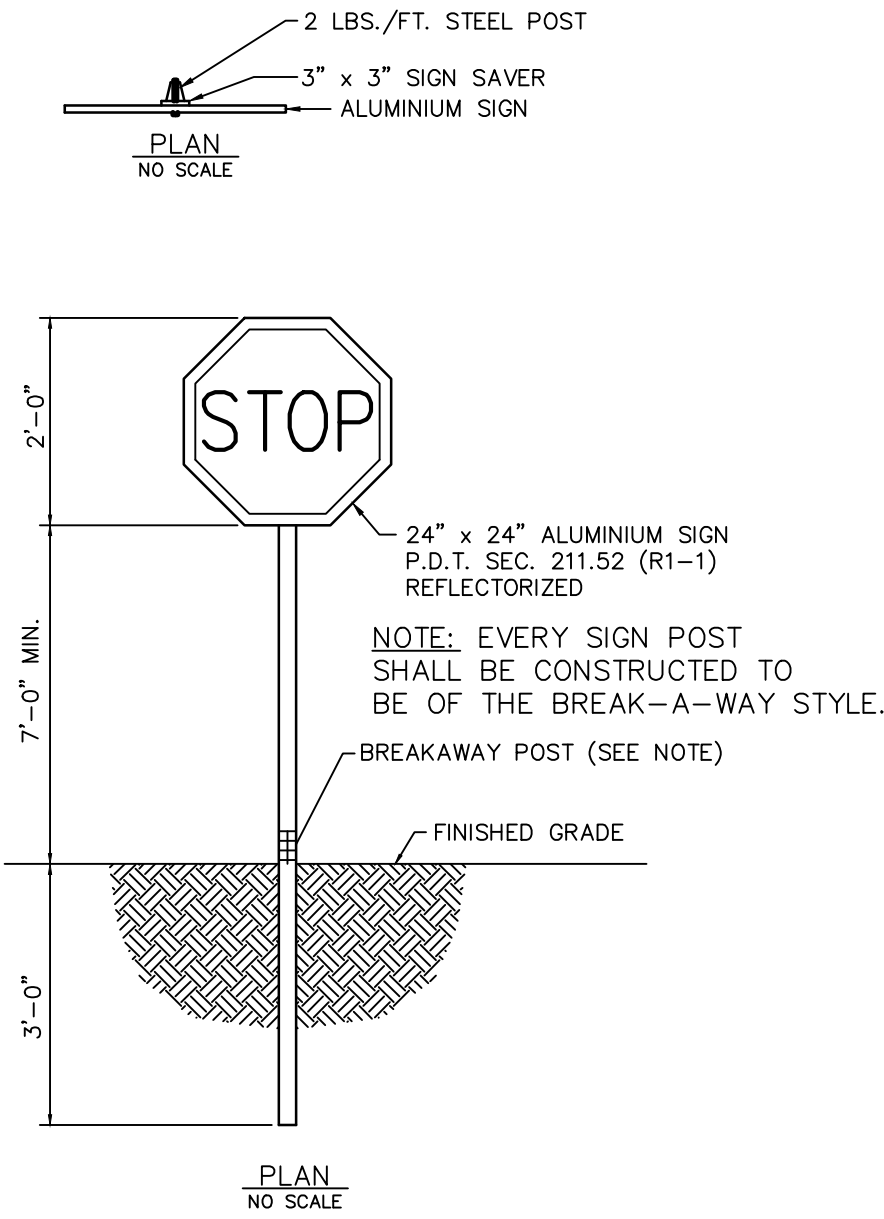


24" STOP SIGN  
Pa.D.O.T. SIGN, R1-1  
NTS

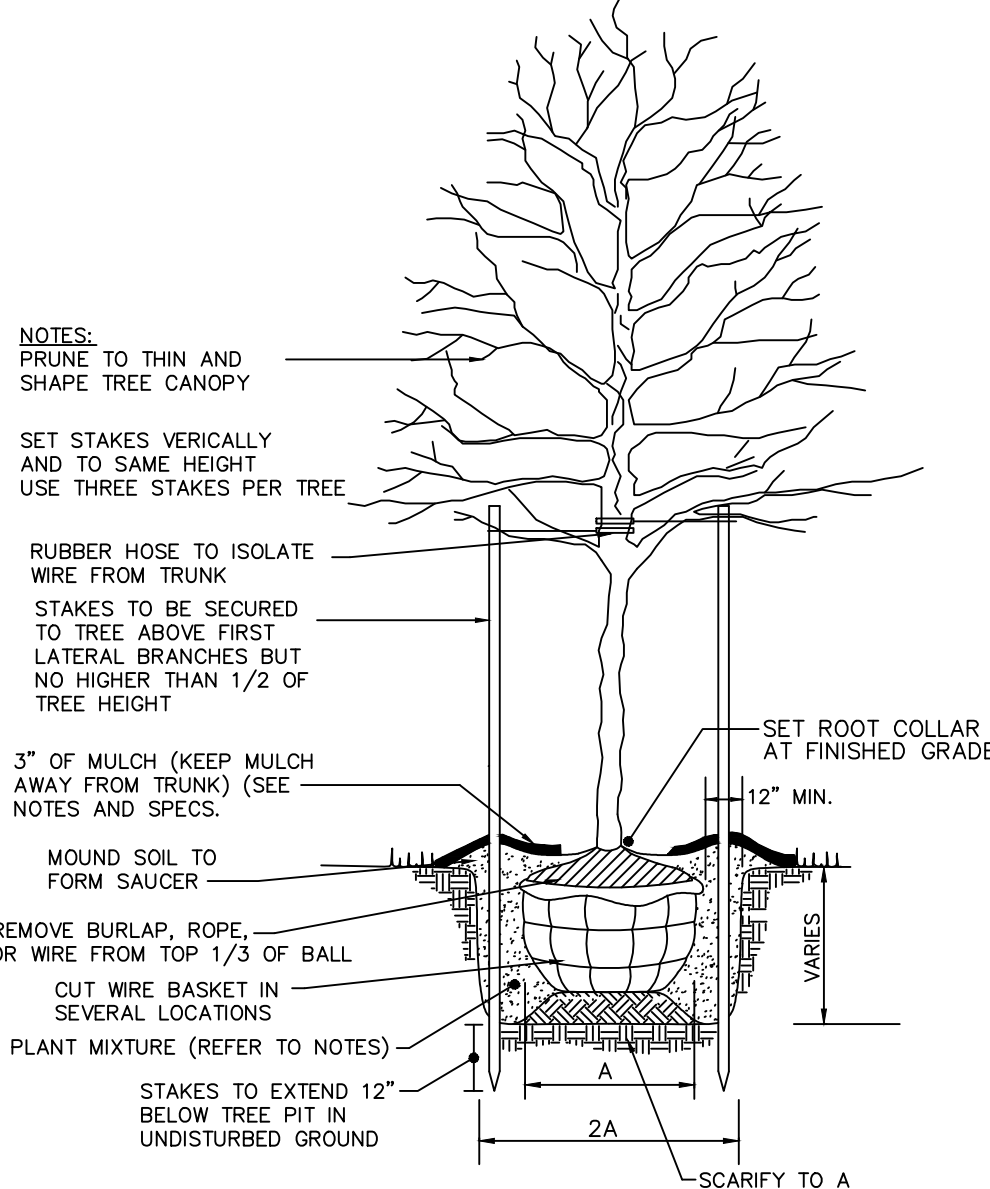

- NOTES:  
PRUNE TO THIN AND SHAPE TREE CANOPY  
SET STAKES VERTICALLY AND TO SAME HEIGHT USE THREE STAKES PER TREE  
RUBBER HOSE TO ISOLATE WIRE FROM TRUNK  
STAKES TO BE SECURED TO TREE ABOVE FIRST LATERAL BRANCHES BUT NO HIGHER THAN 1/2 OF TREE HEIGHT  
3" OF MULCH (KEEP MULCH AWAY FROM TRUNK) (SEE NOTES AND SPECS.)  
MOUND SOIL TO FORM SAUCER  
REMOVE BURLAP, ROPE, OR WIRE FROM TOP 1/3 OF BALL  
CUT WIRE BASKET IN SEVERAL LOCATIONS  
PLANT MIXTURE (REFER TO NOTES)  
STAKES TO EXTEND 12" BELOW TREE PIT IN UNDISTURBED GROUND  
SCARIFY TO A DEPTH OF 4" AND RECOMPACT

DECIDUOUS TREE PLANTING  
NTS

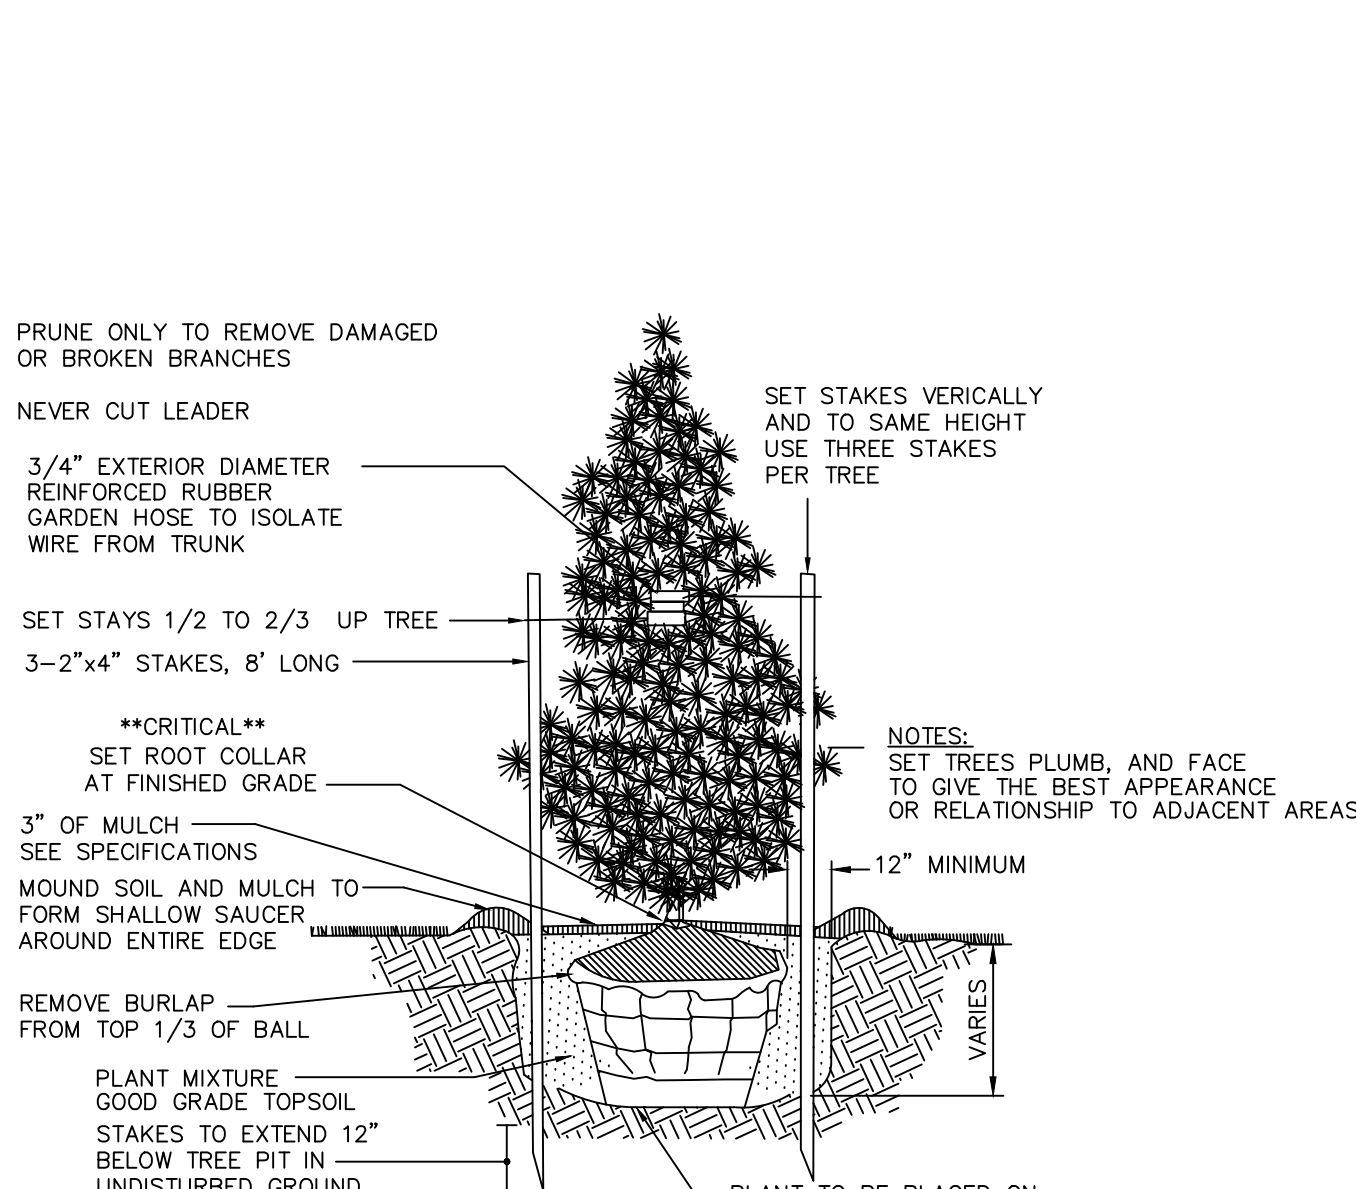

- PRUNE ONLY TO REMOVE DAMAGED OR BROKEN BRANCHES  
NEVER CUT LEADER  
3/4" EXTERIOR DIAMETER REINFORCED RUBBER GARDEN HOSE TO ISOLATE WIRE FROM TRUNK  
SET STAYS 1/2 TO 2/3 UP TREE  
3-2"x4" STAKES, 8' LONG  
\*\*CRITICAL\*\* SET ROOT COLLAR AT FINISHED GRADE  
3" OF MULCH SET SPECIFICATIONS  
MOUND SOIL AND MULCH TO FORM SHALLOW SAUCER AROUND ENTIRE EDGE  
REMOVE BURLAP FROM TOP 1/3 OF BALL  
PLANT MIXTURE GOOD GRADE TOPSOIL  
STAKES TO EXTEND 12" BELOW TREE PIT IN UNDISTURBED GROUND  
PLANT TO BE PLACED ON UNDISTURBED SUBGRADE

CONIFEROUS TREE PLANTING  
NTS



R. J. FISHER & ASSOCIATES, INC.  
SITE PLANNING & CIVIL ENGINEERING & LAND SURVEYS  
1546 BRIDGE STREET, NEW CUMBERLAND, PA. 17070  
PHONE: (717) 774-7534 & FAX: (717) 774-7190  
RJFISHERENGINEERING.COM



SITE DETAILS  
FOR  
2509 MILL ROAD TOWNHOMES  
LOCATED IN  
UPPER ALLEN TOWNSHIP, CUMBERLAND COUNTY, PA

DRAWING ID: 221013-3-LD  
PROJECT: 221013  
DATE: 04/25/2022  
SHEET: 11 OF 18



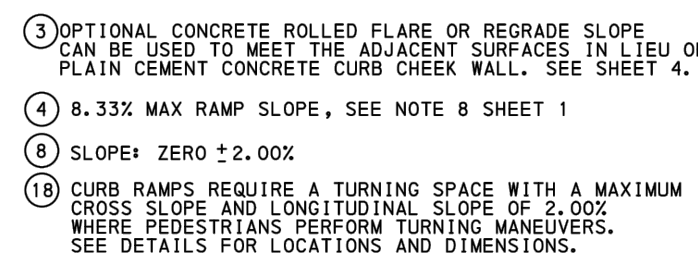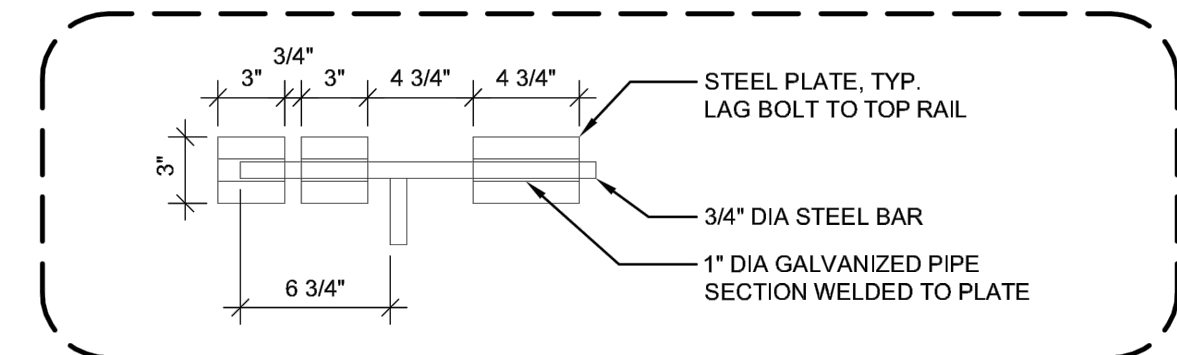


NEW CONSTRUCTION OR  
ALTERATION DETAILS  
TYPE 1A AND TYPE 2 CURB RAMPS

RECOMMENDED JUN. 10, 2013 <i>TC. W. Smith</i> CHIEF, HWY. DELIVERY DIVISION	RECOMMENDED JUN. 10, 2013 <i>David Smith</i> ACTING DIR. BUREAU OF PROJECT DELIVERY	SHT <u>3</u> OF <u>14</u> RC-67M
---	---	-------------------------------------

3. PROVIDE MATERIALS AND CONSTRUCT AS SPECIFIED IN PUBLICATION 408, SECTIONS 350, 413, 630, 676 AND 699.
4. PROVIDE EXPANDED JOINT MATERIAL 3/4" THICK WHERE CURB RAMP ADJOINS ANY RIGID PAVEMENT. SIDEWALK SHALL BE THE TOP OF THE FILLER WITH ADJACENT CONCRETE SURFACE.
5. CONSTRUCT CURB RAMP RATHER THAN MINIMUM 4% SLOPE WITH ADJACENT CONCRETE SURFACE. WITHIN THE WIDTH OF THE CROSSWALK AND WHOLLY OUTSIDE THE PARALLEL WHITE PAVEMENT TRAVEL LANE. SEE SHEET 7 FOR CURB RAMP DETAILS.
6. SEAL JOINTS WITH AN APPROVED SEALING MATERIAL.
7. PROVIDE SLIP RESISTANT TEXTURE ON CURB RAMP BY COARSE BROOMING TRANSVERSE TO THE SLOPE OF THE SLOPE. THE TEXTURE TO THE FULL WIDTH OF THE CURB RAMP INCLUDING SIDE FLORES.
8. PROVIDE CURB RAMP SLOPES TO ADAPT DIMENSIONS TO NOW OR EXISTING CURB HEIGHTS.
9. THE SLOPE IS LESS THAN THE STANDARD 8:1 TRAVEL.
10. PROVIDE SIDE FLORES WITH A MINIMUM 4% SLOPE BASED ON CURB HEIGHT AND THE SIDEWALK SLOPE.
11. TO AVOID CHASING GRADE INDEFINITELY WHEN TRaversing THE HEIGHT OF CURB, RAMP LENGTH NOT TO EXCEED 15'-0". ADJUST RAMP SLOPE AS NECESSARY TO PROVIDE ACCESS TO THE MAXIMUM EXISTING FEASIBLE.
12. NON-WALK AREA ADJ. IS AN OBSTRUCTED OR GRASS/NO-PAVED AREA ADJACENT TO THE PEDESTRIAN ACCESS ROUTE THAT IS NOT USED FOR PEDESTRIAN TRAVEL.
13. THE DETAILS DEPICT PEDESTRIAN PUSHBUTTON PLACES TO ILLUSTRATE THE RECOMMENDED PLACEMENT OF THE VARIOUS ALTERNATE TEXTURES TO BE USED FOR THE PEDESTRIAN PUSHBUTTON PLACES. THE RECOMMENDED PUSHBUTTONS TO THE MAXIMUM EXISTING FEASIBLE. INSTALL PEDESTRIAN PUSHBUTTON STOP BARS, WHERE APPLICABLE, AS NOTED ON THE DETAILS.
14. SEE TO-8800S FOR ADDITIONAL PEDESTRIAN PUSHBUTTON DETAILS NOT SHOWN.
15. ALIGN DETECTABLE WARNING SURFACE TRUNCATED DOMES ON A SQUARE GRID IN THE PREDOMINANT DIRECTION OF TRAVEL. DETECTABLE WARNING SURFACE TRUNCATED DOMES SHALL BE FULLY ADJACENT TO ALL CURVED SURFACES.
16. PROVIDE DETECTABLE WARNING SURFACES (DWS) 24" LIGHT ON (DIRECTION OF PEDESTRIAN TRAVEL) FULLY ADJACENT TO ALL CURVED SURFACES. DETECTABLE WARNING SURFACES SHALL BE FULLY ADJACENT TO ALL VISIBLY BUSY ADJACENT WALKWAY SURFACES, EITHER LIGHT-ON-DARK OR DARK-ON-LIGHT FOR THE FULL WIDTH OF THE WALKWAY SURFACE.
17. FOR NEW CONSTRUCTION, DO NOT EXCEED 2.00% CROSS SLOPE ON THE CURB RAMP OR PEDESTRIAN ACCESS ROUTE.
18. FOR NEW CONSTRUCTION AND ALTERATIONS, CONSTRUCT CURB RAMP AND FLARE SLOPES WITH THE FLATTEST SLOPE POSSIBLE. THE SLOPES INDICATED IN THE DETAILS SHOWN ARE MAXIMUM ALLOWABLE. SLOPES THAT ARE FLATTER THAN THE DETAILS, OR CONTRACT DOCUMENTS AS APPLICABLE, WILL NOT BE ACCEPTED AND WILL BE RECONSTRUCTED.
19. CONSTRUCT SIDEWALKS AT A LONGITUDINAL SLOPE NOT TO EXCEED 8.00%. FOR SIDEWALK FLARE SLOPES THAT EXCEED 8.00% AND ARE GRADUALLY CHANGING, THE SLOPE SHALL BE 10.00% MAXIMUM. SIDEWALK SLOPES NOT TO EXCEED 8.00% SHALL BE MAINTAINED AT THE BOTTOM OF THE CURB RAMP AND ADJOINING ROAD SURFACES. 15% IS NOT TO EXCEED AN UNALLOWED DIFFERENCE OF 13.33%. THE CENTER SLOPE OF THE GUTTER OR ROAD AT THE FOOT OF A CURB SHALL BE A GRADE OF 1.00% TO 2.00% TO THE BOTTOM OF THE CURB RAMP.
20. THE CONSTRUCTION STANDARDS PROVIDED ARE MOST APPROPRIATE FOR NEW CONSTRUCTION. ALL CONSTRUCTION SHALL BE CONSTRUCTED TO MEET THE REQUIREMENTS HEREIN IN ADDITION TO ANY CITY OR DISTRICT.
21. ALL SLOPES ARE MEASURED AS HORIZONTAL. THE SLOPE OF THE CURB RAMP OR SIDEWALK FLARE SLOPE OF RAMP IS NOT SOLELY DEPENDENT ON THE HEIGHT OF CURB, (FOR EXAMPLE, A 6" CURB DOES NOT NECESSARILY MEAN A RAMP SLOPE OF 6% BUT MAY BE 4% OR 5%).
22. SIDEWALK WIDTH MAY BE REDUCED TO 4'-0" WHEN, WHEN PASSING AREAS 5'-0" X 5'-0" ARE PROVIDED EVERY 150 FEET.
23. THE TRAVEL LANE IS DEFINED BY THE OUTSIDE EDGE OF THE WHITE PAVEMENT MARKING LINE. IF A WHITE PAVEMENT MARKING LINE DOES NOT EXIST, THE TRAVEL LANE IS DEFINED BY THE CONTRACT DOCUMENTS.
24. CONSTRUCT DEPRESSIONED CURB FOR CURB RAMP FLUSH TO ADJACENT ROADWAY, GRADE EDGE OF ROAD ELEVATIONS SHALL BE THE SAME AS THE GRADE OF THE ROADWAY. PROVIDE 1/2" DEPRESSION FOR FULL DEPTH OF DEPRESSIONED CURB AND ROADWAYS. REMOVE EXCESS JOINT SEALER AND COVER THE SEALED AREA WITH A LIGHT COAT OF SALT SAND.
25. CHECK MARKS ARE PERMITTED WHEN ADJACENT TO NON-WALK AREAS OR ELEVATION DIFFERENCES CANNOT BE COMPENSATED BY FLARE OR GRAD. THE GRADE GRADE BEARS OR OTHER NON-WALK AREAS AT 361 OR FLATTER, DO NOT REQUIRE CHECK MARKS.
26. CONSTRUCT TOP OF PLAIN CEMENT CONCRETE DEPRESSIONED CURB TO BE FLUSH WITH ADJACENT SURFACES.
27. CONSTRUCT CURB RAMP THAT LEAD TO A SINGLE CROSSWALK, THE RAMP (EXCLUDING FLARES) TO BE FULLY INSIDE OF MARKED CROSSWALK LINES. SEE SHEET 7 FOR DETAILS.
28. IF 1:120 MAXIMUM DIGITAL DISPLAY LEVEL WILL BE USED TO VERIFY THE SLOPES OF CURB RAMP AND SIDEWALKS.
29. INSTALL DUMMY JOINTS WHERE RAMPs, TURNING SPACES, FLARES, AND SIDEWALKS ABUT.
30. FOR NEW CONSTRUCTION AND ALTERATIONS, CONSTRUCT CURB RAMP AND FLARE SLOPES WITH THE FLATTEST SLOPE POSSIBLE. THE SLOPES INDICATED IN THE DETAILS SHOWN ARE MAXIMUM ALLOWABLE. SLOPES THAT ARE FLATTER THAN THE DETAILS, OR CONTRACT DOCUMENTS AS APPLICABLE, WILL NOT BE ACCEPTED AND WILL BE RECONSTRUCTED.
31. CONSTRUCT SIDEWALKS AT A LONGITUDINAL SLOPE NOT TO EXCEED 8.00%. FOR SIDEWALK FLARE SLOPES THAT EXCEED 8.00% AND ARE GRADUALLY CHANGING, THE SLOPE SHALL BE 10.00% MAXIMUM. SIDEWALK SLOPES NOT TO EXCEED 8.00% SHALL BE MAINTAINED AT THE BOTTOM OF THE CURB RAMP AND ADJOINING ROAD SURFACES. 15% IS NOT TO EXCEED AN UNALLOWED DIFFERENCE OF 13.33%. THE CENTER SLOPE OF THE GUTTER OR ROAD AT THE FOOT OF A CURB SHALL BE A GRADE OF 1.00% TO 2.00% TO THE BOTTOM OF THE CURB RAMP.
32. THE CONSTRUCTION STANDARDS PROVIDED ARE MOST APPROPRIATE FOR NEW CONSTRUCTION. ALL CONSTRUCTION SHALL BE CONSTRUCTED TO MEET THE REQUIREMENTS HEREIN IN ADDITION TO ANY CITY OR DISTRICT.
33. ALL SLOPES ARE MEASURED AS HORIZONTAL. THE SLOPE OF THE CURB RAMP OR SIDEWALK FLARE SLOPE OF RAMP IS NOT SOLELY DEPENDENT ON THE HEIGHT OF CURB, (FOR EXAMPLE, A 6" CURB DOES NOT NECESSARILY MEAN A RAMP SLOPE OF 6% BUT MAY BE 4% OR 5%).
34. SIDEWALK WIDTH MAY BE REDUCED TO 4'-0" WHEN, WHEN PASSING AREAS 5'-0" X 5'-0" ARE PROVIDED EVERY 150 FEET.
35. THE TRAVEL LANE IS DEFINED BY THE OUTSIDE EDGE OF THE WHITE PAVEMENT MARKING LINE. IF A WHITE PAVEMENT MARKING LINE DOES NOT EXIST, THE TRAVEL LANE IS DEFINED BY THE CONTRACT DOCUMENTS.
36. CONSTRUCT DEPRESSIONED CURB FOR CURB RAMP FLUSH TO ADJACENT ROADWAY, GRADE EDGE OF ROAD ELEVATIONS SHALL BE THE SAME AS THE GRADE OF THE ROADWAY. PROVIDE 1/2" DEPRESSION FOR FULL DEPTH OF DEPRESSIONED CURB AND ROADWAYS. REMOVE EXCESS JOINT SEALER AND COVER THE SEALED AREA WITH A LIGHT COAT OF SALT SAND.
37. CHECK MARKS ARE PERMITTED WHEN ADJACENT TO NON-WALK AREAS OR ELEVATION DIFFERENCES CANNOT BE COMPENSATED BY FLARE OR GRAD. THE GRADE GRADE BEARS OR OTHER NON-WALK AREAS AT 361 OR FLATTER, DO NOT REQUIRE CHECK MARKS.
38. CONSTRUCT TOP OF PLAIN CEMENT CONCRETE DEPRESSIONED CURB TO BE FLUSH WITH ADJACENT SURFACES.
39. CONSTRUCT CURB RAMP THAT LEAD TO A SINGLE CROSSWALK, THE RAMP (EXCLUDING FLARES) TO BE FULLY INSIDE OF MARKED CROSSWALK LINES. SEE SHEET 7 FOR DETAILS.
40. IF 1:120 MAXIMUM DIGITAL DISPLAY LEVEL WILL BE USED TO VERIFY THE SLOPES OF CURB RAMP AND SIDEWALKS.
41. INSTALL DUMMY JOINTS WHERE RAMPs, TURNING SPACES, FLARES, AND SIDEWALKS ABUT.
42. FOR NEW CONSTRUCTION AND ALTERATIONS, CONSTRUCT CURB RAMP AND FLARE SLOPES WITH THE FLATTEST SLOPE POSSIBLE. THE SLOPES INDICATED IN THE DETAILS SHOWN ARE MAXIMUM ALLOWABLE. SLOPES THAT ARE FLATTER THAN THE DETAILS, OR CONTRACT DOCUMENTS AS APPLICABLE, WILL NOT BE ACCEPTED AND WILL BE RECONSTRUCTED.
43. CONSTRUCT SIDEWALKS AT A LONGITUDINAL SLOPE NOT TO EXCEED 8.00%. FOR SIDEWALK FLARE SLOPES THAT EXCEED 8.00% AND ARE GRADUALLY CHANGING, THE SLOPE SHALL BE 10.00% MAXIMUM. SIDEWALK SLOPES NOT TO EXCEED 8.00% SHALL BE MAINTAINED AT THE BOTTOM OF THE CURB RAMP AND ADJOINING ROAD SURFACES. 15% IS NOT TO EXCEED AN UNALLOWED DIFFERENCE OF 13.33%. THE CENTER SLOPE OF THE GUTTER OR ROAD AT THE FOOT OF A CURB SHALL BE A GRADE OF 1.00% TO 2.00% TO THE BOTTOM OF THE CURB RAMP.
44. THE CONSTRUCTION STANDARDS PROVIDED ARE MOST APPROPRIATE FOR NEW CONSTRUCTION. ALL CONSTRUCTION SHALL BE CONSTRUCTED TO MEET THE REQUIREMENTS HEREIN IN ADDITION TO ANY CITY OR DISTRICT.
45. ALL SLOPES ARE MEASURED AS HORIZONTAL. THE SLOPE OF THE CURB RAMP OR SIDEWALK FLARE SLOPE OF RAMP IS NOT SOLELY DEPENDENT ON THE HEIGHT OF CURB, (FOR EXAMPLE, A 6" CURB DOES NOT NECESSARILY MEAN A RAMP SLOPE OF 6% BUT MAY BE 4% OR 5%).
46. SIDEWALK WIDTH MAY BE REDUCED TO 4'-0" WHEN, WHEN PASSING AREAS 5'-0" X 5'-0" ARE PROVIDED EVERY 150 FEET.
47. THE TRAVEL LANE IS DEFINED BY THE OUTSIDE EDGE OF THE WHITE PAVEMENT MARKING LINE. IF A WHITE PAVEMENT MARKING LINE DOES NOT EXIST, THE TRAVEL LANE IS DEFINED BY THE CONTRACT DOCUMENTS.
48. CONSTRUCT DEPRESSIONED CURB FOR CURB RAMP FLUSH TO ADJACENT ROADWAY, GRADE EDGE OF ROAD ELEVATIONS SHALL BE THE SAME AS THE GRADE OF THE ROADWAY. PROVIDE 1/2" DEPRESSION FOR FULL DEPTH OF DEPRESSIONED CURB AND ROADWAYS. REMOVE EXCESS JOINT SEALER AND COVER THE SEALED AREA WITH A LIGHT COAT OF SALT SAND.
49. CHECK MARKS ARE PERMITTED WHEN ADJACENT TO NON-WALK AREAS OR ELEVATION DIFFERENCES CANNOT BE COMPENSATED BY FLARE OR GRAD. THE GRADE GRADE BEARS OR OTHER NON-WALK AREAS AT 361 OR FLATTER, DO NOT REQUIRE CHECK MARKS.
50. CONSTRUCT TOP OF PLAIN CEMENT CONCRETE DEPRESSIONED CURB TO BE FLUSH WITH ADJACENT SURFACES.
51. CONSTRUCT CURB RAMP THAT LEAD TO A SINGLE CROSSWALK, THE RAMP (EXCLUDING FLARES) TO BE FULLY INSIDE OF MARKED CROSSWALK LINES. SEE SHEET 7 FOR DETAILS.
52. IF 1:120 MAXIMUM DIGITAL DISPLAY LEVEL WILL BE USED TO VERIFY THE SLOPES OF CURB RAMP AND SIDEWALKS.
53. INSTALL DUMMY JOINTS WHERE RAMPs, TURNING SPACES, FLARES, AND SIDEWALKS ABUT.
54. FOR NEW CONSTRUCTION AND ALTERATIONS, CONSTRUCT CURB RAMP AND FLARE SLOPES WITH THE FLATTEST SLOPE POSSIBLE. THE SLOPES INDICATED IN THE DETAILS SHOWN ARE MAXIMUM ALLOWABLE. SLOPES THAT ARE FLATTER THAN THE DETAILS, OR CONTRACT DOCUMENTS AS APPLICABLE, WILL NOT BE ACCEPTED AND WILL BE RECONSTRUCTED.
55. CONSTRUCT SIDEWALKS AT A LONGITUDINAL SLOPE NOT TO EXCEED 8.00%. FOR SIDEWALK FLARE SLOPES THAT EXCEED 8.00% AND ARE GRADUALLY CHANGING, THE SLOPE SHALL BE 10.00% MAXIMUM. SIDEWALK SLOPES NOT TO EXCEED 8.00% SHALL BE MAINTAINED AT THE BOTTOM OF THE CURB RAMP AND ADJOINING ROAD SURFACES. 15% IS NOT TO EXCEED AN UNALLOWED DIFFERENCE OF 13.33%. THE CENTER SLOPE OF THE GUTTER OR ROAD AT THE FOOT OF A CURB SHALL BE A GRADE OF 1.00% TO 2.00% TO THE BOTTOM OF THE CURB RAMP.
56. THE CONSTRUCTION STANDARDS PROVIDED ARE MOST APPROPRIATE FOR NEW CONSTRUCTION. ALL CONSTRUCTION SHALL BE CONSTRUCTED TO MEET THE REQUIREMENTS HEREIN IN ADDITION TO ANY CITY OR DISTRICT.
57. ALL SLOPES ARE MEASURED AS HORIZONTAL. THE SLOPE OF THE CURB RAMP OR SIDEWALK FLARE SLOPE OF RAMP IS NOT SOLELY DEPENDENT ON THE HEIGHT OF CURB, (FOR EXAMPLE, A 6" CURB DOES NOT NECESSARILY MEAN A RAMP SLOPE OF 6% BUT MAY BE 4% OR 5%).
58. SIDEWALK WIDTH MAY BE REDUCED TO 4'-0" WHEN, WHEN PASSING AREAS 5'-0" X 5'-0" ARE PROVIDED EVERY 150 FEET.
59. THE TRAVEL LANE IS DEFINED BY THE OUTSIDE EDGE OF THE WHITE PAVEMENT MARKING LINE. IF A WHITE PAVEMENT MARKING LINE DOES NOT EXIST, THE TRAVEL LANE IS DEFINED BY THE CONTRACT DOCUMENTS.
60. CONSTRUCT DEPRESSIONED CURB FOR CURB RAMP FLUSH TO ADJACENT ROADWAY, GRADE EDGE OF ROAD ELEVATIONS SHALL BE THE SAME AS THE GRADE OF THE ROADWAY. PROVIDE 1/2" DEPRESSION FOR FULL DEPTH OF DEPRESSIONED CURB AND ROADWAYS. REMOVE EXCESS JOINT SEALER AND COVER THE SEALED AREA WITH A LIGHT COAT OF SALT SAND.
61. CHECK MARKS ARE PERMITTED WHEN ADJACENT TO NON-W

N.T.S.



NO.	REVISION	DATE
1	—	—
2	—	—
3	—	—
4	—	—
5	—	—

COPYRIGHT © 2021 BY R.J. FISHER & ASSOCIATES, INC.

---

---

**R. J. FISHER & ASSOCIATES, INC.**

**SITE PLANNING ▣ CIVIL ENGINEERING ▣ LAND SURVEYS**

1546 BRIDGE STREET, NEW CUMBERLAND, PA. 17070

PHONE: (717) 774-7534 □ FAX: (717) 774-7190

RRJFISHERENGINEERING.COM

**THE SHERBURN & ASSOCIATES, INC.**

## SITE DETAILS

FC

# 2509 MILL ROAD TOWNHOMES

LOCATED IN  
UPPER ALLEN TOWNSHIP, CUMBERLAND COUNTY, PA

DRAWING ID:  
221013-3-LD


PROJECT: 221013

DATE: 04/25/2022

SHEET

12 OF 18




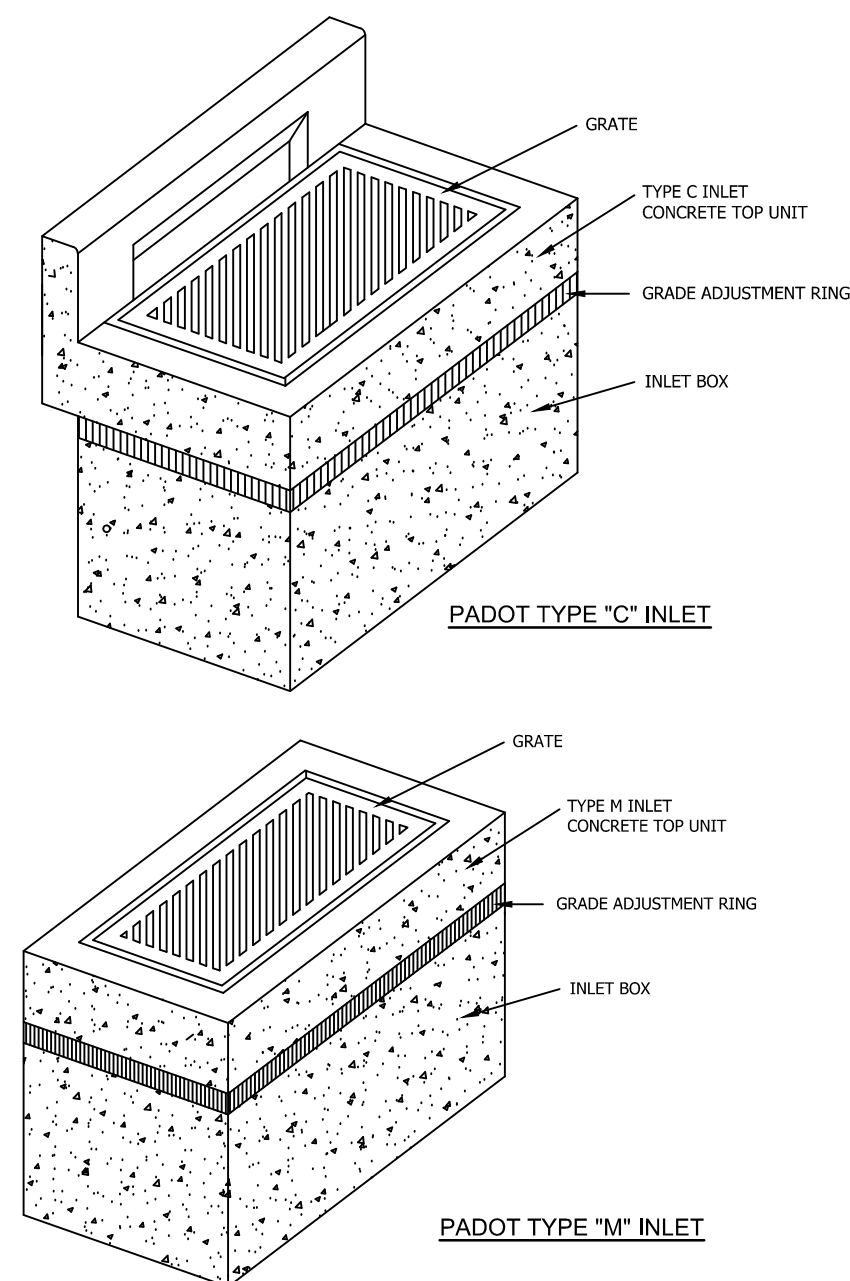

NOTE: CONSTRUCTION OF STORMWATER INLETS SHALL CONFORM TO AND BE IN ACCORDANCE WITH ALL APPLICABLE RC STANDARDS, PENNDOT PUBLICATION 72M AND ALL AMENDMENTS.

PENNDOT TYPE "M" INLET TOP  
N.T.S.

NOTE: ALL INLETS TO HAVE PENN DOT TYPE BICYCLE  
SAFE GRATES.

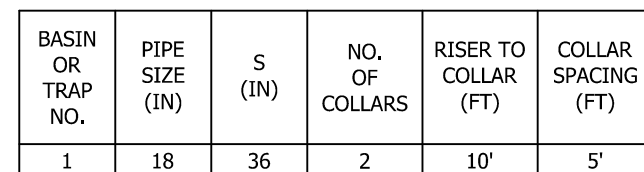

NOTES:

ALL COLLARS SHALL BE INSTALLED SO AS TO BE WATERTIGHT.


COLLAR SIZE AND SPACING SHALL BE AS INDICATED WITHIN TABLE.

The image displays two orthographic views of a mechanical component. The **SIDE VIEW** on the left shows a profile with a total height of 8", a base width of 6", and a sloped section with a 30° angle. The sloped section has a vertical height of 12" and a horizontal run of 10". The **PLAN VIEW** on the right shows a trapezoidal top surface with a total width of 43" and a base width of 52". The sloped sides have a 30° angle and a vertical height of 15". The base of the component is 6" wide.



NOTE: PROVIDE PROTECTIVE BAR SCREEN IF PIPE IS 24" OR LARGER IN DIAMETER

TYPE D-W ENDWALL (MAX. PIPE SIZE 21") DETAIL

N.T.S.

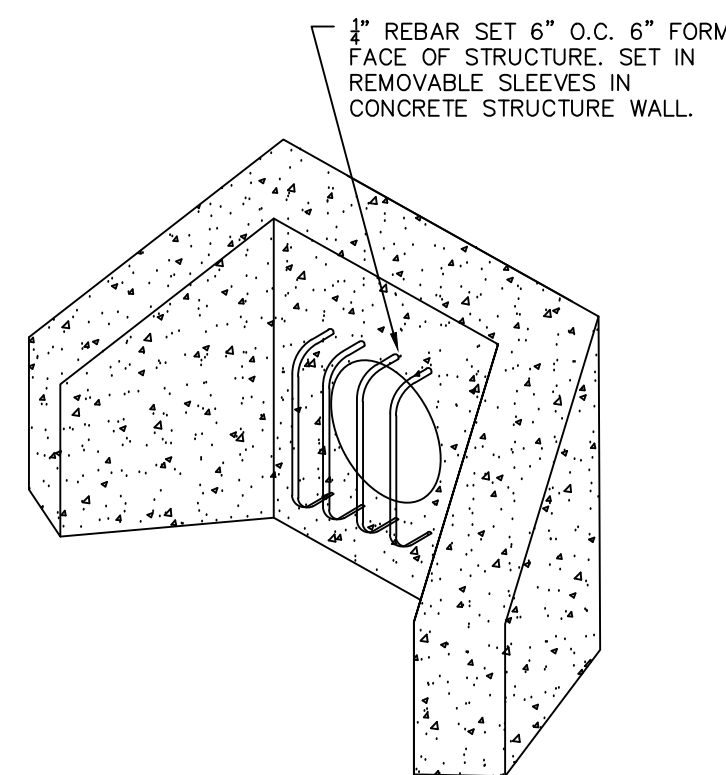

GUARD AT ENDWALL DETAIL  
N.T.S.

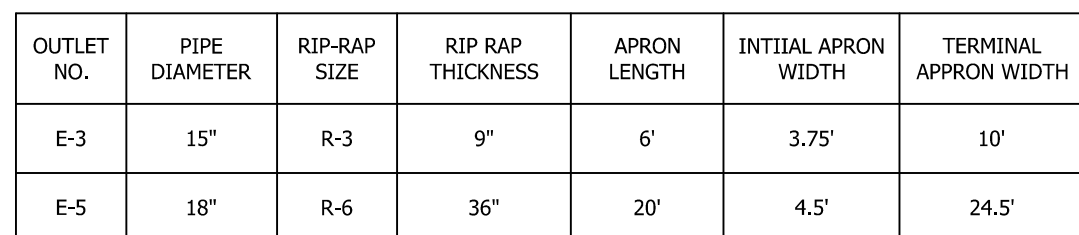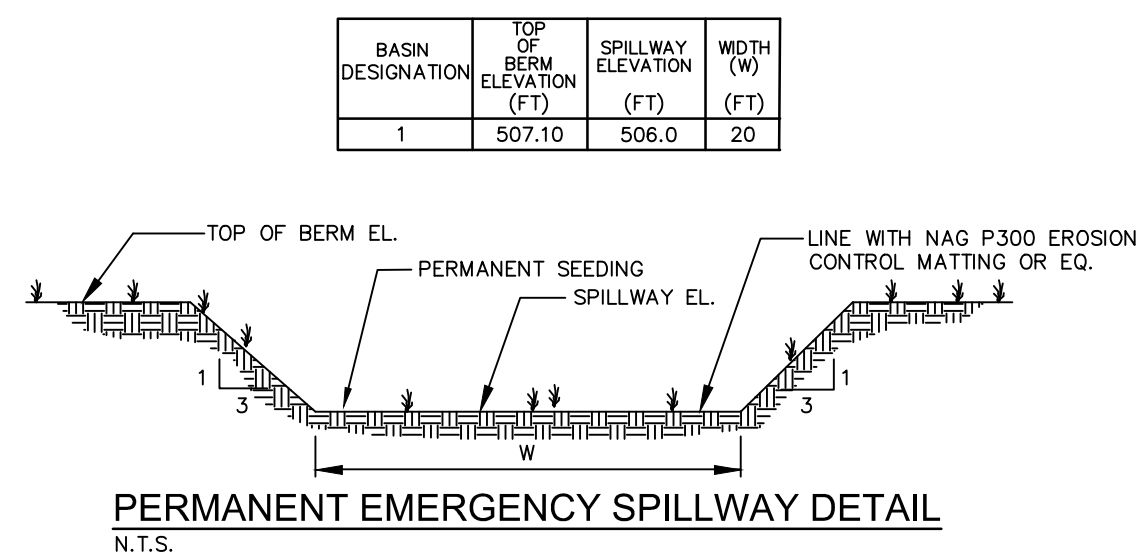


NOTES:


ALL APRONS SHALL BE CONSTRUCTED TO THE DIMENSIONS SHOWN.  
TERMINAL WIDTHS SHALL BE ADJUSTED AS NECESSARY TO MATCH  
RECEIVING CHANNELS.

ALL APRONS SHALL BE INSPECTED AT LEAST WEEKLY AND AFTER EACH RUNOFF EVENT. DISPLACED RIPRAP WITHIN THE APRON SHALL BE REPLACED IMMEDIATELY.

RIPRAP APRON AT PIPE OUTLET  
WITH FLARED END SECTION OR ENDWALL  
N.T.S.

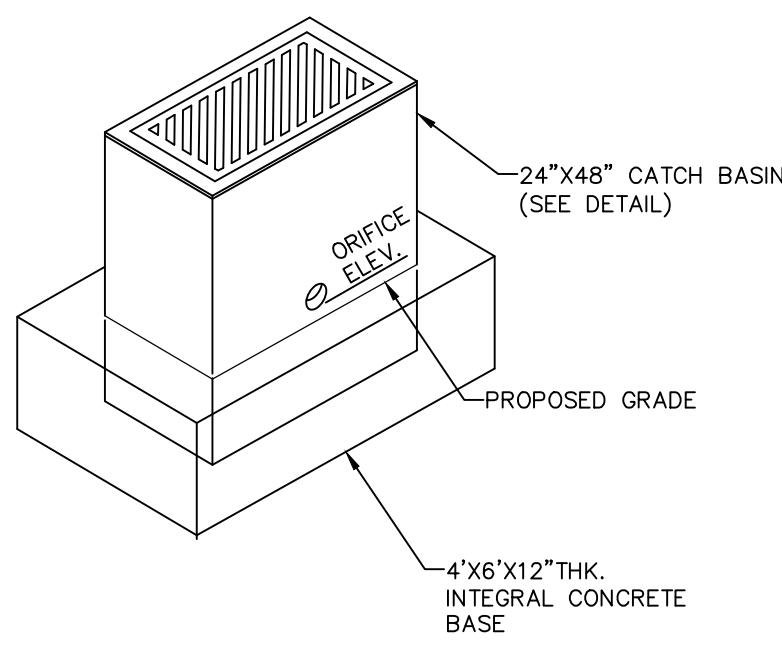

BASIN/ BMP NO.	RISER				BARREL				
	TOP ELEV RCE (FT)	ORIFICE		U. D. ELEV UDE (FT)	MAT'L	DIA D <sub>b</sub> (IN)	INLET ELEV BIE (FT)	LENGTH BI (FT)	OUTLET ELEV BOE (FT)
		SIZE (IN)	ELEV (FT)						
1	505.7	12"	503.5	---	RCP	18	501.5	26	501.0

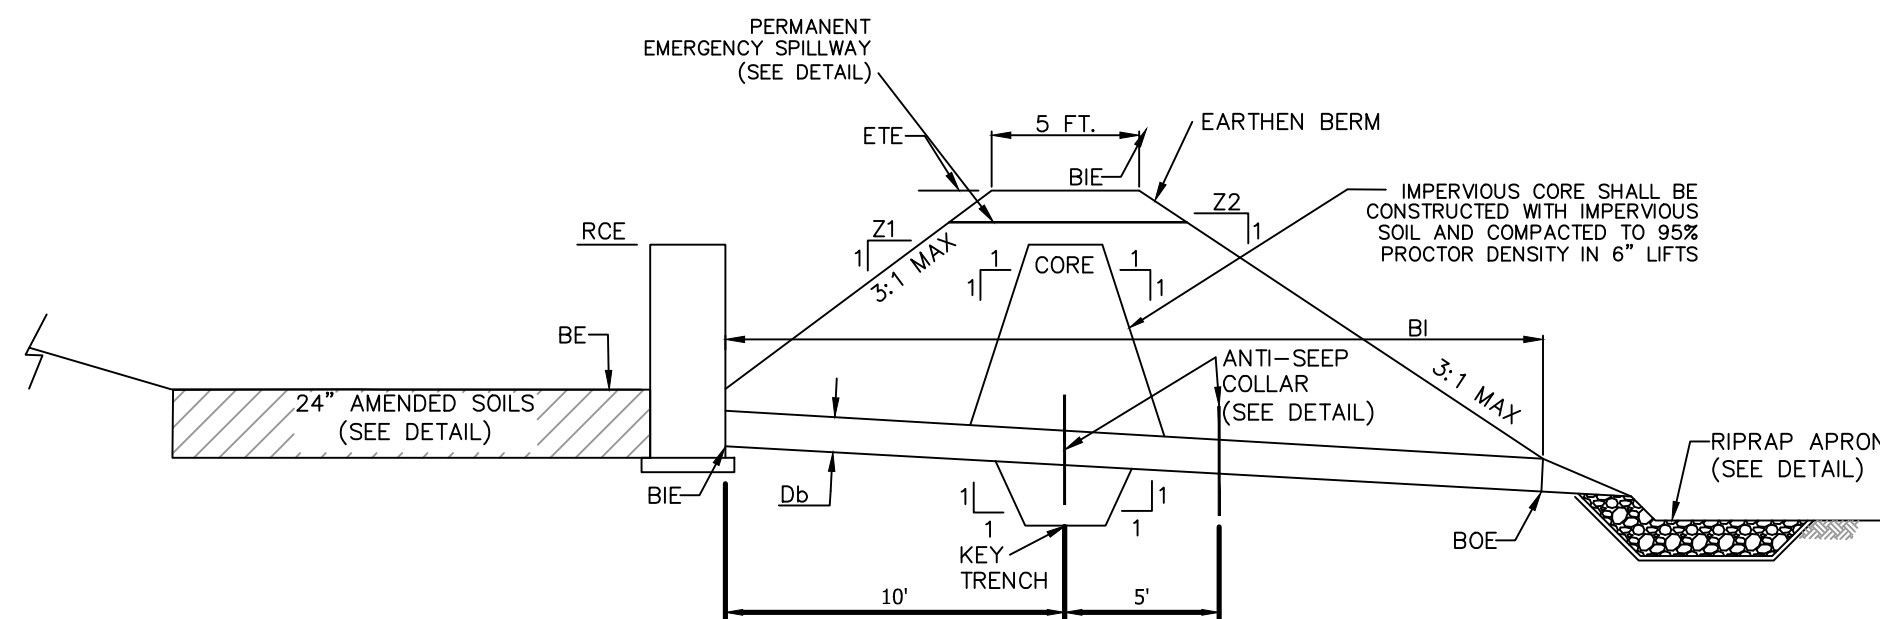


BASIN NO.	Z1 (FT)	Z2 (FT)	EMBANKMENT				BOTTOM ELEV BE (FT)
			TOP ELEV ETE (FT)	TOP WIDTH Etw (FT)	KEY TRENCH DEPTH (FT)	KEY TRENCH WIDTH (FT)	
1	3	3	507.10	5.0	3.0	5.0	501.5

NOTES:

1. PROTECT INFILTRATION BASIN AREA FROM COMPACTION PRIOR TO INSTALLATION.
2. IF POSSIBLE, INSTALL INFILTRATION BASIN DURING LATER PHASES OF SITE CONSTRUCTION TO PREVENT SEDIMENTATION AND/OR DAMAGE FROM CONSTRUCTION ACTIVITY. AFTER INSTALLATION, PREVENT SEDIMENT--LADEN WATER FROM ENTERING INLETS AND PIPES.
3. INSTALL AND MAINTAIN PROPER EROSION AND SEDIMENT CONTROL MEASURES DURING CONSTRUCTION.
4. IF NECESSARY, EXCAVATE INFILTRATION BASIN BOTTOM TO AN UNCOMPACTED SUBGRADE FREE FROM ROCKS AND DEBRIS. DO NOT COMPACT SUBGRADE.
5. INSTALL OUTLET CONTROL STRUCTURES. OUTLET STRUCTURES SHOULD PROVIDE MEANS TO MODIFY THE ORIFICES THROUGH THE USE OF REMOVABLE PLATES UNDER THE DIRECTION OF THE TOWNSHIP.
6. SEED AND STABILIZE TOPSOIL. (VEGETATE IF APPROPRIATE WITH NATIVE PLANTINGS.)
7. DO NOT REMOVE INLET PROTECTION OR OTHER EROSION AND SEDIMENT CONTROL MEASURES UNTIL SITE IS FULLY STABILIZED.
8. PLAT IS TO BE IN PLACE DURING CONSTRUCTION AND TO BE REMOVED FOR THE PERMANENT CONDITION

OUTLETE STRUCTURE & INFILTRATION BASIN DETAIL

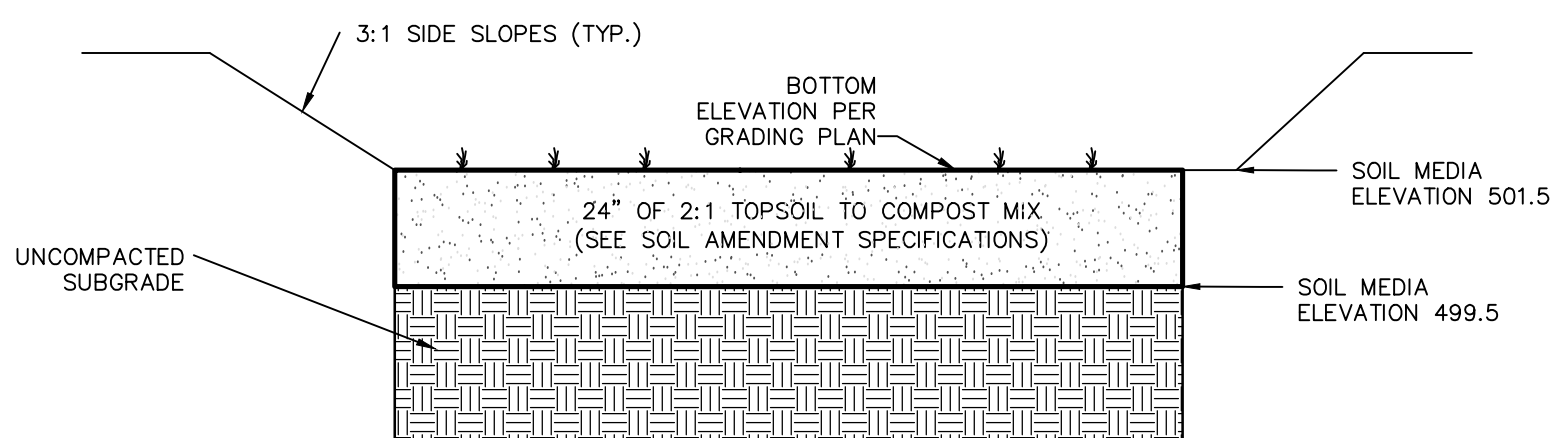

NOTES:

1. EVACUATE FOR SOIL MEDIA TO PROPOSED INVERT DEPTH AND SCARIFY THE EXISTING SOIL SURFACES. DO NOT COMPACT IN-SITU SOLIDS.
2. BACKFILL INFILTRATION AREA / BASIN WITH AMENDED SOIL AS SHOWN ON THE PLANS AND SPECIFICATIONS. OVERFILLING IS RECOMMENDED TO ACCOUNT FOR SETTLEMENT. LIGHT HAND TAMPING IS ACCEPTABLE IF NECESSARY.
3. PRESOAK THE PLANTING SOIL PRIOR TO PLANTING VEGETATION TO AID IN SETTLEMENT.
4. COMPLETE THE FINAL GRADING TO ACHIEVE PROPOSED DESIGN ELEVATIONS, LEAVING SPACE FOR UPPER LAYER OF COMPOST, MULCH OR TOPSOIL AS SPECIFIED ON PLANS.
5. SEED WITH ERNMX-126 RETENTION BASIN FLOOR MIX 20 LB/ACRE WITH A COVER CROP OF GRAIN RYE AT 30 LB/ACRE. SEE SPECIALTY SEEDING SCHEDULE ON EROSION CONTROL DETAILS SHEET.
6. MULCH AND INSTALL EROSION PROTECTION AT SURFACE FLOW ENTRANCES WHERE NECESSARY.

SOIL AMENDMENT SPECIFICATIONS:

1. SOIL AMENDMENT MEDIA MAY CONSIST OF COMPOST (CHOPPED STRAW, LEAVES, GRASS CLIPPINGS AD OTHER PLANT REFUSE), COMPOSTED OR DRIED MANURES, WOOD PRODUCTS (SAWDUST, WOOD SHAVINGS, SHREDDED WOOD PULVERIZED BARK AND WOOD CHIPS), PEAT MOSS, MUSHROOM SOIL, OR SAND, WELL-BLENDED AND AGED.
2. COMPOST SHOULD BE ADDED AT A RATE OF 2:1 (SOIL:COMPOST).
3. ON-SITE TOPSOILS CAN BE PROPERLY STOCKPILED AND REUSED FOR SOIL PORTION OF THE 2:1 SOIL:COMPOST MIX.

**SOIL MEDIA IN BASIN**  
NOT TO SCALE

NO.	REVISION	DATE
1	—	—
2	—	—
3	—	—
4	—	—
5	—	—

COPYRIGHT © 2021 BY R.J. FISHER & ASSOCIATES, INC.


**R. J. FISHER & ASSOCIATES, INC.**

**SITE PLANNING ▣ CIVIL ENGINEERING ▣ LAND SURVEYS**

1340 BRIDGE STREET, NEW CONDELMINE, ILL. 17070  
PHONE: (717) 774-7534 □ FAX: (717) 774-7190

RJFISHERENGINEERING.COM

COPYRIGHT © 2021 BY R.J. FISHER & ASSOCIATES, INC.

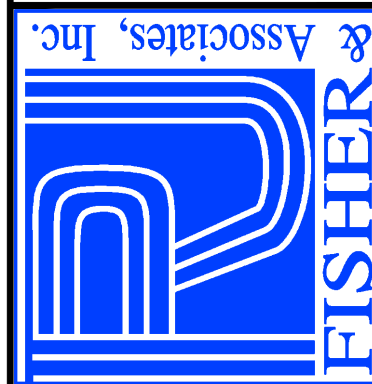

## SWM DETAILS

FOR

# 2509 MILL ROAD TOWNHOMES

LOCATED IN  
UPPER ALLEN TOWNSHIP, CUMBERLAND COUNTY, PA


DRAWING ID:  
221013-3-LE

PROJECT: 221013

DATE: 04/25/2022

SHEET:  
**13 OF 18**



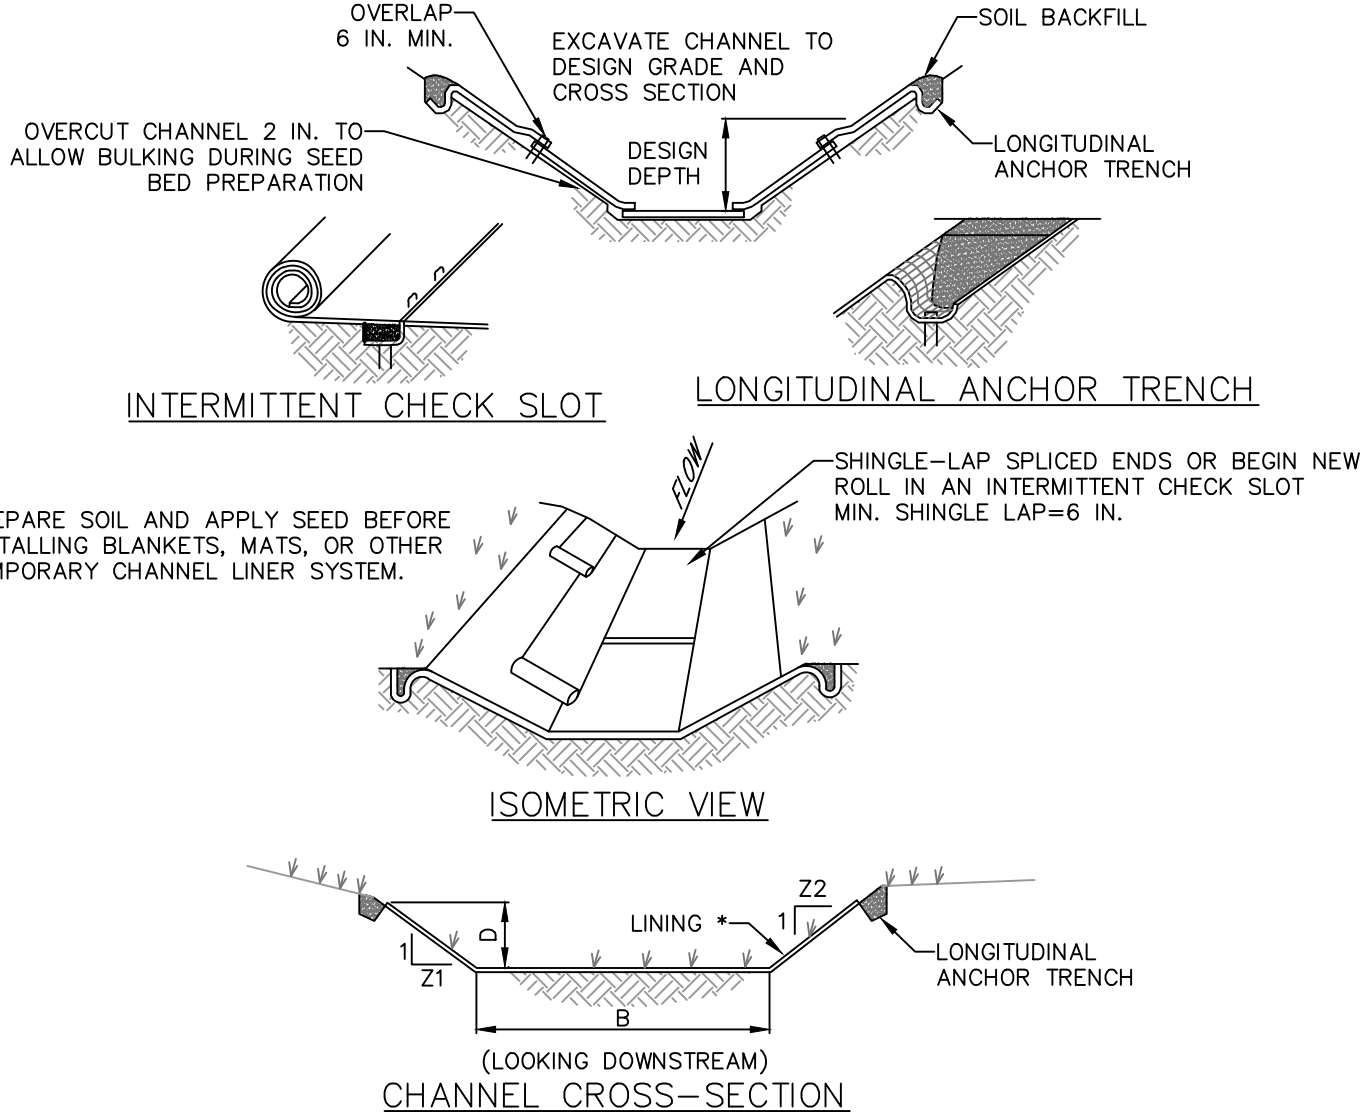

\* SEE MANUFACTURER'S LINING INSTALLATION DETAIL FOR STAPLE PATTERNS, VEGETATIVE STABILIZATION FOR SOIL AMENDMENTS, SEED MIXTURES AND MULCHING INFORMATION

CHANNEL NO.	AVG. SLOPE (%)	BOTTOM WIDTH B (FT)	DEPTH D (FT)	TOP WIDTH W (FT)	Z1 (FT)	Z2 (FT)	LINING *	COVER
Swale 1	6.7	2	1	8	3	3	NAG S75BN	CLASS D VEG.
Swale 2	2.0	2	1	8	3	3	NAG S75BN	CLASS D VEG.
Swale 3	6.5	2	1	8	3	3	NAG S75BN	CLASS D VEG.
Swale 4	6.0	2	1	8	2	2	NAG S75BN	CLASS D VEG.

\* NOTE:  
N.A.G. INDICATES NORTH AMERICAN GREEN PRODUCT, WITH PRODUCT #.

NOTES:

ANCHOR TRENCHES SHALL BE INSTALLED AT BEGINNING AND END OF CHANNEL IN THE SAME MANNER AS LONGITUDINAL ANCHOR TRENCHES.

CHANNEL DIMENSIONS SHALL BE CONSTANTLY MAINTAINED. CHANNEL SHALL BE CLEANED WHENEVER TOTAL CHANNEL DEPTH IS REDUCED BY 25% AT ANY LOCATION. SEDIMENT DEPOSITS SHALL BE REMOVED WITHIN 24 HOURS OF DISCOVERY OR AS SOON AS SOIL CONDITIONS PERMIT ACCESS TO CHANNEL WITHOUT FURTHER DAMAGE. DAMAGED LINING SHALL BE REPAIRED OR REPLACED WITHIN 48 HOURS OF DISCOVERY.

NO MORE THAN ONE THIRD OF THE SHOOT (GRASS LEAF) SHALL BE REMOVED IN ANY MOWING. GRASS HEIGHT SHALL BE MAINTAINED BETWEEN 2 AND 3 INCHES UNLESS OTHERWISE SPECIFIED. EXCESS VEGETATION SHALL BE REMOVED FROM PERMANENT CHANNELS TO ENSURE SUFFICIENT CHANNEL CAPACITY.

STANDARD CONSTRUCTION DETAIL #6-1  
VEGETATED CHANNEL  
NOT TO SCALE

STORMWATER BMP OPERATION AND MAINTENANCE PLAN

OPERATION AND MAINTENANCE SCHEDULE

The storm water volume and quality control Best Management Practices (BMPs) constructed for this project will be maintained to function as designed, and shall implement the procedures described below. The owner of the lot on which facilities are located shall own and maintain the facilities as shown on the drawings.

Excess materials will be properly recycled or disposed of.

The approved facilities are to be permanent, and can only be removed or altered after approval by one or more of the following entities which may have jurisdiction: Upper Allen Township, and/or PA D.E.P. The tasks outlined herein shall be accomplished by the lot owner.

The following physical facilities shall be maintained to the original design and dimensions shown on the design plans approved by Upper All Township, until such time as an amended plan is approved by the Township:

- stormwater pipes;
- riprap aprons at pipe outlets;
- drain inlets, manholes and open pipe ends;
- stormwater MRC basin
- drainage easements associated with all of the above.

For any structural facility (pipe, inlet, manhole), it must be repaired or replaced if damaged more than superficially, in a way that is a safety hazard, if structurally unsound, or if not substantially performing as it is intended per the original design. The lot owner shall keep record of any repaired or replaced facility, including costs, dates, materials removed, materials placed, and the contractor(s) information.

Riprap Aprons Inspection and maintenance tasks --

- Inspect annually at a minimum. Remove any accumulated debris and trash, and remove promptly. Dislodged rock should be reset in place. Any scouring of earth at or below the apron should be re-stabilized with rock, or seeding (seed, mulch and matting), or sod that watered until established; rock should be placed in non-growing seasons, even if temporary.

Storm Pipes and Inlets Inspection and maintenance tasks --

- Examine annually at a minimum. Remove man-made trash and dispose of properly.
- Examine inlet bottoms via grates, for accumulated debris. Remove accumulated grit and other debris. Check for any obvious structure deterioration.
- Examine swales for obstructions and erosion. Any scouring of earth should be re-stabilized with rock, or seeding (seed, mulch and matting), or sod that is watered until established; rock should be placed in non-growing seasons, even if temporary.
- All inlets, storm piping, swales and drainage structures shall be kept free of any obstructions and foreign material that would cause disruption of water flow Man-made trash shall be disposed of properly in containers collected by a licensed commercial trash hauler.
- All impervious surfaces shall be maintained clean of oil, fuel or other toxic spills, in accordance with State, Federal or local regulations.

Drainage Easements Inspection and maintenance tasks --

- Inspect annually at a minimum.
- Notify the landowner if any obstructions or alteration of the ground surface interfere with the purpose and use of the easement, and request removal / correction of the problem.
- Examine any swales for obstructions and erosion. Any scouring of earth should be re-stabilized with rock, or seeding (seed, mulch and matting), or sod that is watered until established; rock should be placed in non-growing seasons, even if temporary.

Stormwater Infiltration Basin

- Inspect annually at a minimum.
- The bottom of the stormwater infiltration basin can be maintained as maintained meadow, or natural brush succession, per the desires and budget of the lot owner. The basin berms shall be maintained as meadow, being mowed once per year in the fall. Removal of sediment / debris shall take place when the basin bottom has dried, if possible. Man-made trash shall be disposed of properly in containers collected by a licensed commercial trash hauler.
- Examine for and clean out the outlet structure and trash rack, of accumulated trash, grit and the like.
- Remove grit, sand, soil or organic matter if it accumulates to a depth of 3" or more, so that storage volume is maintained
- Infiltration Basin. If standing water is present for greater than 72 hours after the last rainfall pump out the basin to perform the following remediation:
  - Remove 10" below the proposed basin bottom, replace with a 2:1 soil to compost mix and till up to 20".
  - If further problems persist contact Cumberland County Conservation District and/or Upper Allen for a suitable solution.

SWM DETAILS

FOR  
2509 MILL ROAD TOWNHOMES  
LOCATED IN  
UPPER ALLEN TOWNSHIP, CUMBERLAND COUNTY, PA

DRAWING ID:  
221013-3-LD  
PROJECT: 221013  
DATE: 04/25/2022  
SHEET:

14 OF 18

R. J. FISHER & ASSOCIATES, INC.

SITE PLANNING ▫ CIVIL ENGINEERING ▫ LAND SURVEYS

1546 BRIDGE STREET, NEW CUMBERLAND, PA. 17070

PHONE: (717) 774-7534 ▫ FAX: (717) 774-7190

RJFISHERENGINEERING.COM










Associates, Inc.

FISHER

NO.	REVISION	DATE
1	—	—
2	—	—
3	—	—
4	—	—
5	—	—

COPYRIGHT © 2021 BY R.J. FISHER & ASSOCIATES, INC.



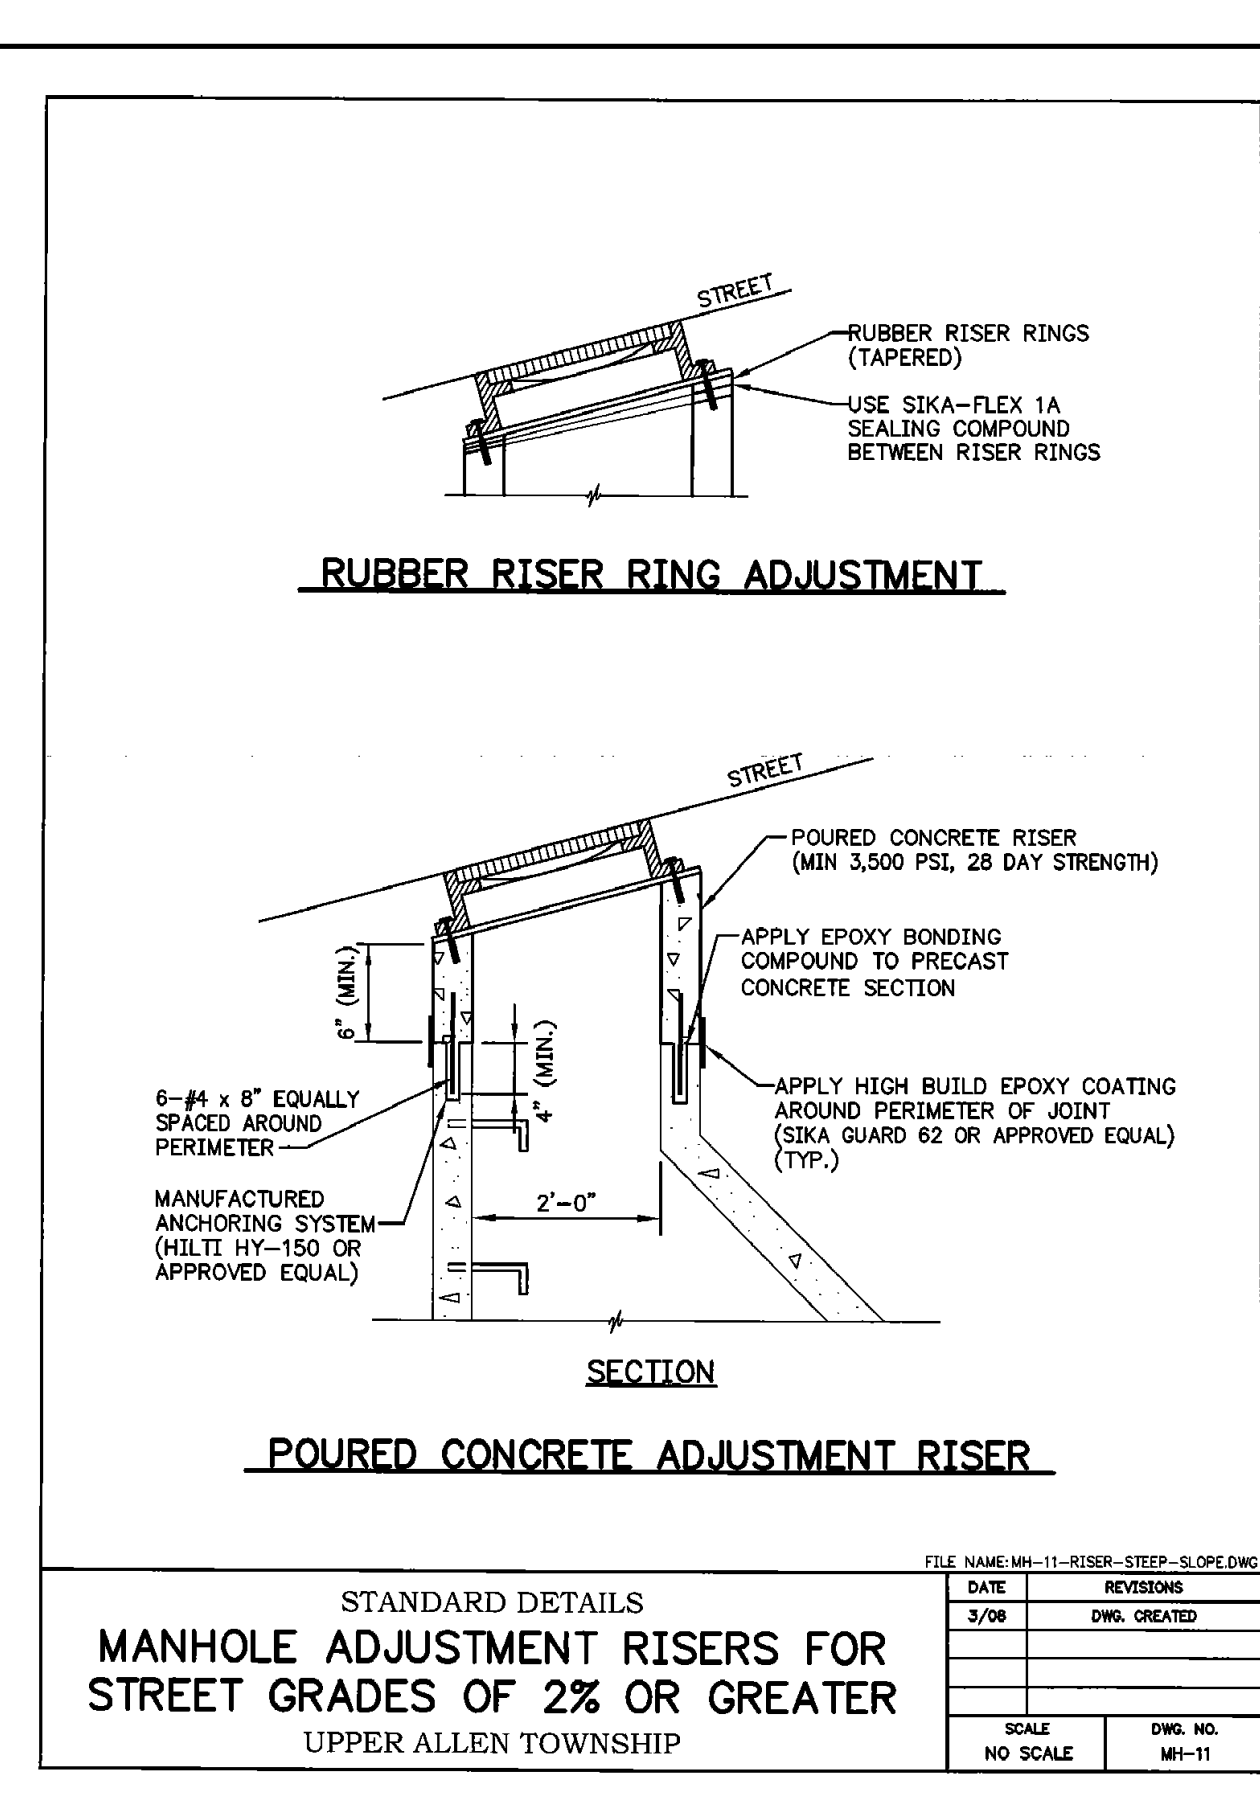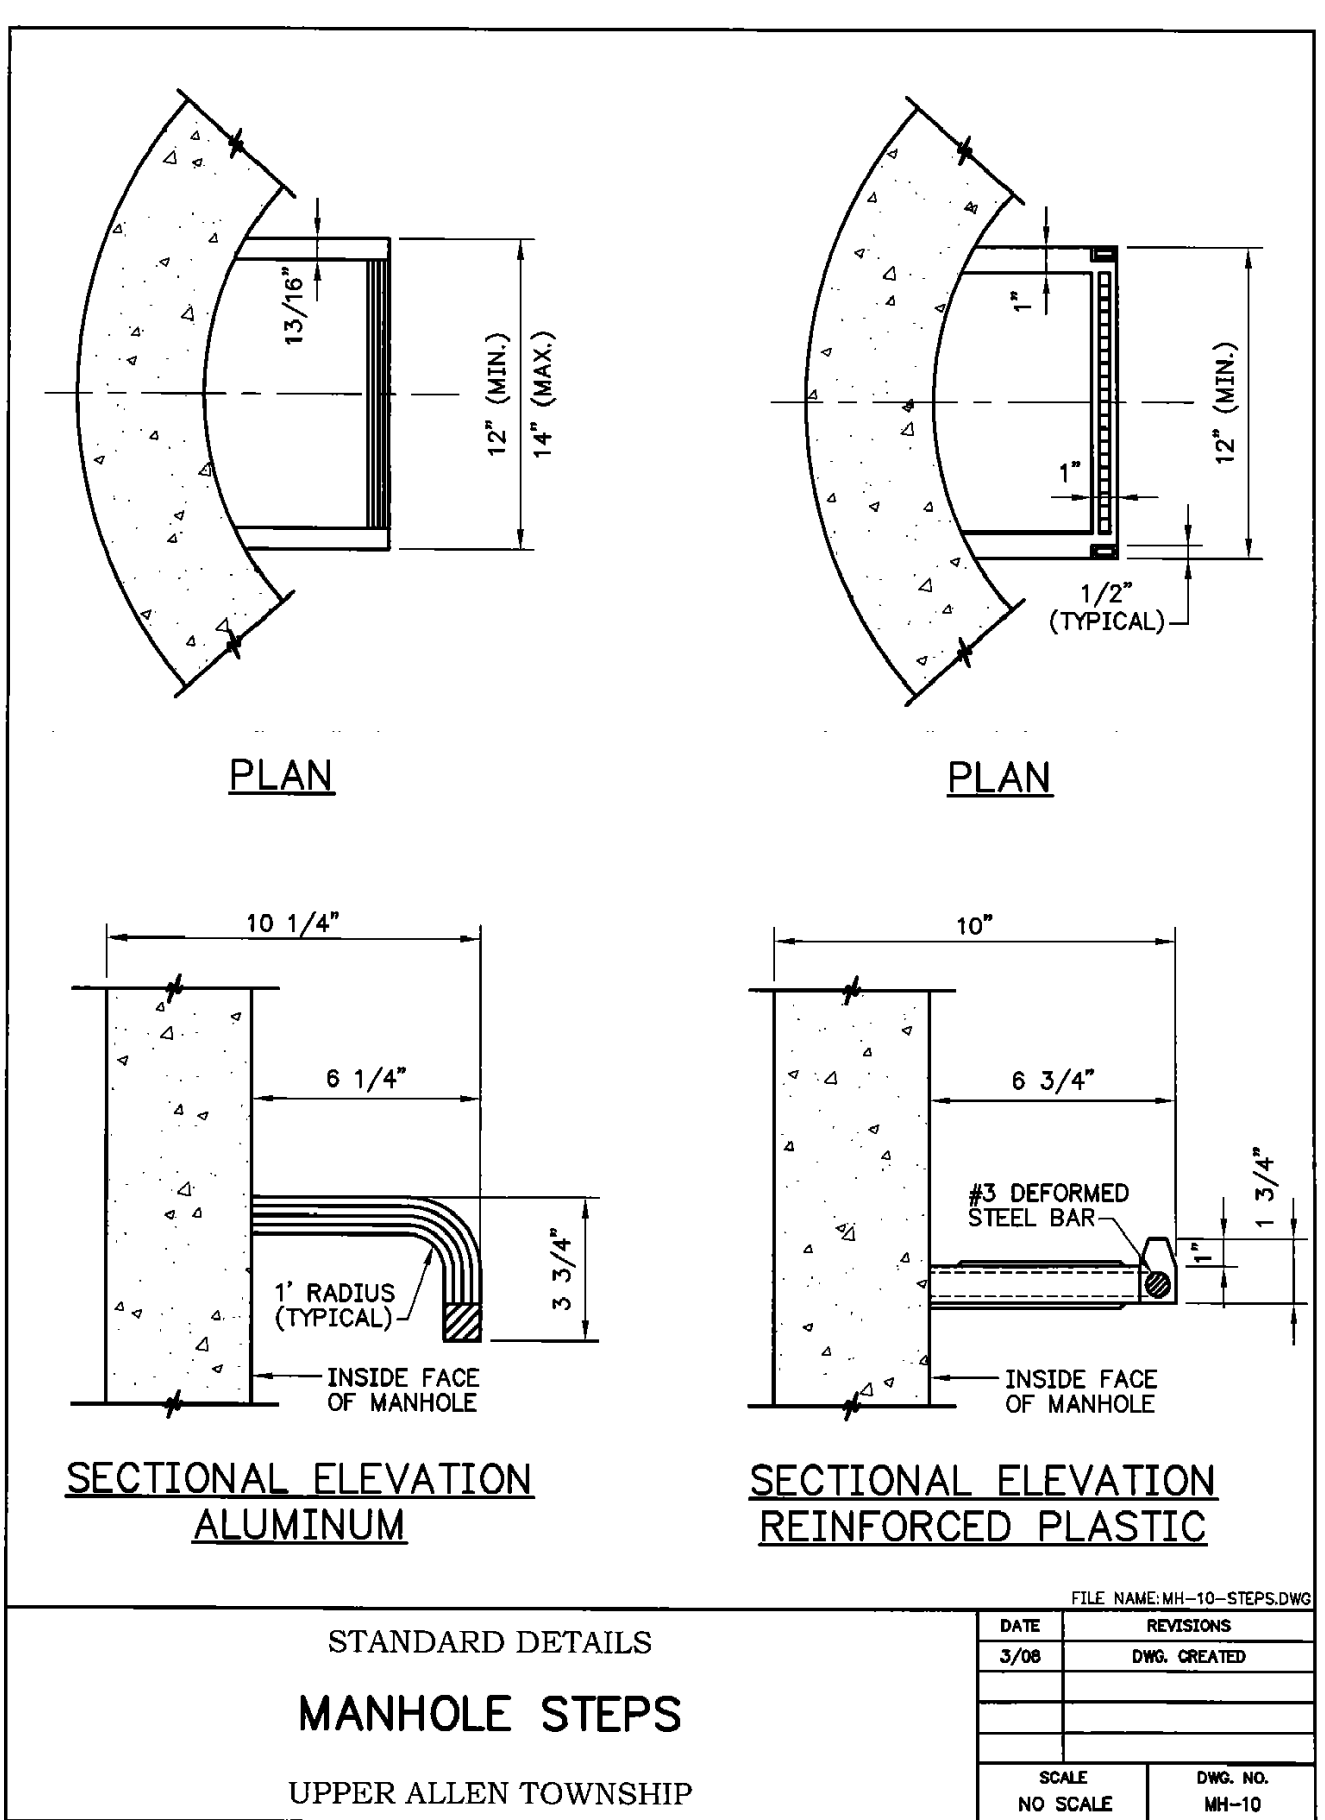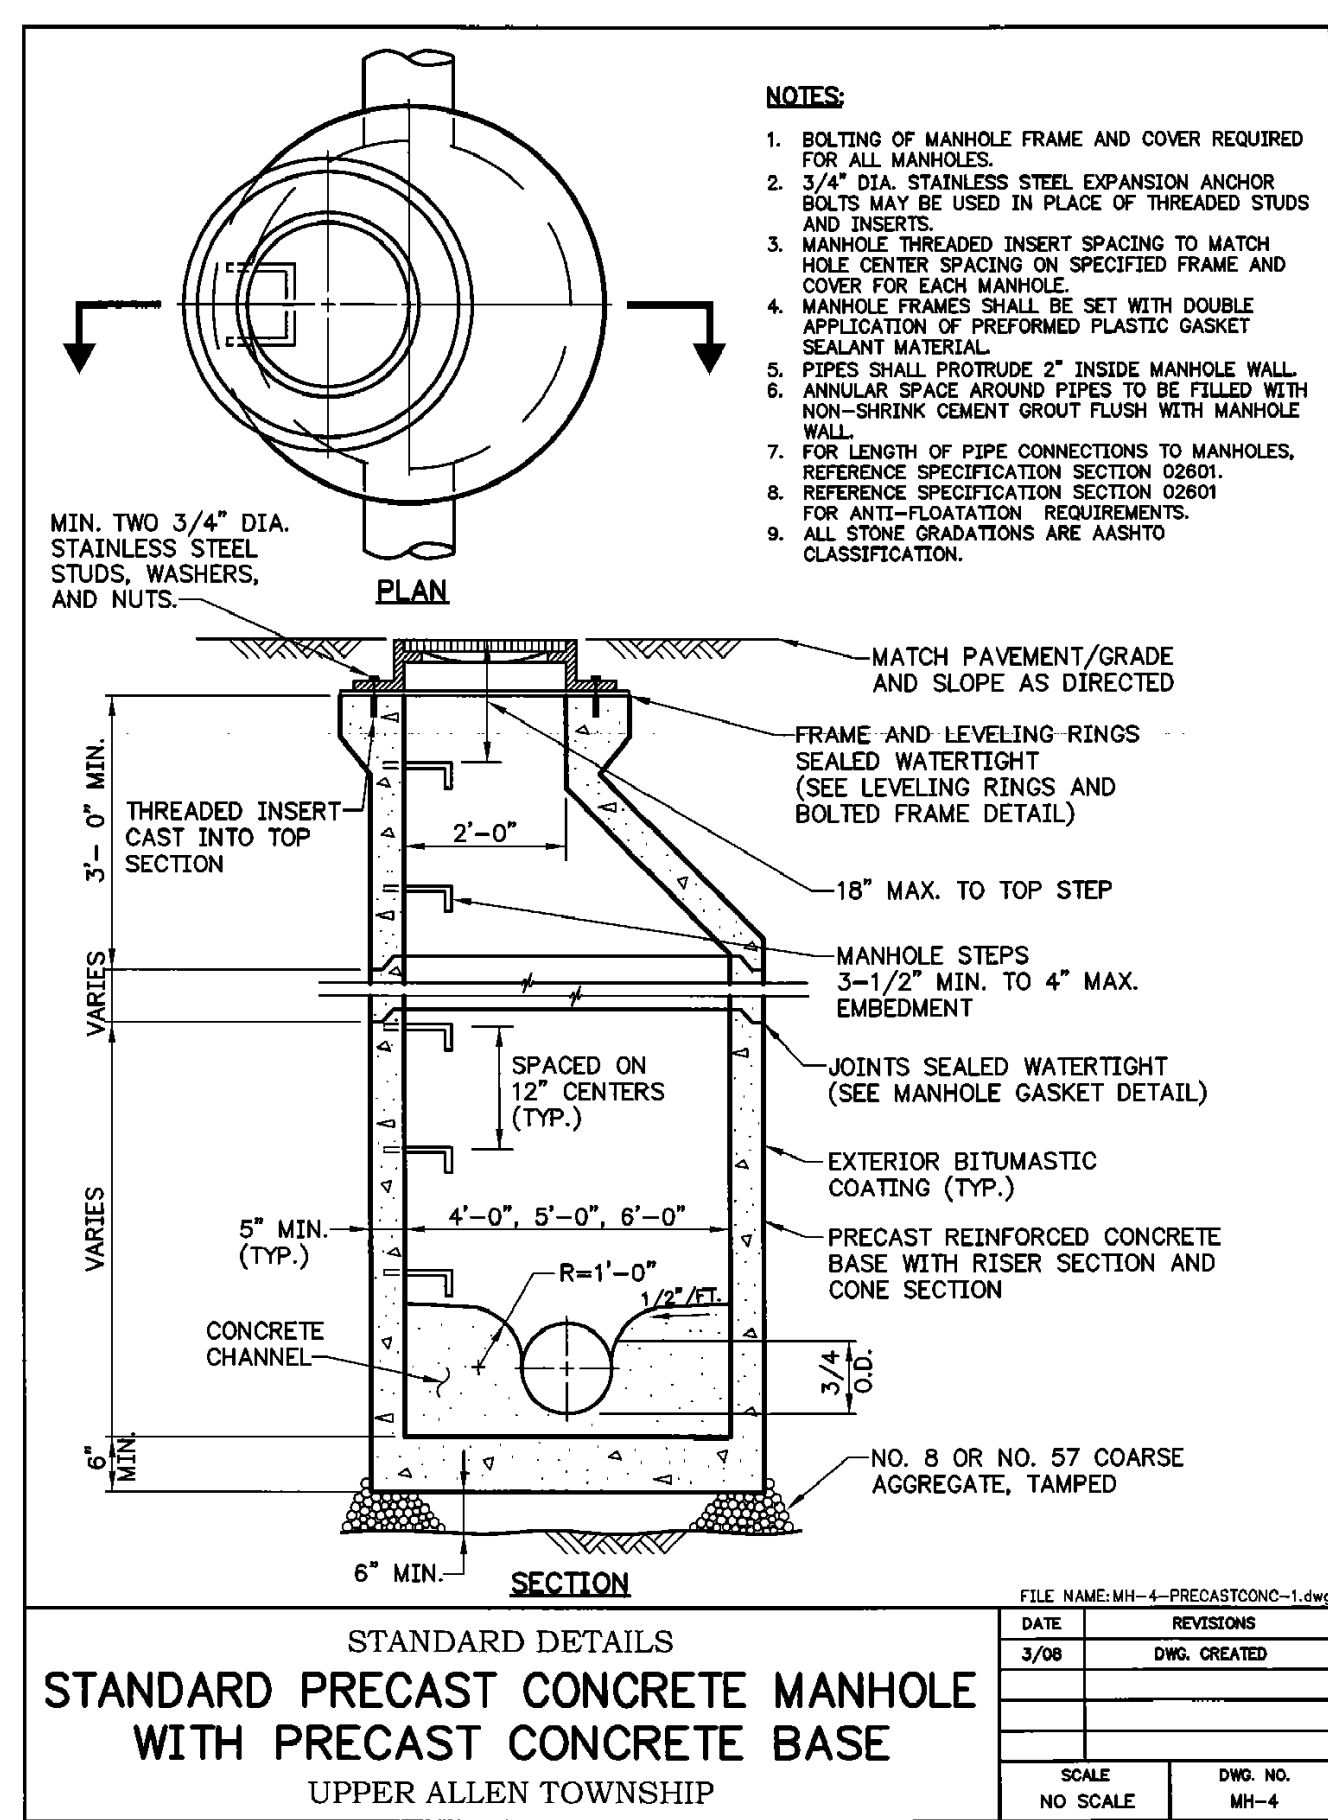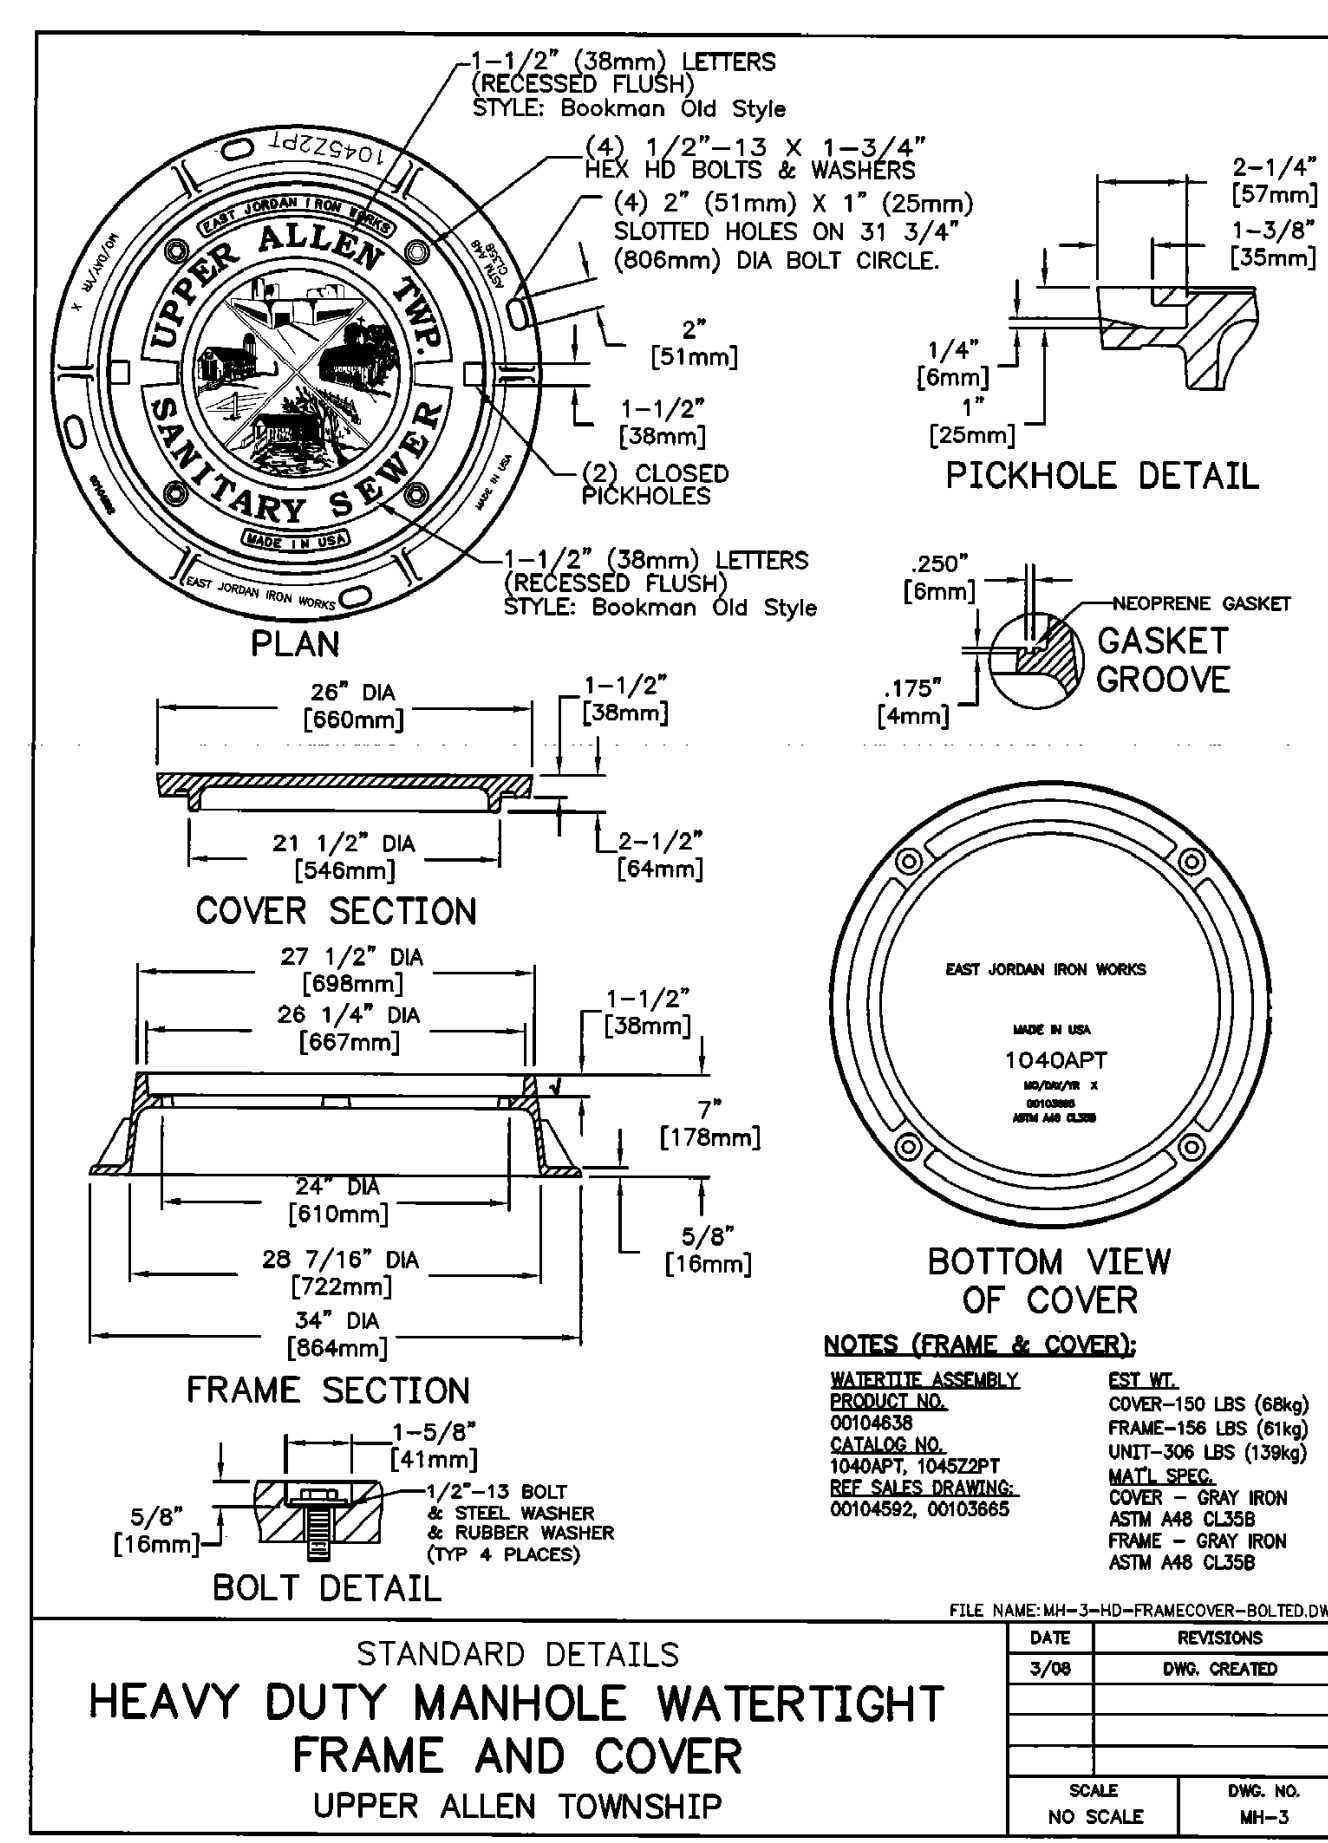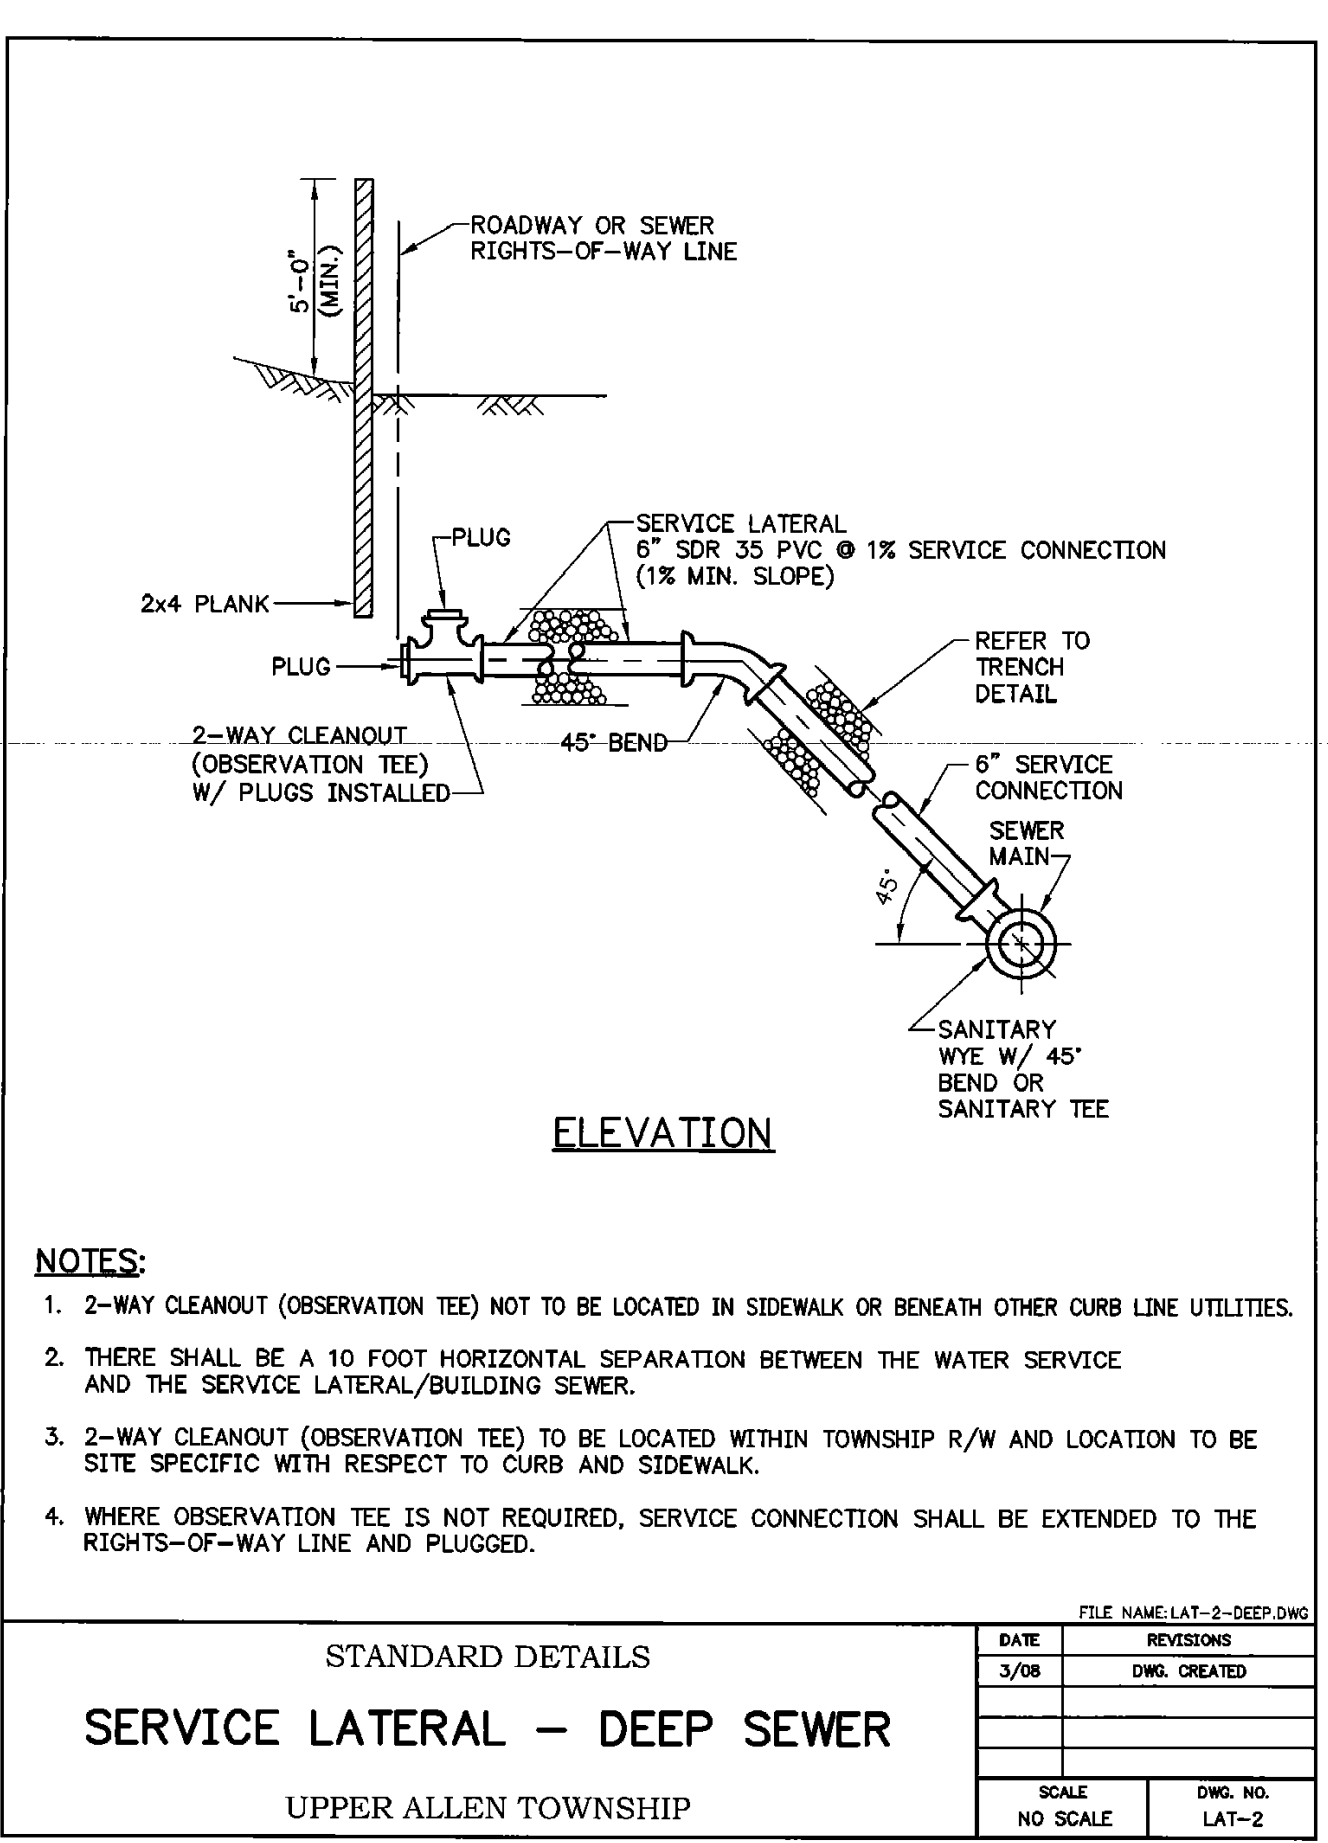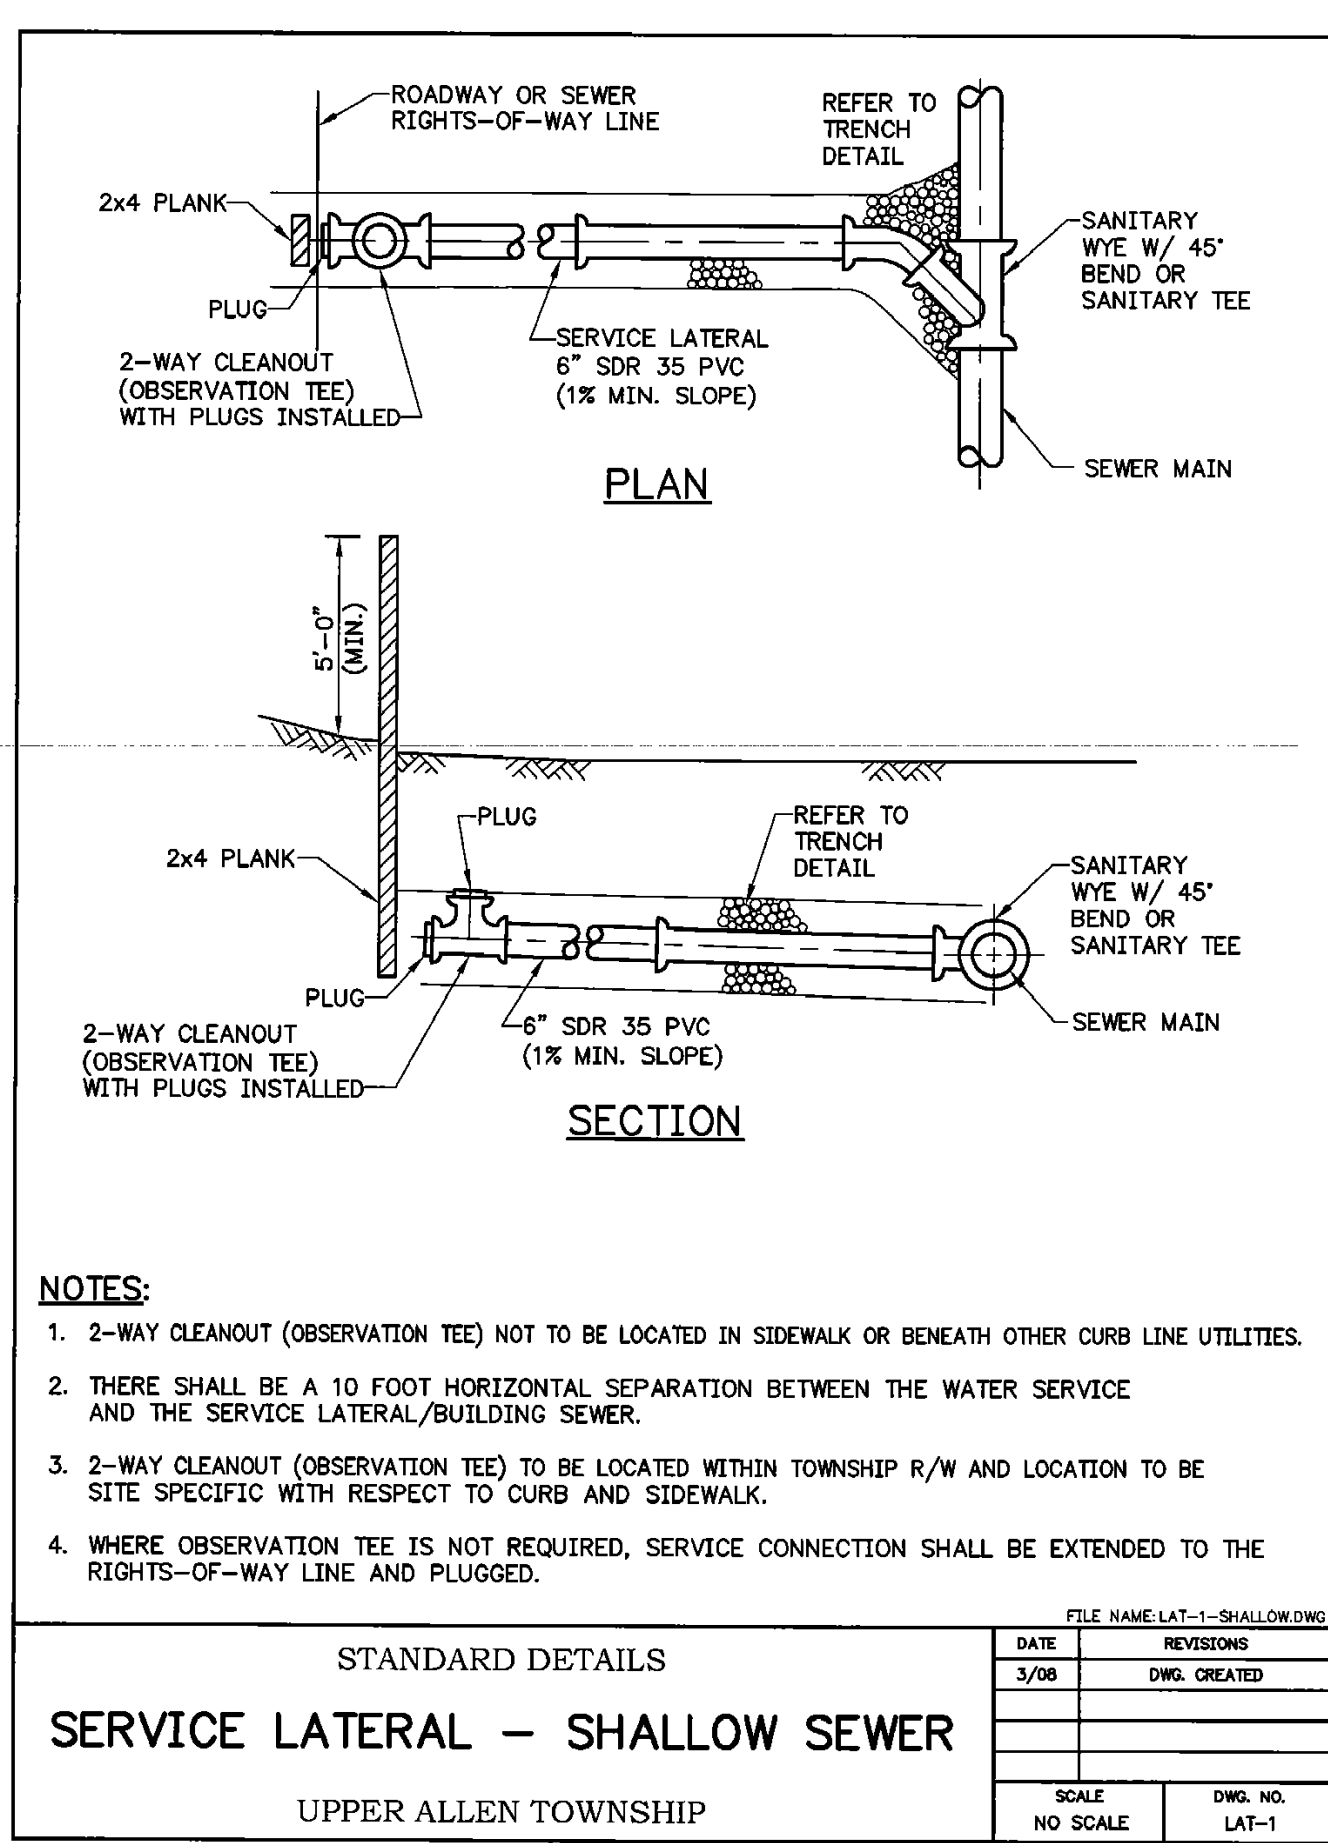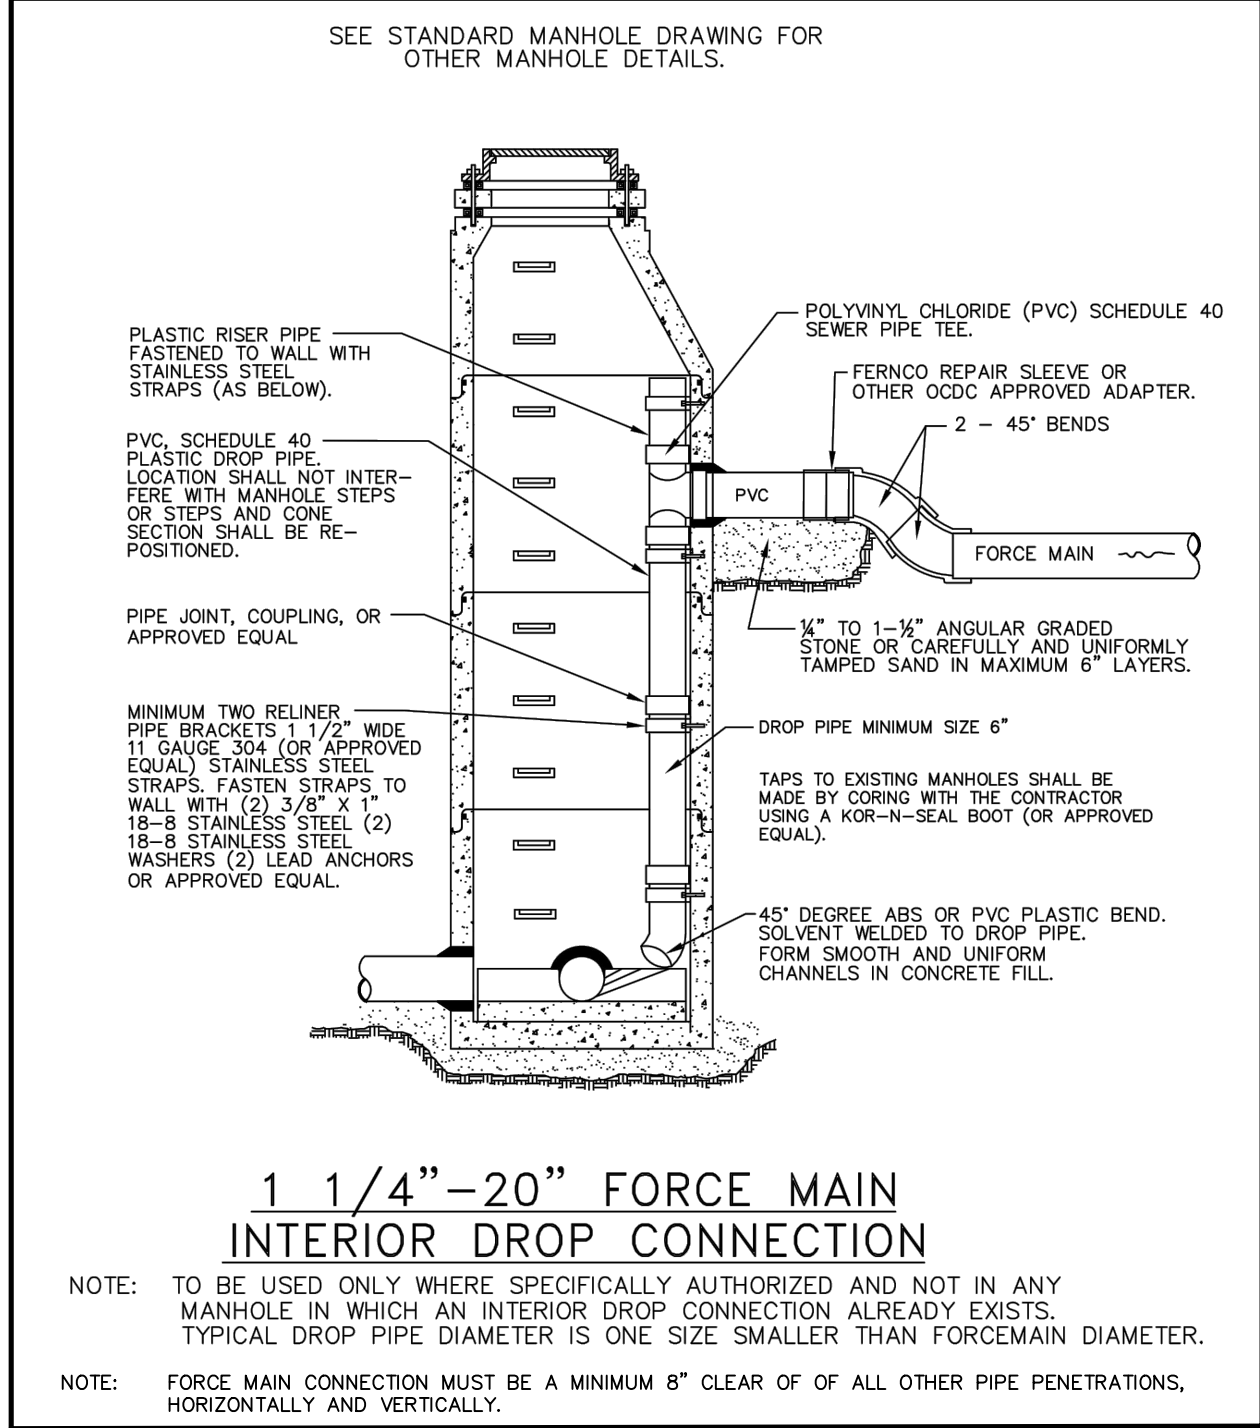


**R. J. FISHER & ASSOCIATES, INC.**  
SITE PLANNING & CIVIL ENGINEERING & LAND SURVEYS  
1546 BRIDGE STREET, NEW CUMBERLAND, PA. 17070  
PHONE: (717) 774-7534 • FAX: (717) 774-7190  
**RJFISHERENGINEERING.COM**



**UTILITY DETAILS**  
FOR  
**2509 MILL ROAD TOWNHOMES**  
LOCATED IN  
UPPER ALLEN TOWNSHIP, CUMBERLAND COUNTY, PA

DRAWING ID: 221013-3-LD  
PROJECT: 221013  
DATE: 04/25/2022  
SHEET: 15 OF 18




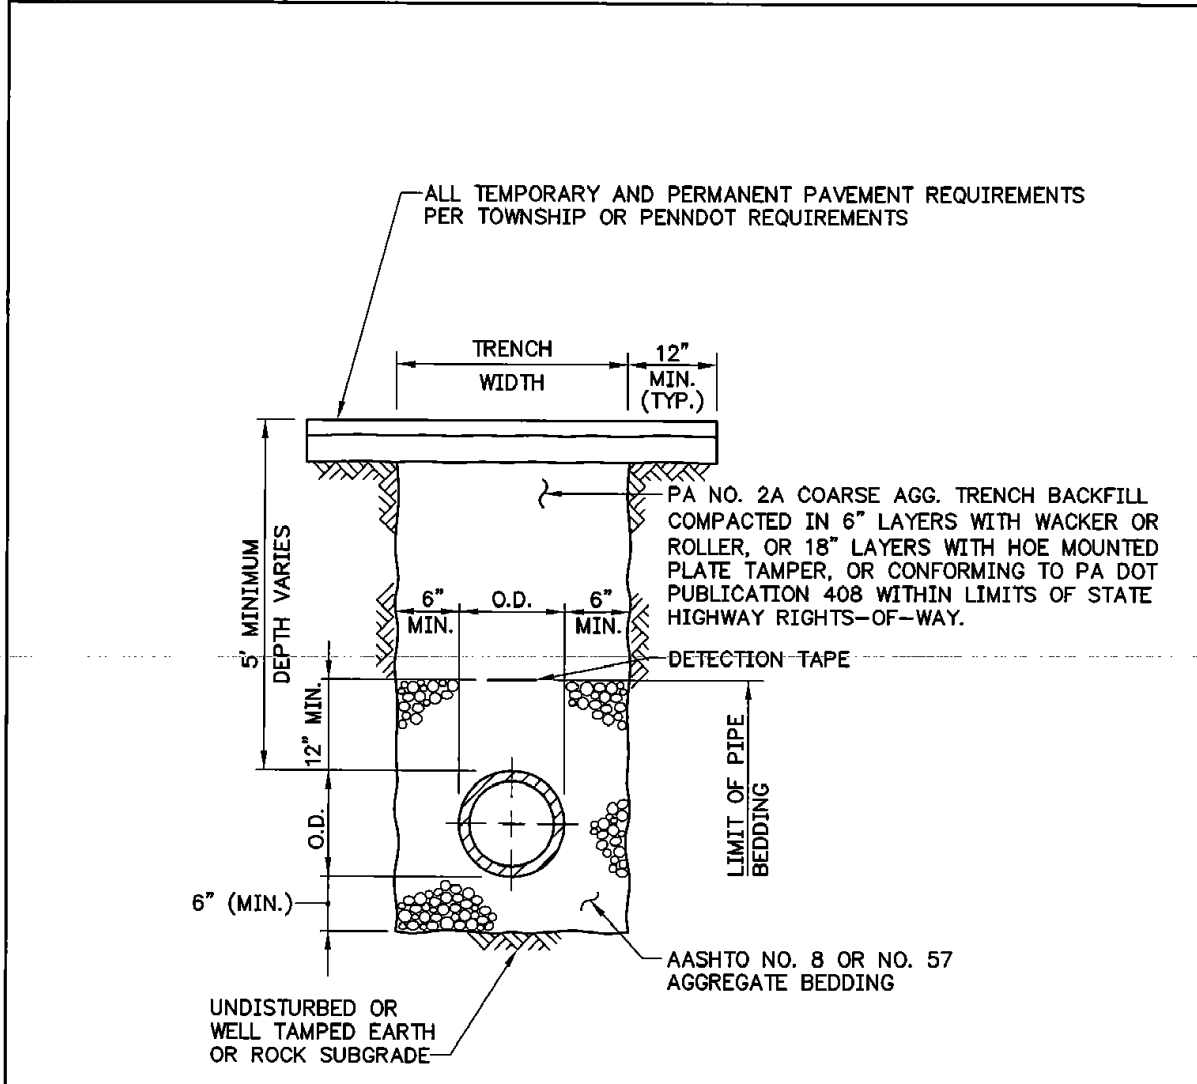

- NOTE:**
- BACKFILL AND COMPACTION REQUIREMENT APPLIES TO PAVED ROADWAYS AND SHOULDERS OF PROPOSED AND EXISTING STREETS (OTHER THAN STATE HIGHWAYS), PAVED DRIVEWAYS, AND SIDEWALKS.

STANDARD DETAILS  
TRENCH BACKFILL DETAIL  
IN PAVED AREAS  
UPPER ALLEN TOWNSHIP

FILE NAME: TRENCH-1-PAVED.DWG	
DATE	REVISIONS
3/08	DWG. CREATED
SCALE	DWG. NO.
NO SCALE	TR-1

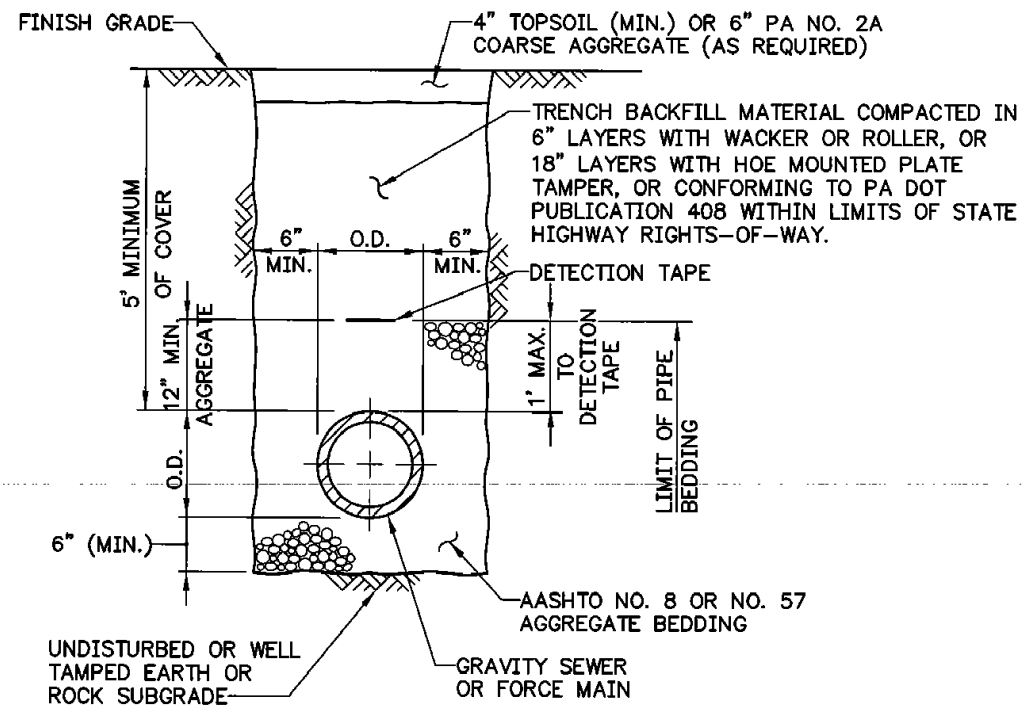


**BACKFILLING REQUIREMENTS:**



- UNPAVED AREAS OUTSIDE ROADWAYS – SUITABLE ON-SITE BACKFILL COMPACTED AS INDICATED ABOVE TO BOTTOM OF TOPSOIL. REPLACE TOPSOIL TO APPROXIMATE DEPTH OF EXISTING OR MIN. 4".
- UNPAVED AREAS WITHIN R/W LIMITS OF STATE HIGHWAYS – CONFORMING TO REQUIREMENTS OF PA DOT PUBLICATION 408.
- UNPAVED SHOULDERS OF PROPOSED AND EXISTING STREETS OTHER THAN STATE HIGHWAYS – AGGREGATE BACKFILL COMPACTED AS INDICATED ABOVE.
- STONE DRIVEWAYS AND PARKING AREAS – SUITABLE ON-SITE BACKFILL COMPACTED AS INDICATED ABOVE.
- UNIMPROVED STREETS – AGGREGATE BACKFILL COMPACTED AS INDICATED ABOVE.

STANDARD DETAILS  
TRENCH BACKFILL DETAIL  
IN UNPAVED AREAS  
UPPER ALLEN TOWNSHIP

FILE NAME: TRENCH-2-UNPAVED.DWG	
DATE	REVISIONS
3/08	DWG. CREATED
SCALE	DWG. NO.
NO SCALE	TR-2

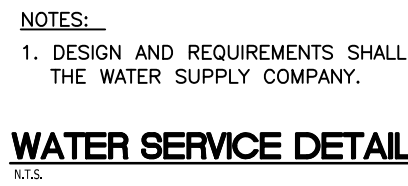

- NOTES:**
- DESIGN AND REQUIREMENTS SHALL BE PER THE WATER SUPPLY COMPANY.

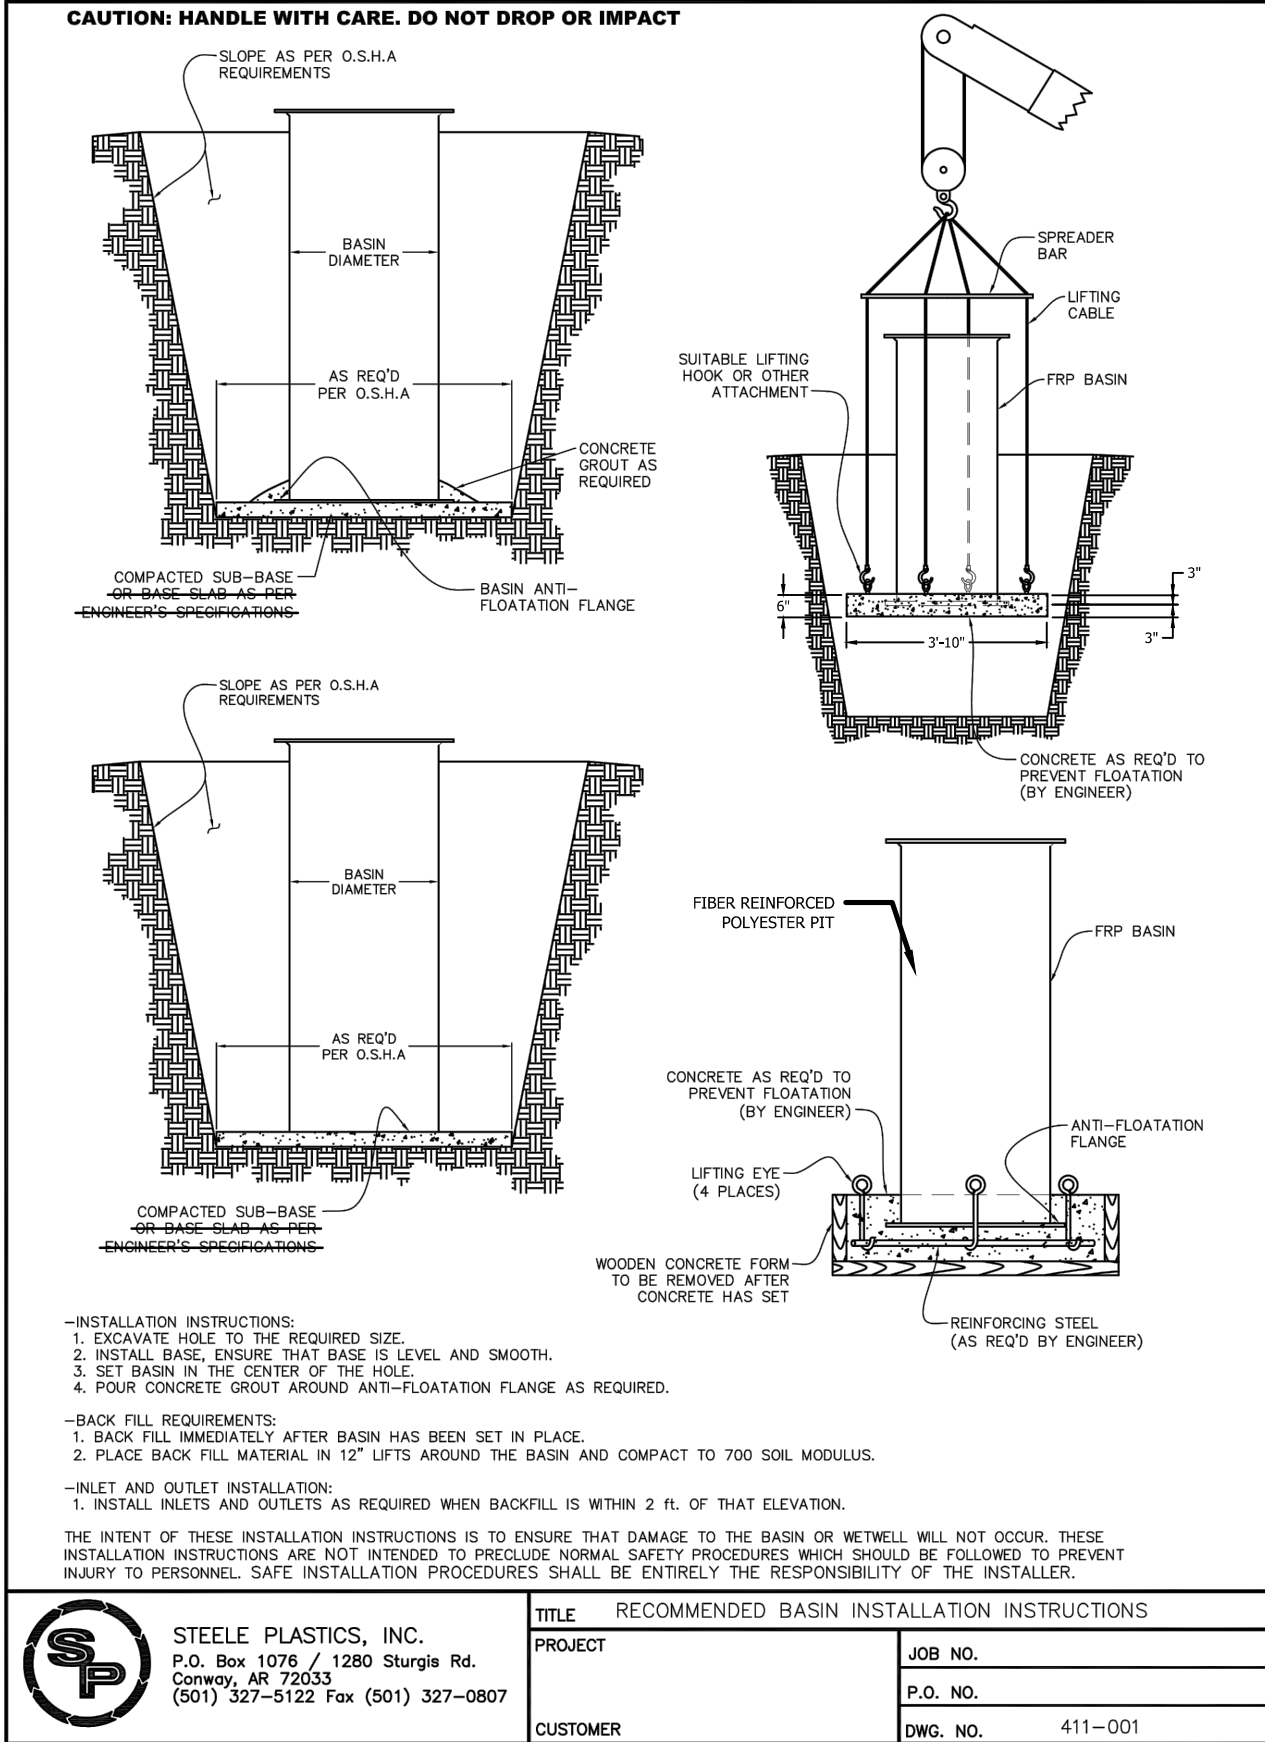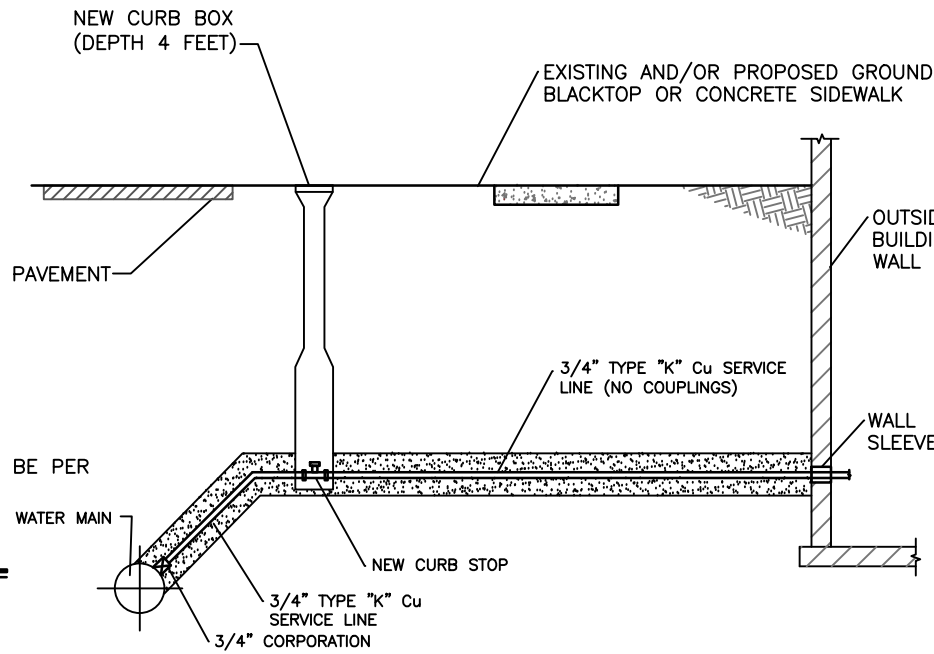


STEELE PLASTICS, INC.		TITLE: RECOMMENDED BASIN INSTALLATION INSTRUCTIONS	
P.O. Box 1078 / 1880 Shingle Rd.	PROJECT	JOB NO.	
Cornwray, AR 72633	P.O. NO.	DWG. NO.	411-001
(501) 327-5122 Fax (501) 327-0807	CUSTOMER		

**R. J. FISHER & ASSOCIATES, INC.**  
SITE PLANNING & CIVIL ENGINEERING & LAND SURVEYS  
1546 BRIDGE STREET, NEW CUMBERLAND, PA. 17070  
PHONE: (717) 774-7534 & FAX: (717) 774-7190  
RJFISHERENGINEERING.COM



**UTILITY DETAILS**  
FOR  
**2509 MILL ROAD TOWNHOMES**  
LOCATED IN  
UPPER ALLEN TOWNSHIP, CUMBERLAND COUNTY, PA

DRAWING ID: 221013-LD  
PROJECT: 221013  
DATE: 04/25/2022  
SHEET: 16 OF 18

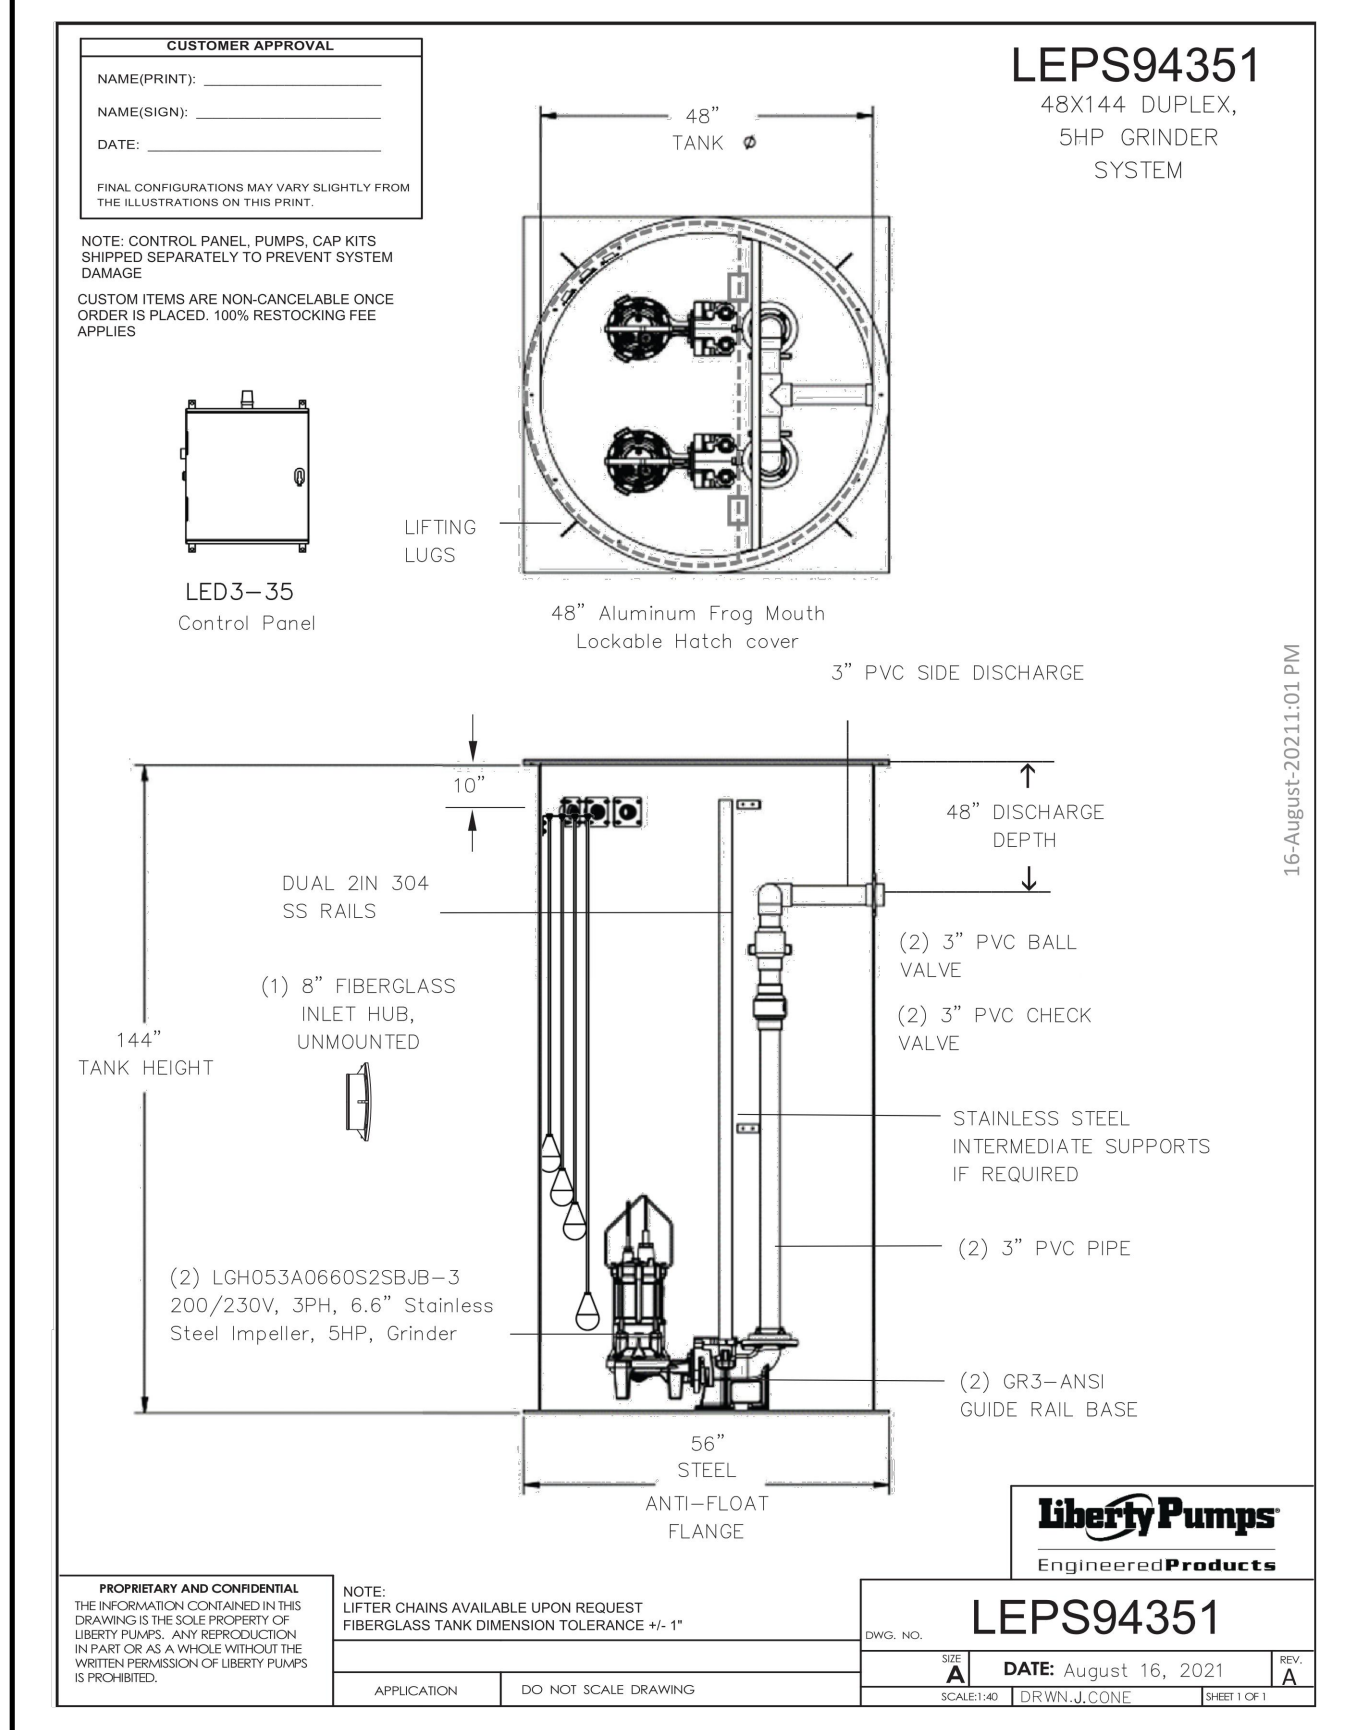

**Liberty Pumps**  
Engineered Products

**LES-Series Simplex Controls**  
**LED-Series Duplex Controls**  
**Control Panels**



Available in fiberglass or stainless steel enclosures  
Wide array of options and custom builds available

- Hand-Off-Auto switches
- Pump run lights
- Inner panel door
- Elapsed time meters
- Auxiliary contacts
- Seal test and fail indicators
- Lockable door
- Adjustable motor overloads
- Thermal overloads
- Alarm beacon
- NEMA@ 4X enclosure
- Intrinsically safe panels available









Proudly engineered and built in the USA

3 Phase									
Fiberglass Enclosure					Stainless Steel Enclosure				
Voltage	Overload	Breaker	Duplex I.S.	Simplex I.S.	Duplex I.S.	Duplex	Simplex I.S.	Simplex	
45-18	20		LEDK3-20	LED3-20	LEDK3-20	LEDK3-20	LEDK3-20	LEDK3-20	LESS3-20
8-32	35		LEDK3-35	LED3-35	LEDK3-35	LEDK3-35	LEDK3-35	LEDK3-35	LESS3-35
30-40	40		LEDK3-40	LED3-40	LEDK3-40	LEDK3-40	LEDK3-40	LEDK3-40	LESS3-40
37-50	50		LEDK3-50	LED3-50	LEDK3-50	LEDK3-50	LEDK3-50	LEDK3-50	LESS3-50
48-65	65		LEDK3-65	LED3-65	LEDK3-65	LEDK3-65	LEDK3-65	LEDK3-65	LESS3-65



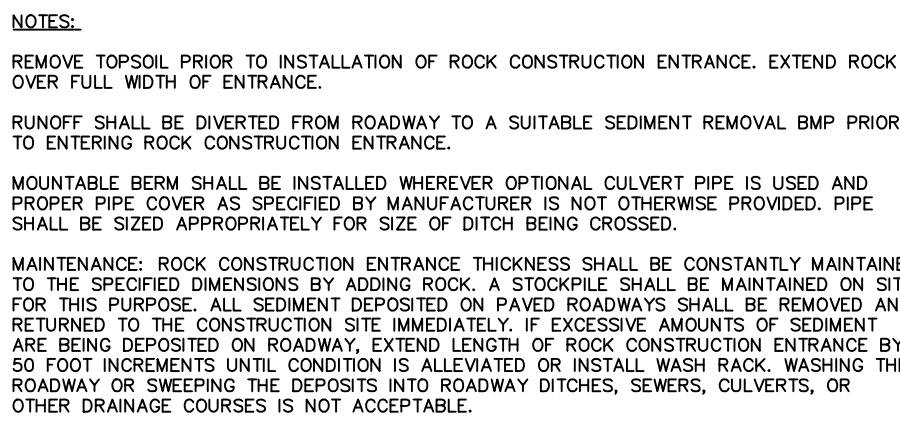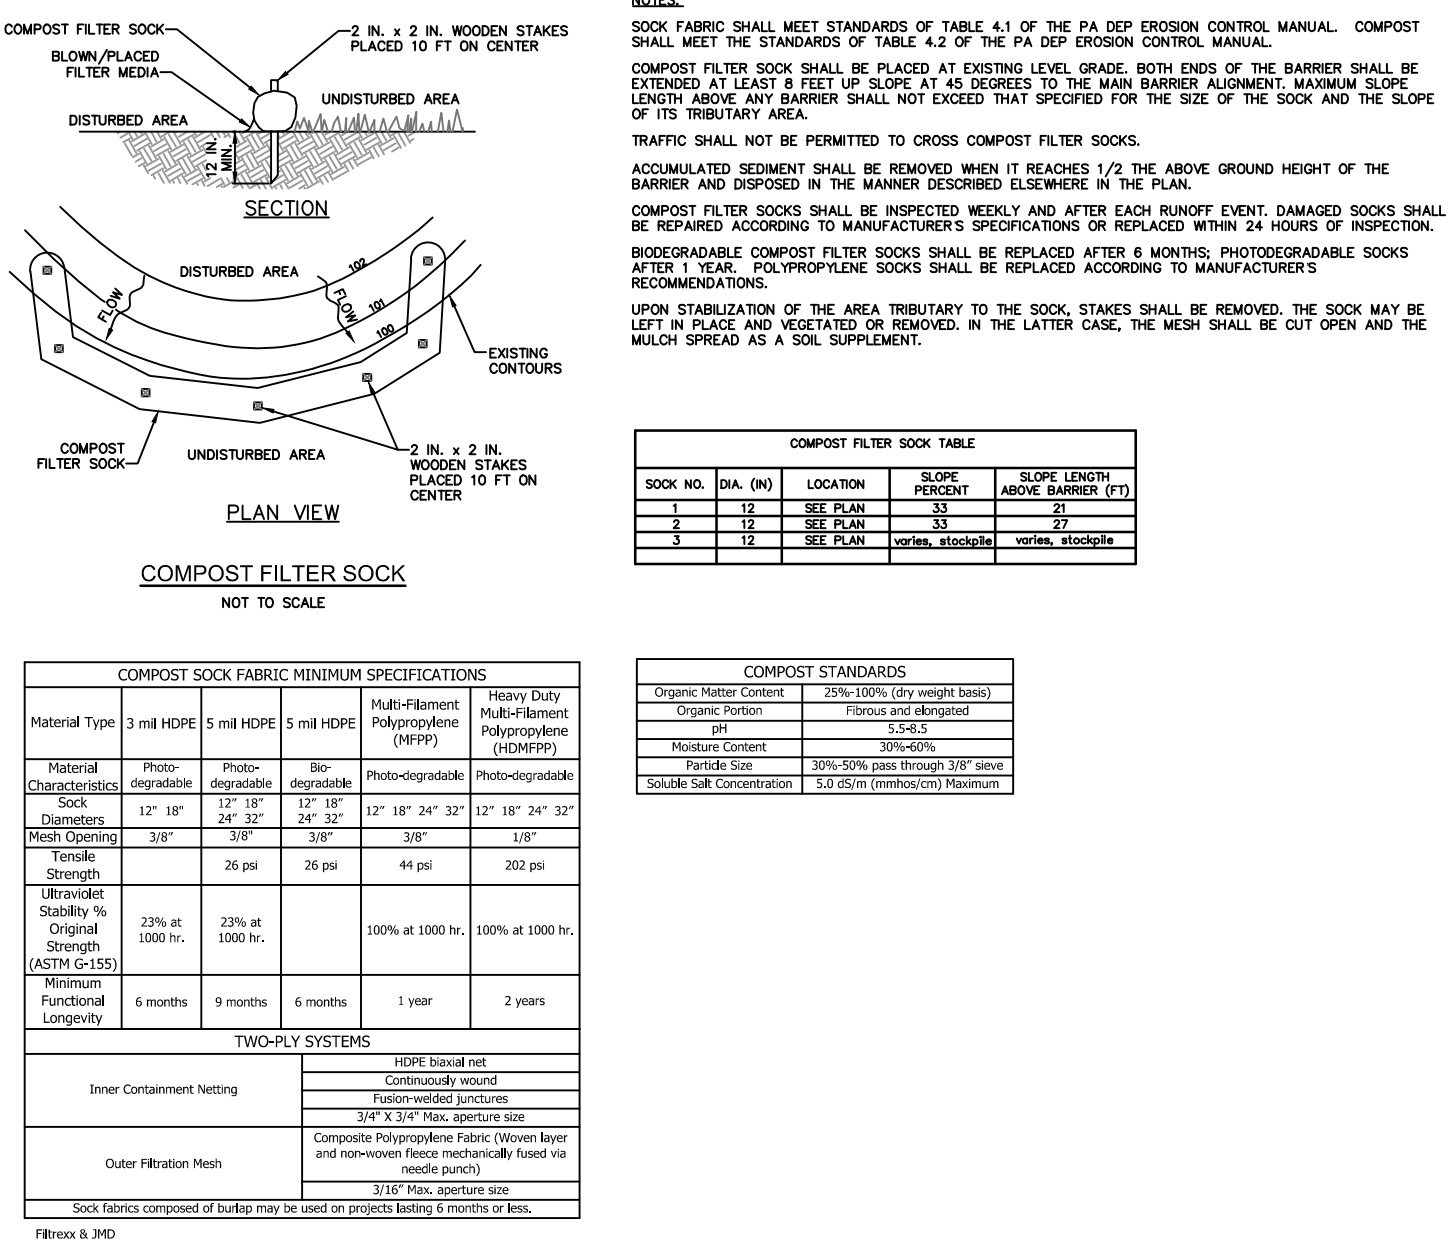

TURBIDITY BARRIER  
NOT TO SCALE

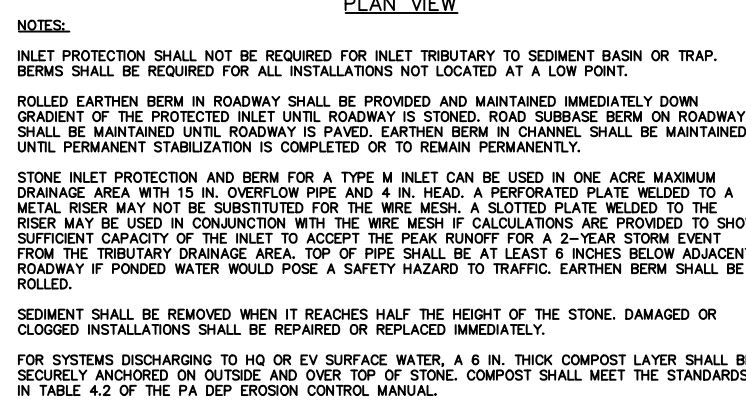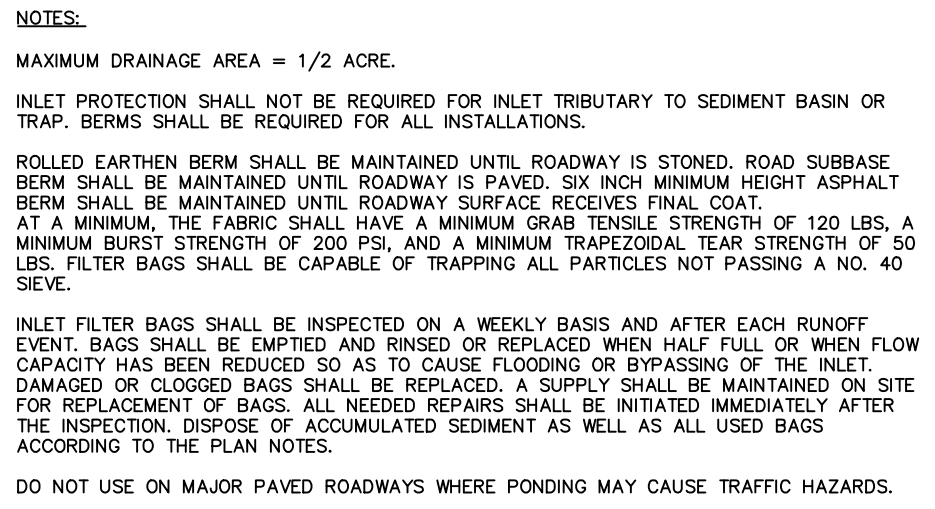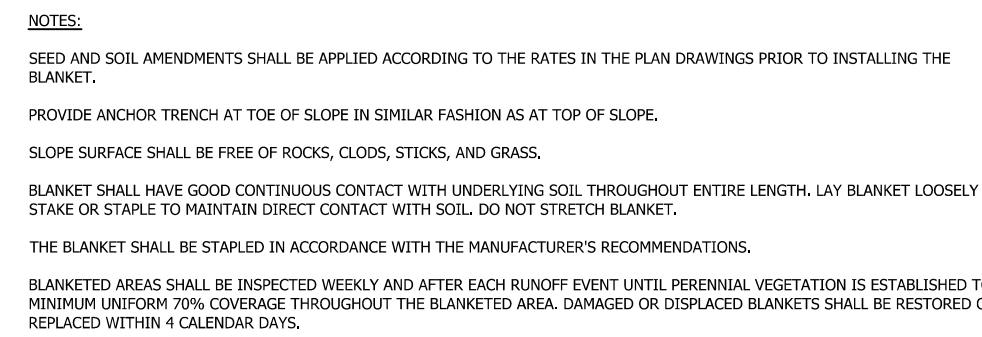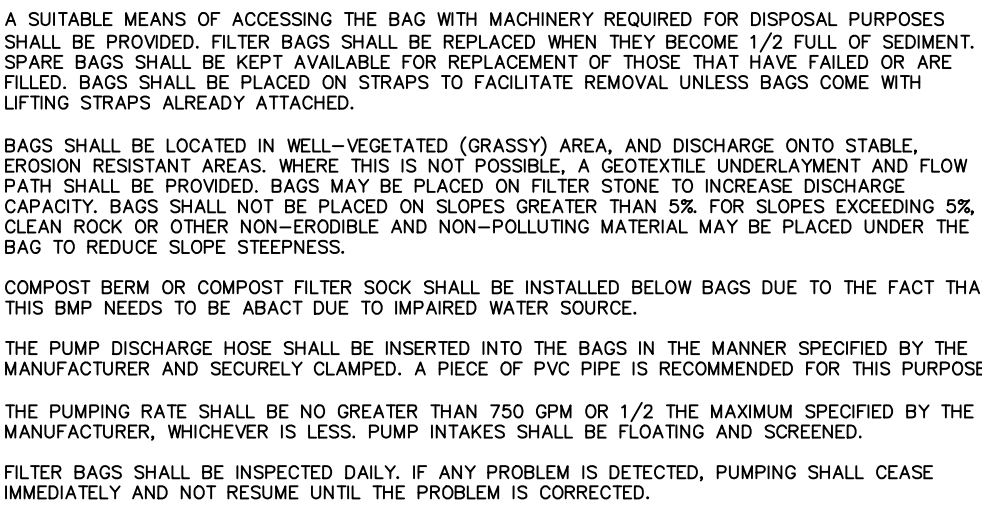

**R. J. FISHER & ASSOCIATES, INC.**  
SITE PLANNING ■ CIVIL ENGINEERING ■ LAND SURVEYS  
1546 BRIDGE STREET, NEW CUMBERLAND, PA. 17070  
PHONE: (717) 774-7534 ■ FAX: (717) 774-7190  
**RJFISHERENGINEERING.COM**



**E&S CONTROL DETAILS**  
FOR  
**25509 MILL ROAD TOWNHOMES**  
LOCATED IN  
UPPER ALLEN TOWNSHIP, CUMBERLAND COUNTY, PA

DRAWING ID:	221013-3-LD
PROJECT:	221013
DATE:	04/25/2022
SHEET:	17 OF 18



GENERAL NOTES

1. The site contractor and their designees shall familiarize themselves with this Erosion Control Plan. The site contractor shall be responsible for implementation of this Erosion Control Plan.
2. The site contractor shall not disturb more area than is necessary for the task to be done, so that potential for erosion is minimized.
3. The site contractor shall ensure that earth disturbance activities are planned and implemented to the extent practicable in accordance with the following:
- a. Minimize the extent and duration of the earth disturbance.
  - b. Maximize protection of existing drainage features and vegetation.
  - c. Minimize soil compaction.
  - d. Utilize other measures or controls that prevent or minimize the generation of increased stormwater runoff.
4. Erosion and sedimentation controls must be constructed, stabilized, and functional before site disturbance within the tributary areas to the controls.
5. A copy of the approved Erosion and Sediment Control Plan / Drawings (stamped, signed and dated by the reviewing agency) must be available at the project site at all times.
6. At least 7 days prior to starting any earth disturbance activities, or expanding into an area previously unmarked, the owner and/or operator shall invite all contractors involved in those activities, the landowner, appropriate municipal officials, the erosion control plan preparer, the post construction plan preparer, and a representative of the County Conservation District to an on-site pre-construction meeting.
7. At least 3 days before starting any earth disturbance activities, or expanding into an area previously unmarked, all contractors involved in those activities shall notify the Pennsylvania One Call System incorporated at 1-800-242-1776 for the location of existing underground utilities.
8. All earth disturbance activities shall proceed in accordance with the sequence provided on the plan drawings. Deviation from that sequence must be approved in writing from the County Conservation District prior to implementation.
9. Clearing, grubbing, and topsoil stripping shall be limited to those areas described in each stage of the construction sequence. General site clearing, grubbing and topsoil stripping may not commence in any stage or phase of the project until the E & S BMPs specified by the Construction Sequence for that stage or phase have been installed and are functioning as described in this document.
10. At no time shall construction vehicles be allowed to enter areas outside the limit of disturbance boundaries shown on the plan maps. These areas must be clearly marked and fenced off before clearing and grubbing operation begin.
11. Topsoil stockpile heights shall not exceed 35 feet. Stockpile side slopes must be 2:1 or flatter.
12. Immediately upon discovering unforeseen circumstances posing the potential for accelerated erosion and/or sediment pollution, the operator shall implement appropriate best management practices (BMPs) to minimize the potential for erosion and sediment pollution, and notify the local Conservation District and/or the regional office of PA DEP.
13. Solids, trash and other pollutants shall be disposed in accordance with federal and state regulations in order to prevent any pollutant in such materials from adversely affecting the environment. All building materials and wastes must be removed from the site and recycled or disposed in accordance with the Department of Environmental Protection's Solid Waste Management regulations at 25 Pa. Code 260, 260.1 et seq., 271.1, and 287.1 et seq. No building materials or wastes or unused building materials shall be burned, buried, dumped, or discharged at the site.
14. All off-site waste and borrow areas must have an E & S Plan approved by the Conservation District or DEP, and fully implemented prior to being activated.
15. The contractor is responsible for ensuring that any material brought onto the site is Clean Fill. Form FP-001 must be retained by the property owner for any fill material affected by a spill or release of a regulated substance but qualifying as Clean Fill due to analytical testing.
16. All pumping of water from any work area shall be done according to the procedure described in this plan, over undisturbed vegetated areas.
17. Areas which are to be topsoiled shall be scarified to a minimum depth of 4 inches prior to placement of topsoil. Areas to be vegetated shall have a minimum 4 inches of topsoil in place prior to seeding and mulching. Fill outcrops shall have a minimum of 2 inches of topsoil.
18. All fills shall be compacted as required to reduce erosion, slippage, settlement, subsidence or other related problems. Fill intended to support buildings, structures, conduits, etc. shall be compacted in accordance with local requirements or codes. All fills shall be placed in compacted layers not to exceed 9 inches in thickness. Fill materials shall be free of frozen particles, brush, roots, sod, or other foreign or objectionable materials that would interfere with or prevent construction of satisfactory fills. Frozen materials or soft, mucky, or highly compressible materials shall not be incorporated into fills. Fill shall not be placed on saturated or frozen surfaces.
19. Seeps or springs encountered during construction shall be handled in accordance with the standard and specification for subsurface drain or other approved method.
20. All graded areas shall be permanently stabilized immediately upon reaching finished grade. Cut slopes in competent bedrock and rock fills need not be vegetated.
21. Immediately after earth disturbance activities cease in any area or subarea of the project, the operator shall stabilize all disturbed areas. During non-germinating months, mulch or protective blanketing shall be applied as described in the plan. Areas not at finished grade, which will be reactivated within 1 year, may be stabilized in accordance with the temporary stabilization specifications. Those areas which will not be reactivated within 1 year shall be stabilized in accordance with the permanent stabilization specifications.
22. Permanent stabilization is defined as a minimum uniform, perennial 70% vegetative cover or other permanent non-vegetative cover with a density sufficient to resist accelerated erosion. Cut and fill slopes shall be capable of resisting failure due to slumping, sliding, or other movements.
23. All E & S BMPs must remain functional as such until all areas tributary to them are permanently stabilized or until they are replaced by another BMP approved by the Conservation District or PA DEP.
24. Upon completion of all earth disturbance activities and permanent stabilization of all disturbed areas, the owner and / or operator shall contact the Conservation District for an inspection prior to removal / conversion of the E & S BMPs.
25. After final site stabilization has been achieved, temporary E & S BMPs must be removed or converted to permanent post construction stormwater management BMPs. Areas disturbed during removal or conversion of the BMPs must be stabilized immediately. In order to ensure rapid revegetation of disturbed areas, such removal / conversions should be done only during the germinating season.
26. Upon completion of all earth disturbance activities and permanent stabilization of all disturbed areas, the owner and / or operator shall contact the Conservation District to schedule a final inspection.
27. Failure to correctly install E & S BMPs, failure to prevent sediment-laden runoff from leaving the construction site, or failure to take immediate corrective action to resolve failure of E & S BMPs may result in administrative, civil, and/or criminal penalties being instituted by the Pennsylvania Department of Environmental Protection as defined in Section 602 of the Pennsylvania Clean Streams law. The Clean Streams law provides for up to \$10,000 per day in civil penalties, up to \$10,000 in summary criminal penalties, and up to \$25,000 in misdemeanor criminal penalties for each violation.
28. Only limited disturbance will be permitted to initially access and acquire borrow to construct control facilities, before general site alteration begins.
29. If fuel or other dangerous chemicals are stored on site, then a Preparedness, Prevention and Contingency (PPC) Plan must be developed and kept on site.
30. During dry and windy conditions Dust Control measures shall be implemented to suppress air-borne dust and may include sprinkling/irrigation, vegetative cover establishment, mulching, matting, tillage, stone, and spray-on chemical treatments. Refer to the PADEP Erosion & Sediment Control Manual, Appendix H, Dust Control for further information.
31. An erosion control blanket must be installed on all disturbed slopes steeper than 3:1 in all areas with concentrated flows as noted on the drawings.

31. Underground utilities cutting through any active channel shall be immediately backfilled and the channel restored to its original cross-section and protective lining. Any base flow within the channel shall be conveyed past the work in the manner described in this plan until such restoration is complete.
32. Fill Materials:
- a. The NPDES Permit covers the "moving, depositing, stockpiling, or storing of soil, rock, or earth materials." If the site will need to have fill imported from an off site location, the responsibility for performing environmental due diligence and the determination of clean fill will in most cases reside with the Operator. If the site will have excess fill that will need to be exported to an off site location, the responsibility of clean fill determination and the environmental due diligence rests on the applicant. If all cut and fill materials will be used on the site, a clean fill determination is not required by the operator unless there is a belief that a spill or release of a regulated substance occurred on site. The contractor is responsible for ensuring that any material brought onto the site is Clean Fill. Form FP-001 must be retained by the property owner for any fill material affected by a spill or release of a regulated substance but qualifying as Clean Fill due to analytical testing.
  - b. Applicants and/or operators must use environmental due diligence to ensure that the fill material associated with this project qualifies as Clean Fill. Definitions of Clean Fill and Environmental Due Diligence are provided below. All fill material must be used in accordance with the Department's policy "Management of Fill", document number 258-2182-773. A copy of this policy is available online at [www.depweb.state.pa.us](http://www.depweb.state.pa.us). Under the heading Quick Access on the left side of the screen, click on "Forms and Publications." On the left side of the screen click on "Technical Guidance Documents- Final." Then type the document number 258-2182-773 into the search window and conduct the search. Click on "Management of Fill."
  - c. Clean Fill is defined as: Uncontaminated, non-water soluble, non-decomposable, inert, solid material. The term includes soil, rock, stone, dredged material, used asphalt, and brick, block or concrete from construction and demolition activities that is separate from other waste and is recognizable as such. The term does not include materials placed in or on the waters of the Commonwealth unless otherwise authorized. (The term "used asphalt" does not include milled asphalt or asphalt that has been processed for re-use.)
  - d. Clean Fill affected by a spill or release of a regulated substance: Fill materials affected by a spill or release of a regulated substance still qualifies as clean fill provided the testing reveals that the fill material contains concentrations of regulated substances that are below the residential limits in Tables FP-1a and FP-1b found in the Department's policy "Management of Fill."
  - e. Environmental due diligence: Investigative techniques, including, but not limited to, visual property inspections, electronic data base searches, review of property ownership, review of property use history, Sanborn maps, environmental questionnaires, transaction screens, analytical testing, environmental assessments or audits. Analytical testing is not a required part of due diligence unless visual inspection and/or review of the past land use of the property indicates that the fill may have been subjected to a spill or release of regulated substance. If the fill may have been affected by a spill or release of a regulated substance, it must be tested to determine if it qualifies as clean fill. Testing should be performed in accordance with Appendix A of the Department's policy "Management of Fill."
  - f. Fill material that does not qualify as clean fill is regulated fill. Regulated fill is waste and must be managed in accordance with the Department's municipal or residual waste regulations based on 25 Pa. Code Chapters 287 Residual Waste Management or 271 Municipal Waste Management, whichever is applicable.

TEMPORARY SEEDING SCHEDULE

The contractor shall immediately temporarily stabilize any rough graded area, topsoil stockpile, or unused excavated fill material that will be left idle for less than 1 year. The grass will provide interim protection against the impact of precipitation, running water and wind. Permanently seed any area that will be idle for more than 1 year.

Temporary seeding schedule is as follows:

Species:	annual rye grass
% Live Seed:	98%
Application rate:	10 lbs./1,000 sq. yds.
Fertilizer type:	general purpose granular, 10-20-20
Fertilizer application rate:	11 lbs./1,000 sq. yds.
Liming rate:	per soil test; minimum of 4 tons per acre.
Strawdale mulch rate:	1,200 lbs./1,000 sq. yds.
Seeding dates:	no seeding between 11/1 and 3/15
Mulch anchoring:	Asphalt, either emulsified or cut-back, containing no solvents or other diluting agents toxic to plant or animal life, uniformly applied at the rate of 31 gallons per 1,000 square yards. Synthetic binders (chemical binders) may be used per manufacturer's recommendation provided they are non-toxic to plant and animal species.

When seeding is not possible due to the time of year or other limitations, disturbed area shall be mulched with strawbales at the rate above. An erosion control blanket must be installed on all disturbed slopes steeper than 3:1, and all areas with concentrated flows. Matting can be North American Green 'S75' or approved equal.

PERMANENT SEEDING SCHEDULE--

All disturbed soil not to be covered with impervious surfaces, riprap or landscaping mulch shall be permanently seeded to provide protection against the impact of precipitation, running water and wind. Permanent seeding schedule for the general project area is as follows:

Species:	45% Kentucky bluegrass (50/50 variety mix) 45% Penninn Creeping Red Fescue 20% Noreia Perennial ryegrass 5% annual ryegrass
% Pure live seed:	98%
Application rate:	6 lbs./1000 sq. ft.
Fertilizer type:	general purpose granular, 10-20-20
Fertilizer application rate:	11 lbs./1000 sq. yds.
Liming rate:	per soil test; minimum of 6 tons per acre
Seeding dates:	between 3/15-6/1 and 8/1-10/15

Apply all permanent seed at rates equivalent with above broadcast rates in accordance with PENNDOT 408 Sec. 805.3 in a potable water-based slurry with a Bonded Fiber Matrix hydromulch material. Care shall be taken to not spray areas unintended for seeding.

An erosion control blanket must be installed on all disturbed slopes steeper than 3:1, and all areas with concentrated flows. Matting can be North American Green 'S75' or approved equal.

A minimum of 6" of topsoil shall be placed prior to seeding.

MAINTENANCE OF TEMPORARY EROSION & SEDIMENT CONTROL FACILITIES

1. Until the site is stabilized, all erosion and sediment control BMPs must be maintained properly. Responsibility for implementing and maintaining erosion and sedimentation control measures shall be designated to a minimum of one individual who will be present at the project site each working day. Maintenance must include inspections of all erosion and sediment control BMPs after each runoff event and on a weekly basis, to ensure that they are in place, stable, and functioning properly. All preventative and remedial maintenance work, including clean out, repair, replacement, re-grading, reseeding, re-mulching, and re-netting must be performed immediately, to restore the control measure to the original design. If erosion and sediment control BMPs fail to perform as expected, replacement BMPs, or modifications of those installed, will be required.
2. A log showing dates that E & S BMPs were inspected as well as any deficiencies found and the date they were corrected shall be maintained on the site and be made available to regulatory agency officials at the time of inspection.
3. Any sediment removed from BMPs during construction will be returned to upland areas within the project area, and incorporated into the site grading, or in the manner described on the plan drawings.
4. See the construction details and seeding specifications for maintenance procedures for the various control measures.
5. Mud must be removed from vehicle tires before they exit the site. Sediment tracked onto any public roadway or sidewalk shall be returned to the construction site by the end of each work day and disposed in the manner described in this plan. In no case shall the sediment be washed, shoveled, or swept into any roadside ditch, storm sewer or surface water.

STAGING OF EARTH MOVING ACTIVITIES

General Notes:

1. A licensed professional or a designee shall be present on site during construction of the following critical stages of implementation of the approved PCSM plan:
- A. Storm Basin #1 Underdrain and Soil Amendments
2. At least 3 days before starting any earth disturbance activities, all contractors involved in those activities shall notify the Pennsylvania One Call system Incorporated at 1-800-242-1776 for the location of existing underground utilities.
3. All earth disturbance activities shall proceed in accordance with the following specific sequencing. Each stage shall be completed and immediately stabilized before any following stage is initiated. Clearing, grubbing and topsoil stripping shall be limited only to those areas described in each stage. Any deviation from the following sequence must be approved in writing from the Cumberland County Conservation District.
4. Immediately upon discovering unforeseen circumstances posing the potential for accelerated erosion and/or sediment pollution, the operator shall implement appropriate best management practices to eliminate the potential for accelerated erosion and/or sediment pollution.
5. At least 7 days before starting any earth disturbance activities, the owner and/or operator shall invite all contractors involved in those activities, the landowner, all appropriate municipal officials, and a representative of the Cumberland County Conservation District to an on-site pre-construction meeting.
6. Immediately after earth disturbance activities cease, the operator shall stabilize the disturbed areas. During non-germinating periods, mulch must be applied at the specified rates. Disturbed areas which are not at finished grade and which will be re-disturbed within 1 year must be stabilized in accordance with the temporary seeding vegetative stabilization specifications. Disturbed areas which are not at final grade or which will not be re-disturbed within 1 year must be stabilized in accordance with the permanent seeding vegetative stabilization specifications.
7. All pumping of sediment laden water shall be through a sediment control BMP, such as a pumped water filter bag or equivalent sediment removal facility, over undisturbed vegetated areas.
8. Upon temporary cessation of an earth disturbance activity or any stage or phase of an activity where a cessation of earth disturbance activities will exceed 4 days, the site shall be immediately seeded, mulched, or otherwise protected from accelerated erosion and sedimentation pending future earth disturbance activities.

Specific Staging of Earthmoving Activities.

1. Field mark the limits of disturbance.
2. Bring site to final sub-grade elevation in the area of the Stabilized Construction Entrance and install Stabilized Construction Entrance.
3. Install Silt Barriers #1 and #2.
4. Bring site to subgrade, constructing Sediment Basin as first priority. Use lightest equipment as practical during the construction of the Sediment Trap as this will be used as an filtration / managed release basin during the Post Construction Stormwater Management state. Permanent slopes of 3:1 or greater require temporary N.A.G. S75 matting or equivalent. Permanently seed and mulch slopes as soon as they are to final grade. Delay Amended Soils and basin sub-drain until rest of site is complete and stabilize and ready for final PCSM conversion.
5. Install Temporary Baffle and cleanout marker stake in Sediment Basin.
6. Install Sediment Barrier #3.
7. Install basin discharge pipe, rock apron, and level spreader. Delay permanent Stormwater Basin Discharge Structure until site is stabilized and ready for conversion to final PCSM condition.
8. Install Temporary Riser for Sediment Trap and associated dewatering facility and trash rack.
9. Install stormwater structures, rock aprons, storm sewers, and associated inlet protection.
10. Begin Building Construction.
11. Install water service. Install sanitary sewer pump station lateral, & force main.
12. Install curb
13. Install stone base at parking lot, access drive, walkways concrete pads..
14. Complete construction of buildings, and concrete/ asphalt paving.
15. Permanently seed and mulch remaining lawn areas.
16. Install proposed landscaping.

Conversion to PCSM

\*- Item requires on-site observation by designated professional during installation.

1. Temporary control measures can only be removed when the watershed draining to the measure is permanently stabilized and removal is authorized by the Cumberland County Conservation District. Permanently stabilized is defined as a minimum uniform 70% perennial vegetative cover or other permanent non-vegetative cover with a density capable to resist accelerated surface erosion, and subsurface characteristics sufficient to resist sliding and other movements. The location of the control measure must be immediately permanently stabilized upon its removal. All areas to be permanently seeded shall have a minimum depth of 6" of topsoil before seeding.
2. \*Install Amended Soils and permanent basin subdrain.
3. Convert Discharge structure to permanent condition.
4. Upon completion of all earth disturbance activities and permanent stabilization of all disturbed areas, the owner and/or operators shall contact the Cumberland County Conservation District for an inspection prior to the removal/conversion of the E&S BMP's.
5. Upon approval from the Cumberland County Conservation District, Sediment Basin 1 shall be converted to the permanent condition as indicated on the PCSM plan. Sediment Basin shall be dewatered and any baffles and cleanout stakes shall be removed. The permanent emergency spillway associated with Storm Basin 1 shall be modified and outlet structure converted to permanent condition. All sediment deposited within storm sewers shall be removed prior to converting the sediment basin. Remove an additional 24" below the proposed basin bottom, replace with a 2:1 soil to compost mix and till up to 20". Install underdrain as shown on PCSM Plan and Profile. Permanently seed and mulch as required.
6. Upon approval from the Cumberland County Conservation District, all silt barriers shall be properly removed.
7. Upon completion of all earth disturbance activities, removal of all temporary BMPs, installation of all permanent PCSM BMPs, and permanent stabilization of all disturbed areas, the owner and/operators shall contact the Cumberland County Conservation District for a final inspection.

SPECIALTY SEEDING SCHEDULES:

NATIVE STEEP SLOPE MIX W/ANNUAL RYEGRASS

(APPLY TO ALL 3:1 OR STEEPER SLOPES)

Mix Composition
31.1% Sorghastrum nutans, New England 2 Ecotype (Indiangrass, New England 2 Ecotype)
20.0% Lolium multiflorum (Annual Ryegrass)
14.0% Andropogon gerardii, 'Niagara' (Big Bluestem, 'Niagara')
10.0% Elymus virginicus, 'Madison' (Virginia Wildrye, 'Madison')
7.0% Elymus canadensis (Canada Wildrye)
4.0% Agrostis perennans, Albany Pine Bush-NY Ecotype (Autumn Bentgrass, Albany Pine Bush-NY Ecotype)
4.0% Panicum virgatum, 'Carthage', NC Ecotype (Switchgrass, 'Carthage', NC Ecotype)
3.0% Panicum clandestinum, Tioga (Deertongue, Tioga)
1.5% Echinacea purpurea (Purple Coneflower)
1.3% Chamaecrista fasciculata, PA Ecotype (Swainson's Pea, PA Ecotype)
1.2% Helopsis helianthoides, PA Ecotype (Oxeye Sunflower, PA Ecotype)
1.0% Coreopsis lanceolata (Lanceleaf Coreopsis)
1.0% Rudbeckia hirta (Blackeyed Susan)
0.3% Monarda fistulosa, Fort Indiantown Gap-PA Ecotype (Wild Bergamot, Fort Indiantown Gap-PA Ecotype)
0.2% Actaeas syriaca (Common Milkweed)
0.2% Solidago rugosa, PA Ecotype (Wrinkleleaf Goldenrod, PA Ecotype)
0.1% Aster lateriflorus (Calico Aster)
0.1% Aster pilosus, PA Ecotype (Heath Aster, PA Ecotype)

Item Number: ERNMX-181

Height: 1.0 - 6.3 Ft

Seeding Rate: 60 lb per acre, or 1.5 lb per 1,000 sq ft

RETENTION BASIN FLOOR MIX - LOW MAINTENANCE

(APPLY TO BOTTOM OF STORMWATER BASIN)

Mix Composition
20.0% Panicum clandestinum, Tioga (Deertongue, Tioga)
20.0% Puccinellia distans, Fuhs (Kikigrass, Fuhs)
18.0% Elymus virginicus, 'Madison' (Virginia Wildrye, 'Madison')
15.0% Agrostis stolonifera (Creeping Bentgrass)
15.0% Poa palustris (Fowl Bluegrass)
10.0% Carex vulpinoidea, PA Ecotype (Fox Sedge, PA Ecotype)
1.0% Carex scoparia, PA Ecotype (Blunt Broad Sedge, PA Ecotype)
1.0% Juncus effusus (Soft Rush)

Item Number: ERNMX-126

Seeding Rate: 20-40 lbs per acre, or 0.5-1 lb/1,000 sq ft with a cover crop. For a cover crop use one of the following: grain rye (1 Sep to 30 Apr; 30 lbs/acre), Japanese millet (1 May to 31 Aug; 10 lbs/acre), or barnyard grass (1 May to 31 Aug; 10 lbs/acre).

E&S CONTROL DETAILS

FOR

2509 MILL ROAD TOWNHOMES

LOCATED IN  
UPPER ALLEN TOWNSHIP, CUMBERLAND COUNTY, PA



R. J. FISHER & ASSOCIATES, INC.

SITE PLANNING & CIVIL ENGINEERING & LAND SURVEYS

1546 BRIDGE STREET, NEW CUMBERLAND, PA. 17070

PHONE: (717) 774-7534 & FAX: (717) 774-7190

RJFISHERENGINEERING.COM

NO.	REVISION	DATE
1	-	-
2	-	-
3	-	-
4	-	-
5	-	-

COPYRIGHT © 2021 BY R.J. FISHER & ASSOCIATES, INC.

DRAWING ID:  
221013-3-LD

PROJECT: 221013

DATE: 04/25/2022

SHEET:  
18 OF 18