



WATER OPERATING SERVICES
 WATER QUALITY
 10100 EAST JEFFERSON AVENUE
 DETROIT, MICHIGAN 48214
 PHONE: 313-926-8102 / 313-926-8127

GLWA Water Treatment Plants - Mineral Reports

Sample Dates: 05/16/2017 05/16/2017 05/16/2017 05/16/2017 05/16/2017 05/16/2017 05/16/2017 05/16/2017

Parameter	Formula	Units	Lake Huron		Southwest		Belle Isle	Water Works Park	Northeast	Springwells	MCL	Sec.Std	MDL
			Raw	Tap	Raw	Tap	Raw	Tap	Tap	Tap			
Turbidity		NTU	0.69	0.06	16.00	0.04	4.70	0.07	0.06	0.04	0.3/95% (1)		
Total Solids		mg/L	122	126	179	162	145	147	143	147		500	10
Total Dissolved Solids		mg/L	122	125	158	153	129	137	137	139		500	10
Aluminum	Al	mg/L	0.121	0.068	0.791	0.100	0.536	0.088	0.079	0.072		0.05-0.2	0.005
Iron	Fe	mg/L	0.013	< 0.050	0.487	0.007	0.163	< 0.005	< 0.005	0.009		0.3	0.005
Copper	Cu	mg/L	0.019	0.006	0.066	0.028	0.031	0.004	< 0.005	0.007	1.3 (AL)	1.0	0.002
Magnesium	Mg	mg/L	7.90	7.70	8.78	8.35	7.88	7.93	7.93	7.88			0.5
Calcium	Ca	mg/L	26.7	26.3	29.8	31.7	25.9	26.6	26.9	28.7			0.1
Sodium	Na	mg/L	4.56	4.46	6.18	5.90	4.76	4.78	4.85	4.96		20 (2)	0.1
Potassium	K	mg/L	0.92	0.92	1.24	1.15	0.93	0.96	0.97	0.96			0.1
Manganese	Mn	mg/L	< 0.002	< 0.002	0.012	< 0.002	0.004	< 0.002	< 0.002	0.007		0.05	0.002
Lead	Pb	mg/L	< 0.002	< 0.002	< 0.002	< 0.002	< 0.002	< 0.002	< 0.002	< 0.002	0.015 (AL)		0.001
Zinc	Zn	mg/L	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1		5	0.1
Silica	SiO ₂	mg/L	0.8	0.9	0.8	0.9	0.7	0.9	0.8	0.8			0.4
Sulfate	SO ₄ ²⁻	mg/L	15.7	20.3	15.5	26.6	16.6	21.8	25.0	26.9		250	
Chloride	Cl ⁻	mg/L	6.2	6.5	8.4	9.0	6.2	7.1	7.4	7.4		250	5
Phosphorus	P	mg/L	< 0.05	0.36	< 0.05	0.35	< 0.05	0.33	0.37	0.52			0.05
Free Carbon Dioxide	CO ₂	mg/L	1.3	5.0	1.4	8.2	0.9	6.2	8.4	9.2			
Total Hardness (3), (4), (5)		mg/L	102	102	116	126	114	106	118	102			
Total Alkalinity (3)		mg/L	84	76	102	86	82	78	80	70			
Carbonate Alkalinity (3)		mg/L	0	0	0	0	0	0	0	0			
Bi-Carbonate Alkalinity (3)		mg/L	84	76	102	86	82	78	80	70			
Non-Carbonate Hardness (3)		mg/L	18	26	14	40	32	28	38	32			
Chemical Oxygen Demand		mg/L	4.4	4.0	2.8	< 2.0	4.0	3.2	2.8	< 2.0			2
Dissolved Oxygen		mg/L	12.4	11.6	8.2	9.0	10.6	106.0	11.8	11.8			
Nitrite Nitrogen	NO ₂ ⁻ - N	mg/L	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1	1		0.1
Nitrate Nitrogen	NO ₃ ⁻ - N	mg/L	0.33	0.34	1.08	0.95	0.41	0.40	0.44	0.38	10		0.1
Fluoride	F ⁻	mg/L	0.09	0.72	0.11	0.61	0.09	0.66	0.66	0.63	4.0	2.0	0.5
pH			8.09	7.48	8.17	7.32	8.26	7.40	7.28	7.18		6.5-8.5	
Specific Conductance @ 25 °C.		micromhos	213	216	262	262	220	226	229	231			
Temperature		°C	12.0	12.5	14.5	14.6	18.9	18.8	13.3	13.8			

Legend	Notes:
MCL: Maximum Contaminant Level	(1) Turbidity must not exceed 0.3 NTU in 95% of samples in any month and always be < 1 NTU
Sec.Std: Secondary Standard	(2) EPA Guidance Level
NTU: Nephelometric Turbidity Unit	(3) As Calcium Carbonate
mg/L: Milligram Per Liter	mg/L is equivalent to part per million (ppm)
AL: Action Level	
MDL: Method Detection Limit	(4) By Titration
< : Less than	(5) Tap Water Hardness in Grains per Gallon multiply value by 0.058 (Grains/Gallon)/(mg/L)
AE: Analytical Error	(6) Reported results are below the low calibration standard but above the instrument
IV: Invalid Sample	detection limit.


Analyst: Brian Brown
 Reviewed By: Patrick Williford

Chemist-I
 Management Professional - Ops.

Initials: **B. B.**
 Initials: **P. W.**

Date: 07/31/2017
 Date: 07/31/2017

Great Lakes Water Authority

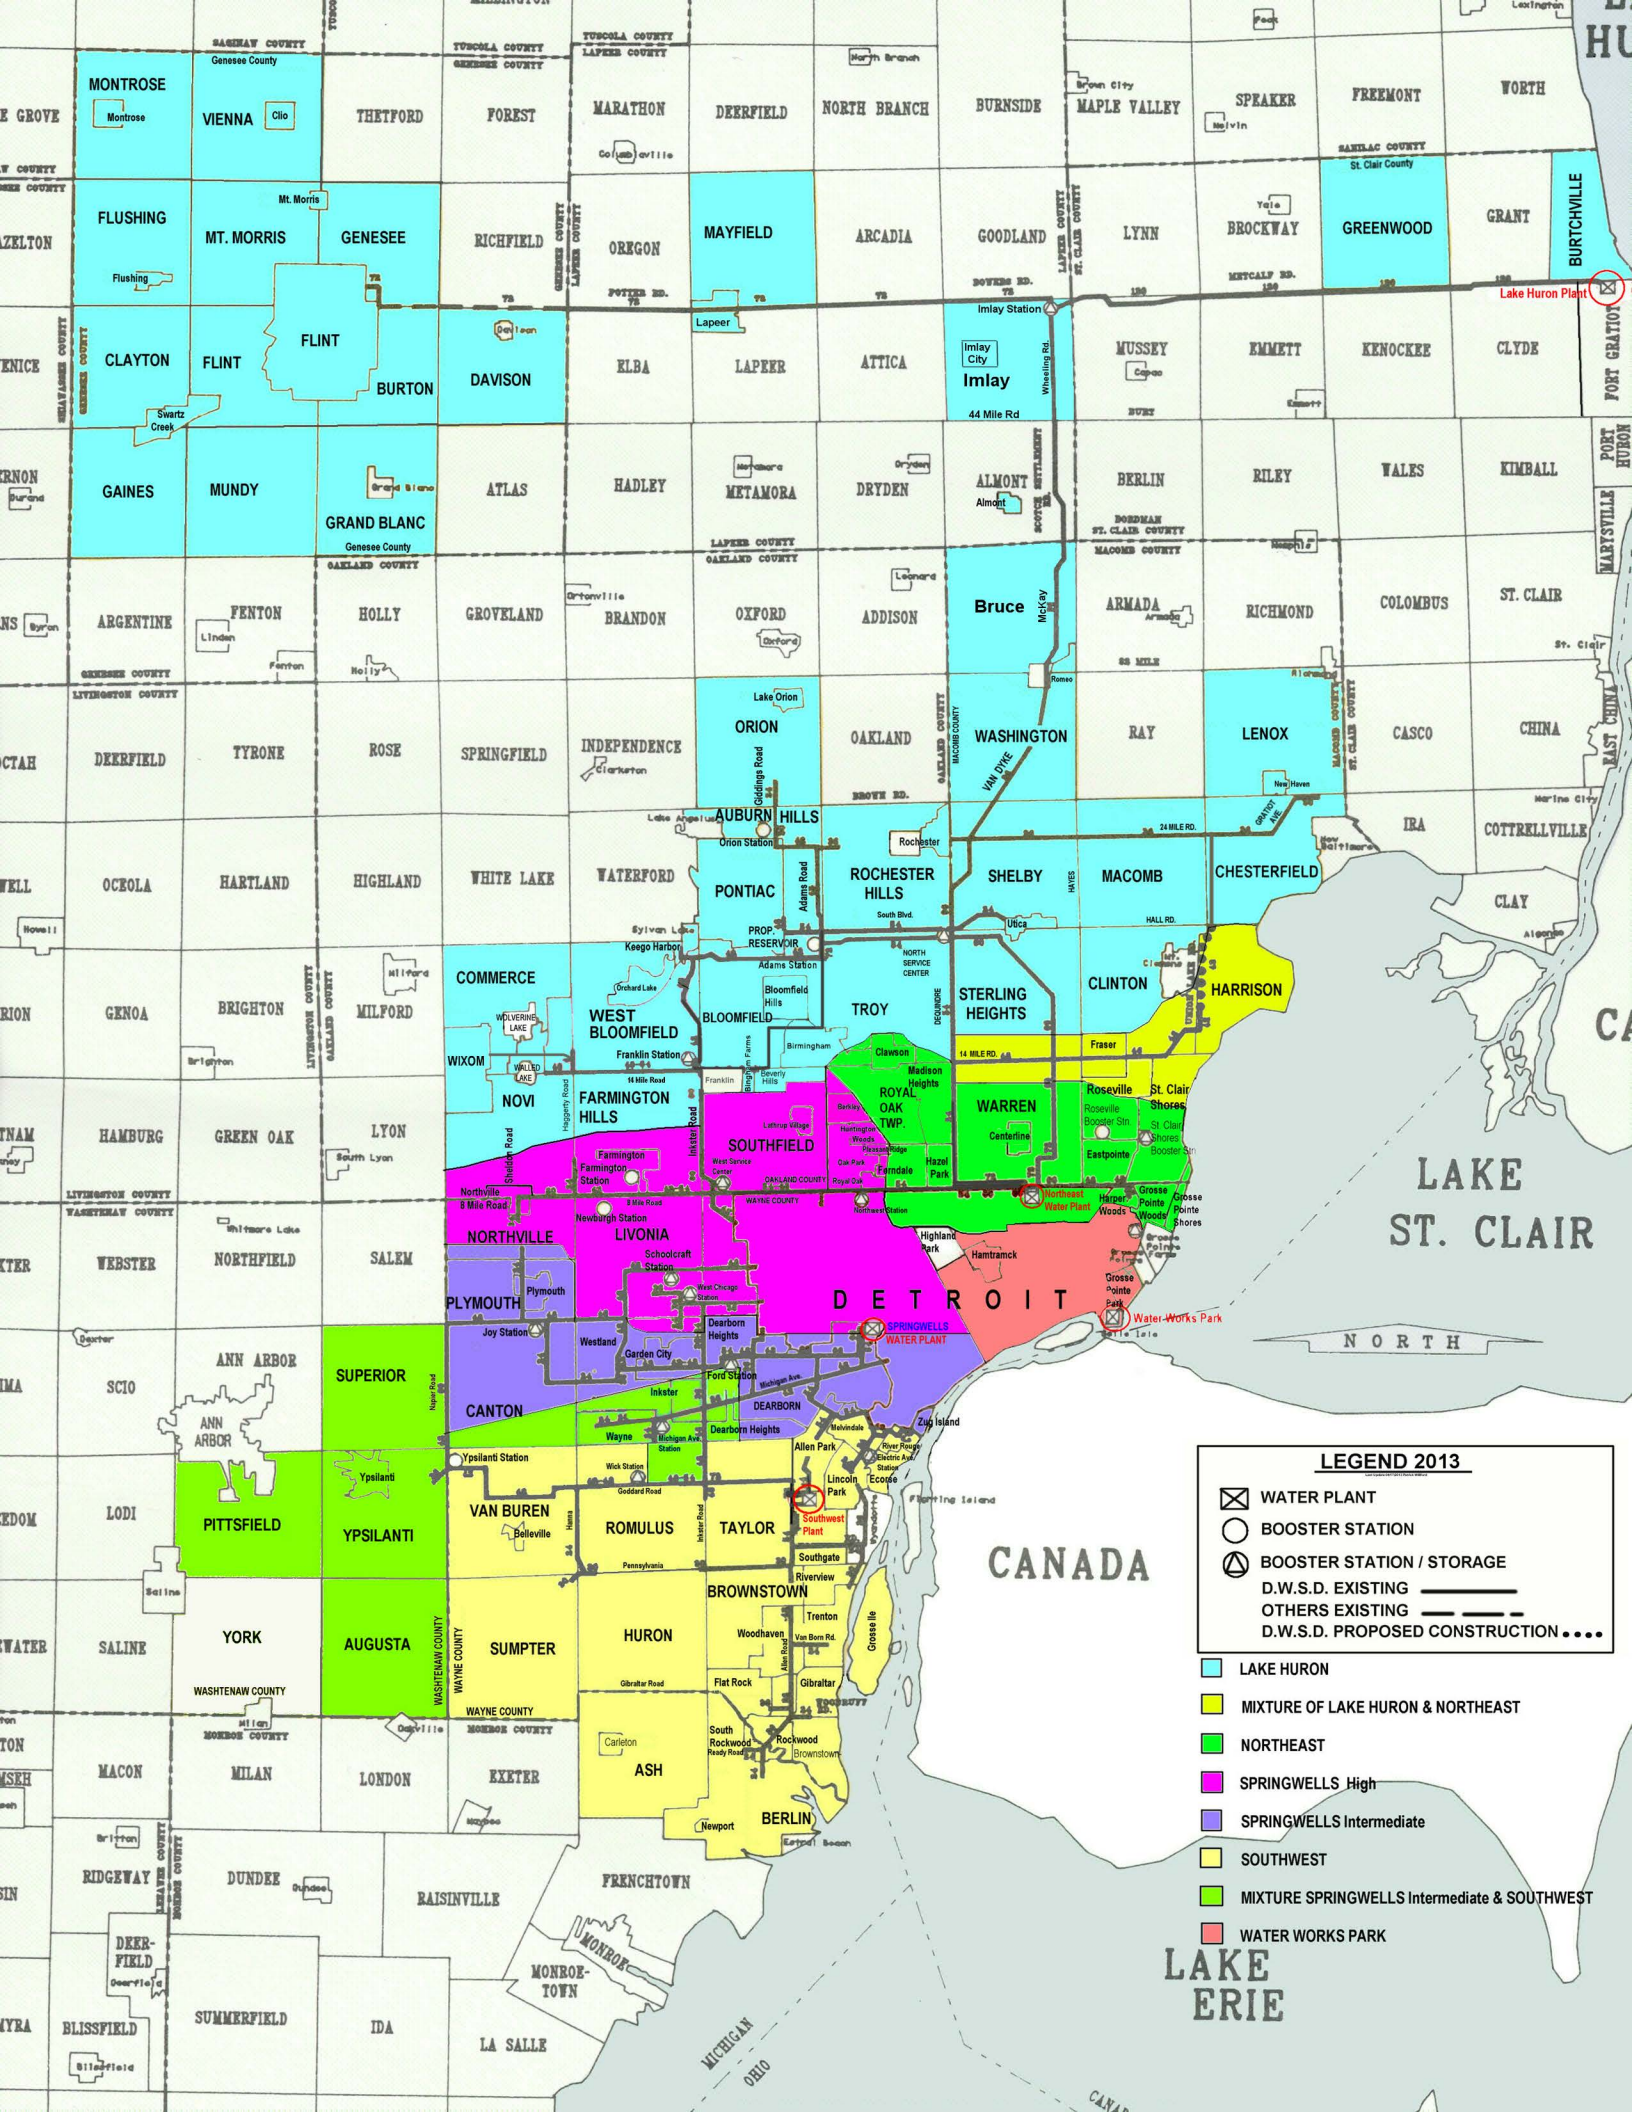

LEGEND 2013

- WATER PLANT
- BOOSTER STATION
- BOOSTER STATION / STORAGE
- D.W.S.D. EXISTING
- OTHERS EXISTING
- D.W.S.D. PROPOSED CONSTRUCTION

- LAKE HURON
- MIXTURE OF LAKE HURON & NORTHEAST
- NORTHEAST
- SPRINGWELLS High
- SPRINGWELLS Intermediate
- SOUTHWEST
- MIXTURE SPRINGWELLS Intermediate & SOUTHWEST
- WATER WORKS PARK

LAKE ERIE



CANADA

MICHIGAN OHIO